



Certifications



Intertek

NSF/Sanitation Compliance

This merchandiser model is manufactured to meet NSF/ANSI Standard 7 requirements for construction, materials, and cleanability.

⚠ WARNING

Component parts shall be replaced with like components, and servicing shall be done by factory authorized service personnel only, so as to minimize the risk of possible ignition due to incorrect parts or improper service.

Technical Datasheet

ID6NU

Open Multideck Medium
Temperature Display Case

Applications

Dairy, Deli, and Meat

P/N 3064394 Rev H

April 2026

Models Covered

ID6NU4, ID6NU6,
ID6NU8, ID6NU12

Refrigerant(s)

A2L (R-454A or R-454C)

R-744 (CO₂)

Glycol

HFC/HCFC/HFO

Table of Contents

Model Name	2
Performance Data	3
Refrigerant Data	4
Additional Data	5
Cross-section View	6
Plan View	7
Estimated Shipping Weight	8
Electrical Specifications	9
Wiring Diagrams	10

We reserve the right to change or revise specifications and product design in connection with any feature of our products. Such changes do not entitle the buyer to corresponding changes, improvements, additions, or replacements for equipment previously sold or shipped.

WARNING:

Read the entire installation, operation, and service manual before installing, servicing, or using this equipment in any way. Refer to the manual for detailed information about minimum room floor area and installation, maintenance, and service processes.

A2L Equipped Models

If the information in the instructions are not followed exactly, a fire or explosion may result, causing property damage, personal injury, or death. Installation and service must be performed by a qualified installer or service agency.



Mildly flammable A2L refrigerant used. Units that are configured to use A2L refrigerants require special attention. No open flames, cigarettes, or other possible sources of ignition should be used inside or in the vicinity of units containing flammable refrigerants.

If a refrigerant leak is present or even suspected, do not allow untrained personnel to attempt to find the cause. No open flames, cigarettes, or other possible sources of ignition should be used inside or in the vicinity of the unit(s). Intrinsically safe components are the only types that can be worked on while live in the presence of a flammable atmosphere.

Information on pre-installed A2L refrigerant sensors and detectors, safety shut-off and check valves, relay information, and additional parts replacement information can be found in the associated installation, operation, and service manual. All manual information must be reviewed in full prior to performing any work.

R-744 (CO₂) Equipped Models

This equipment uses carbon dioxide (R-744 [CO₂]) refrigerant for heat transfer. The system is sealed and pressure-tested with ASME-certified vessels, but leaks can occur in the event of a system failure. A CO₂ leak in an unventilated space can pose serious hazards. Therefore, units must be installed in areas with adequate ventilation and in accordance with local safety codes.

A leak of R-744 could result in a concentration exceeding the practical limit in an enclosed, occupied space such as a cold room. Precautions must be taken to prevent asphyxiation. These include the use of permanent leak detection, which activates an alarm in the event of a leak.



Observe all warnings and labels on the unit being installed or serviced such as the one below indicating high pressure.

All refrigeration servicing must be completed by a certified refrigeration installation professional, and all tubing and components **MUST** be qualified for CO₂ applications, with a minimum design pressure of 1,305 psig (90 bar).

Failure to abide by all warnings contained within the associated manual could result in an explosion, death, injury, and property damage.

Model Nomenclature

“ID6NU” is followed by a number representing the length of the case in feet (i.e., a 12-foot model would be “ID6NU12”).

Ordering Information

All options must be selected at time of ordering. Some lengths and/or applications require optional fan motor kits applied by the Hussmann Product Configurator (HPC).

Refrigeration Data ¹

ID6NU		Optimal Shelf Life			Energy Comparison
Application		Dairy/Deli/ Beverage/ Produce ¹	Convertible / Meat ¹	NSF Type 2 Ambient ⁴	AHRI 1200 Rating Point ^{1, 5}
Unlit Shelves	Discharge Air °F (°C)	33 (0.6)	33 (0.6)	34 (1.1)	35 (1.7)
	Average Evaporator °F (°C) ^{2, 3}	28 (-2.2)	26 (-3.3)	26 (-3.3)	30 (-1.1)
	Parallel Btu/hr/ft (Watts/m)	1380 (1,327)	1,664 (1,600)	1,806 (1,736)	1,334 (1,283)
	Conventional Btu/hr/ft (Watts/m)	1,505 (1,447)	1,815 (1,745)	1,970 (1,984)	1,455 (1,399)
Lit Shelves ⁶	Discharge Air °F (°C)	32 (0)	32 (0)	33 (0.55)	34 (1.1)
	Average Evaporator °F (°C) ^{2, 3}	27 (-2.8)	25 (-3.9)	25 (-3.9)	29 (-1.7)
	Parallel Btu/hr/ft (Watts/m)	1,389 (1,335)	1,673 (1,609)	1,815 (1,745)	1,343 (1,291)
	Conventional Btu/hr/ft (Watts/m)	1,515 (1,457)	1,825 (1,755)	1,980 (1,904)	1,465 (1,409)
Fan Speed ⁷	ID6NU6 (10.3")	1,300	1,600 ⁷	1,600 ⁷	1,300
	ID6NU4, 8, 12 (10.3")	1,300	1,600 ⁷	1,600 ⁷	1,300

Notes:

- All data based on store temperature and humidity that does not exceed NSF Type 1 ambient conditions of 75°F and 55% relative humidity except where noted.
- Average evaporator temperature shown. Use dew point for high glide refrigerants for unit sizing. Care should be taken to use the dew point in PT tables for measuring and adjusting superheat. Adjust evaporator pressure as needed to maintain discharge air temperature shown.
- For DX CO₂ applications the average evaporator temperature may be lowered by 2°F but not more than 5°F. An EPR valve should be used if the system suction temperature is more than 5 degrees below the published case evaporator temperature. A 31°F flash tank temperature with a 24°F evaporator temperature is used when sizing default EEV selections to provide a minimum pressure drop across the valve of approximately 50 psig. For operating conditions that provide a pressure drop across the valve above 65 psig or below 35 psig, the electronic expansion valve size should be determined using the valve vendor sizing program and selected from the pull down list in the Hussmann Product Configurator (HPC).
- Data for operation in NSF Type 2 ambient of 80°F and 55% relative humidity.
- AHRI 1200 Rating Point for energy consumption comparison only.
- Add 10 Btu/hr/ft (9.6 Watts/m) per shelf row for LED shelf light fixtures.
- Some lengths and/or applications require optional fan motor kits applied by the Hussmann Product Configurator (HPC).

Defrost Data

Frequency (hours between defrost) 4
Defrost Water ⁸ 10.3 lb/ft/day
 (15.3 kg/m)
⁸ (± 15% based on case configuration and product loading).

OFFTIME ID6NU
Time (minutes) 20
ELECTRIC OR GAS Not Available

Conventional Controls

ID6NU
Low Pressure Backup
Control CI/CO ⁹
 20°F /10°F
 -6.7°C / -12.2°C

Indoor Unit Only,
Pressure Defrost
Termination ⁹
 48°F (8.9°C)

⁹ Use a Temperature Pressure Chart to determine PSIG conversions.

Product Data

Gross Refrigerated Volume ¹¹ (Cu Ft/Ft) 10.8 ft³/ft (1.00 m³/m)
AHRI Total Display Area ¹² (Sq Ft/Ft) 5.55 ft²/ft (1.69 m²/m)
Shelf Area ¹³ (Sq Ft/Ft) 9.58 ft²/ft (2.92 m²/m)

¹⁰ AHRI Gross Refrigerated Volume: Refrigerated Volume/Unit of Length, ft³/ft [m³/m]

¹¹ Computed using AHRI 1200 standard methodology: Total Display Area, ft² [m²]/Unit of Length, ft [m]

¹² Shelf surface area is composed of bottom deck plus standard shelf complement for this model: (5) rows of 18-in. shelves

Refrigerant Data**Approximate HFC/HCFC/HFO Refrigerant Charge¹³**

Case	Estimated Charge
ID6NU4	11.2 oz (318 g)
ID6NU6	19.2 oz (544 g)
ID6NU8	25.6 oz (726 g)
ID6NU12	49.6 oz (1,406 g)

A2L Refrigerant Charge

Model	Minimum Room Floor Area ft ² (m ²)	Estimated Refrigerant Charge — lb (g)	
		Operating Charge	
		R-454A	R-454C
ID6NU4	106 (9.8)	1.6 (728)	1.6 (728)
ID6NU6	106 (9.8)	2.2 (990)	2.2 (990)
ID6NU8	196 (18.2)	2.8 (1,269)	2.8 (1,269)
ID6NU12	196 (18.2)	4.1 (1,866)	4.1 (1,866)

R-744 (CO₂) Pressure Rating

Case Configuration	Pressure Rating
standard pressure CO ₂	652 psi (45 bar)
high pressure CO ₂	1,305 psi (90 bar)

Glycol Heat Transfer Fluid Data (Dairy)

Model	Coil Inlet Temperature ° F (° C)	Coil Temp. Rise ° F (° C)	Average Coil Temperature ° F (° C)	Flow Rate GPM (LPM)	Pressure Drop PSI (bar)
ID6NU4	25 (-3.9)	4 (2.2)	27 (-2.8)	3.3 (12.5)	9.5 (0.7)
	20 (-6.7)	14 (7.8)	27 (-2.8)	0.9 (3.4)	1.9 (0.1)
ID6NU6	25 (-3.9)	4 (2.2)	27 (-2.8)	5.0 (18.9)	6.5 (0.4)
	20 (-6.7)	14 (7.8)	27 (-2.8)	1.4 (5.3)	1.4 (0.1)
ID6NU8	25 (-3.9)	4 (2.2)	27 (-2.8)	6.6 (25.0)	11.0 (0.8)
	20 (-6.7)	14 (7.8)	27 (-2.8)	1.9 (7.2)	2.5 (0.2)
ID6NU12	25 (-3.9)	4 (2.2)	27 (-2.8)	9.8 (37.1)	11.2 (0.8)
	20 (-6.7)	14 (7.8)	27 (-2.8)	2.8 (10.6)	2.6 (0.2)

¹³ This is an average for all refrigerant types. Actual refrigerant charge may vary by approximately half a pound.

Open Multideck Medium Temperature Display Case Narrow Bottom, Ultra Low Height Front

ID6NU

DOE 2017
Energy Efficiency
Compliant

Husmann refrigerated merchandisers configured for sale for use in the United States meet or surpass the requirements of the DOE 2017 energy efficiency standards.

Dimensions shown as in. and (mm).

Other optional kits (top piping and vent fans) add to the overall case height.

A minimum 1 1/2-in. clearance required to remove raceway cover, 6 1/2-in. for full access. See the Installation manual for instructions.


3-in. between back to back cases.

Shelf complement shown as tested:


Five rows of 18-in. shelves spaced equally between bottom display pan and interior top panel.

Shown with Standard Faceted Canopy.

OPTIONAL RAIL LIGHT

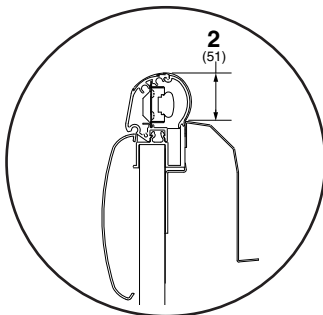

ID6NU

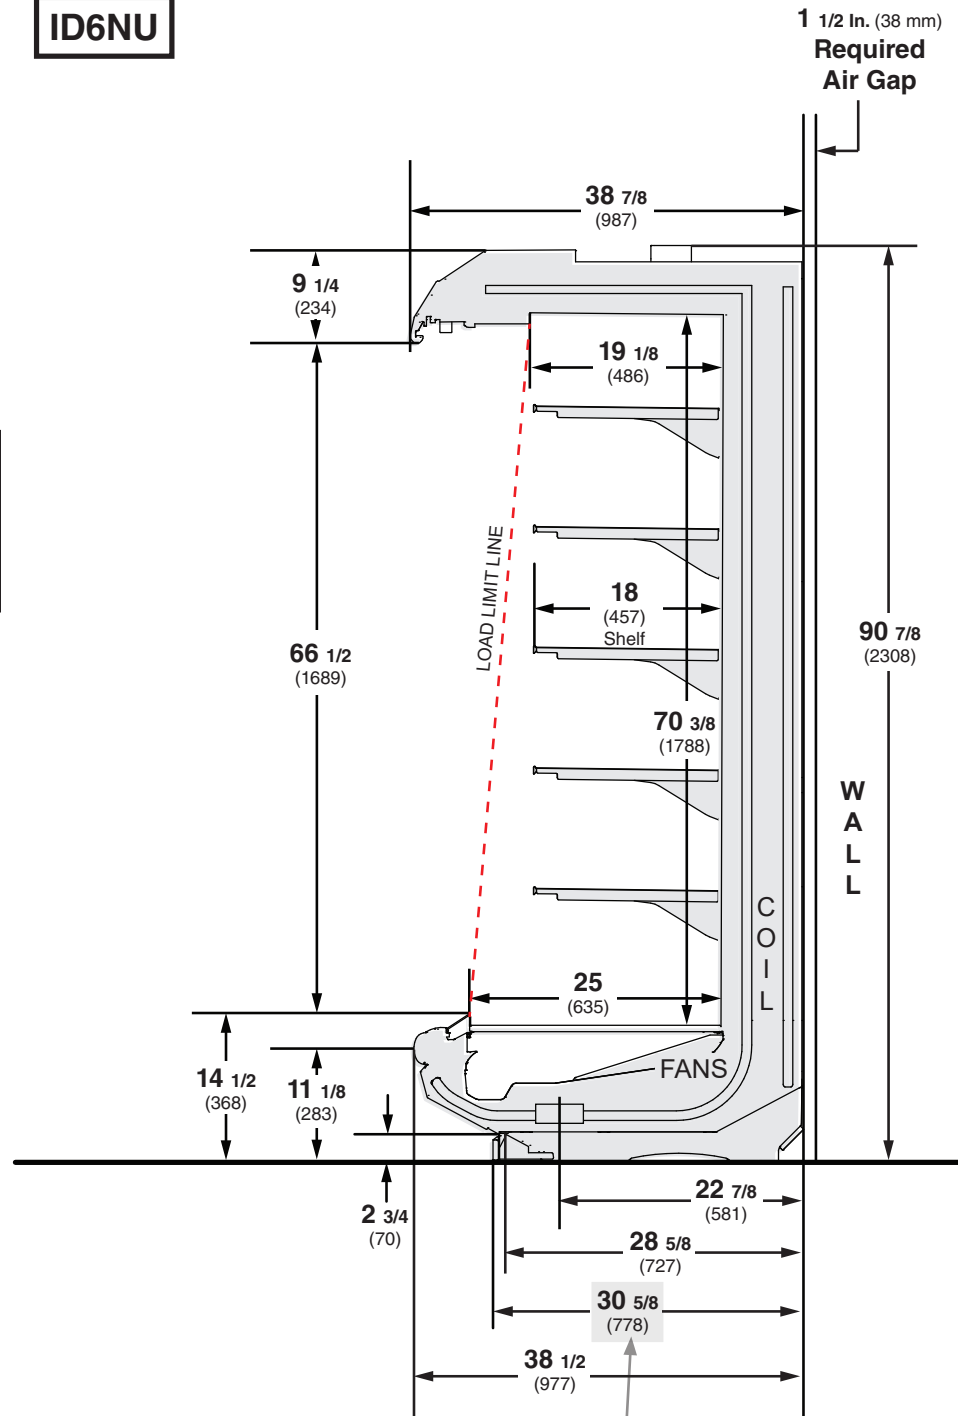


NOTE:

If extended drain kits are used, the distance from back of case (not including air gap) increases to 35 1/8 inches. This may affect floor drain layout. See Page 7 for more details.

Plan View

Dimensions shown as in. and (mm).

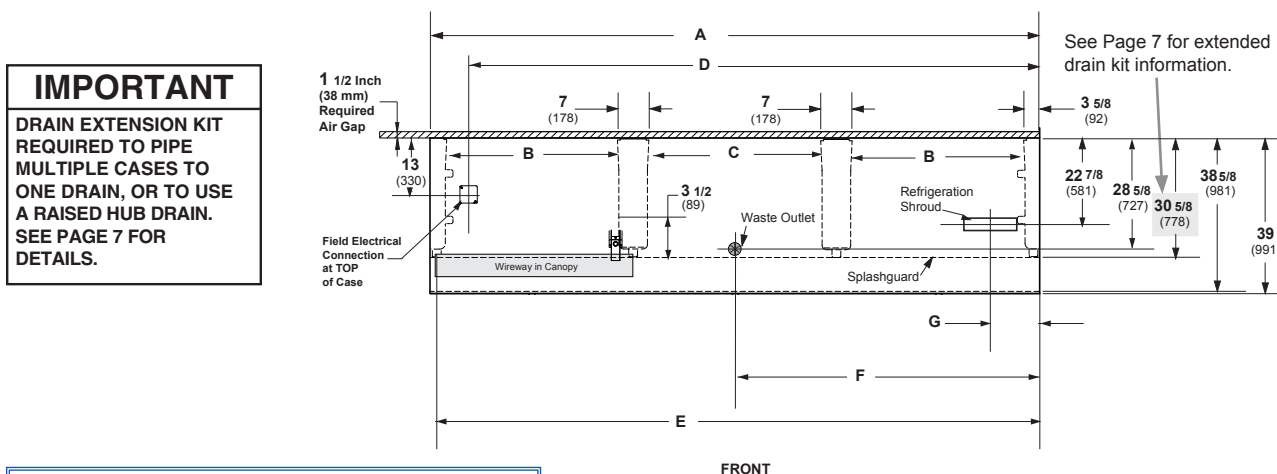

Insight standard field electrical connections are at the top left of the merchandiser.


(12 Foot Model shown above)

	4 ft	6 ft	8 ft	12 ft
General				
(A) Case Length (without ends or partitions) (Each end and insulated partition adds 1 1/2 in. (38 mm) to case line up.)	48 1/8 (1222)	72 1/4 (1835)	96 1/4 (2445)	144 3/8 (3668)
Maximum O/S dimension of case back to front (includes bumper)	38 5/8 (981)	38 5/8 (981)	38 5/8 (981)	38 5/8 (981)
Back of case to front of splashguard	30 5/8 (778)	30 5/8 (778)	30 5/8 (778)	30 5/8 (778)
(B) Distance between edges of external legs and center legs	NA	29 (737)	41 (1041)	41 (1041)
(C) Distance between edges of center legs	41 1/8 (1045)	NA	NA	41 1/8 (1045)
Distance between front legs and splashguard	3 1/4 (83)	3 1/4 (83)	3 1/4 (83)	3 1/4 (83)
Electrical Service (Field Electrical Wiring Connection)				
(D) RH End of case to center of Field Electrical Wiring Connection (top of case)	39 3/8 (1000)	63 1/2 (1613)	87 1/2 (2223)	135 1/2 (3442)
Back of case to center of Field Electrical Wiring Connection	13 (330)	13 (330)	13 (330)	13 (330)
Length of electrical wireway	44 5/8 (1133)	33 1/2 (851)	45 7/8 (1165)	45 7/8 (1165)
(E) RH end of case to LH end of electrical wireway (top of case)	46 1/2 (1181)	70 1/2 (1791)	94 1/2 (2400)	142 5/8 (3630)
Waste Outlets (see page 5 for drain extension option)				
(F) RH End of case to the center of waste outlet	24 1/8 (613)	24 1/8 (613)	24 1/8 (613)	72 1/4 (1835)
Back O/S of case to center of waste outlet(s)	28 5/8 (727)	28 5/8 (727)	28 5/8 (727)	28 5/8 (727)
Schedule 40 PVC drip pipe	1 1/4 (32)	1 1/4 (32)	1 1/4 (32)	1 1/4 (32)
Floor Drain must be located within 24 inches of Waste Outlet.				
Refrigeration Shroud				
(G) Back of case to center of refrigeration shroud	22 7/8 (581)	21 1/8 (537)*	22 7/8 (581)	22 7/8 (581)
End of case to center of refrigeration shroud	9 1/2 (241)	7 5/8 (194)*	9 1/2 (241)	9 1/2 (241)
*6 foot case at 42° angle, parallel to the plenum.				

**Waste Outlet
Drain Extension
Option**

Drain Extension Option


(Partial End View)

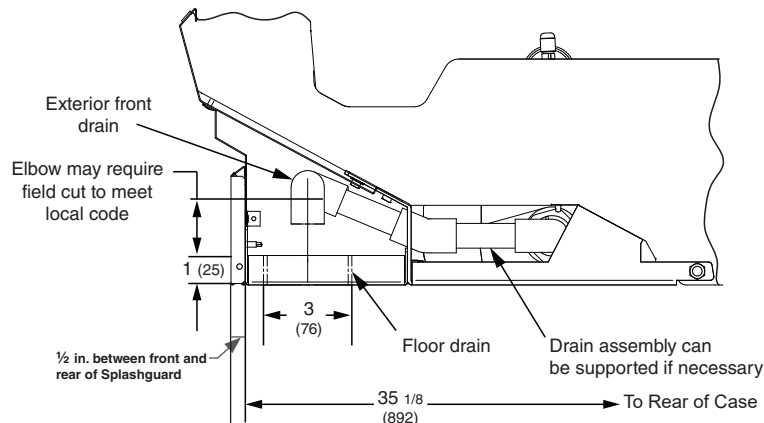

IMPORTANT: If hub drain is used in lieu of flush floor sink, a drain extension kit must be installed. Hub drains must be located in front of the waste outlet to achieve adequate air gap.

**Engineering
Plan View**

Dimensions shown as in. and (mm).

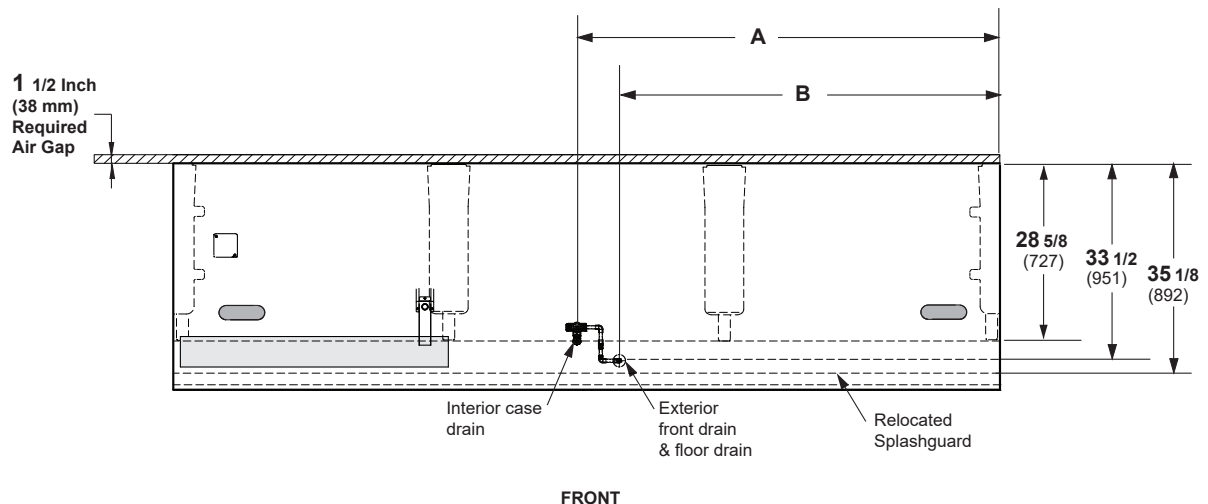

(12 Foot Model shown above)

	4 ft	6 ft	8 ft	12 ft
Waste Outlet Drain Option				
(A) RH of case to center of interior case drain	24 1/8 (613)	24 1/8 (613)	24 1/8 (613)	72 1/4 (1835)
(B) RH of case to center of exterior front drain and floor drain	13 3/4 (349)	13 3/4 (349)	13 3/4 (349)	61 7/8 (1572)

Electrical Data

Number of Fans	4 ft	6 ft	8 ft	12 ft
10.3-in.	1	2	2	3

			Amperes				Watts			
Evaporator Fan			4 ft	6 ft	8 ft	12 ft	4 ft	6 ft	8 ft	12 ft
120V	60Hz	Energy Efficient	0.40	0.80	0.80	1.20	24	48	48	72
230V	50/60Hz	Energy Efficient	0.21	0.42	0.42	0.62	24	48	48	72

Minimum Circuit Ampacity						
120V	60Hz	Energy Efficient	0.60	1.00	1.00	1.40
230V	50/60Hz	Energy Efficient	0.41	0.62	0.62	0.82

Maximum Over Current Protection						
120V			20	20	20	20
230V			15	15	15	15

Lighting

ONLY LIGHTING CONFIGURATIONS THAT ARE COMPLIANT WITH THE U.S. DEPT. OF ENERGY (DOE) 2017 REGULATION ARE AVAILABLE FOR SALE FOR USE IN THE U.S.A.

			Amperes				Watts			
			4 ft	6 ft	8 ft	12 ft	4 ft	6 ft	8 ft	12 ft
STANDARD LED LIGHTING										
LED Canopy Lights										
1 Row			0.16	0.22	0.31	0.47	19	27	38	57

OPTIONAL LED LIGHTING										
2 Rows of Canopy Lights			0.32	0.44	0.62	0.94	38	54	76	114

LED SHELF LIGHTING										
1 Row of Shelves			0.06	0.07	0.11	0.17	7	9	13	20
2 Rows of Shelves			0.11	0.15	0.22	0.33	13	18	27	40
3 Rows of Shelves			0.17	0.22	0.33	0.50	20	27	40	60
4 Rows of Shelves			0.22	0.30	0.44	0.67	27	36	53	80
5 Rows of Shelves			0.28	0.37	0.56	0.83	33	44	67	100
6 Rows of Shelves			0.33	0.44	0.67	1.00	40	53	80	120
7 Rows of Shelves			0.39	0.51	0.78	1.17	47	62	93	140

LED Rail Light										
1 Row			0.06	0.07	0.11	0.17	7	9	13	20

120V Lighting Circuit Total = Standard Lighting + Total Optional Lighting + Optional Shelf Lighting
230V Lighting Circuit Total = Multiply 120V Lighting Circuit Total by 0.52

ENDS or PARTITIONS Each standard end and each insulated partition adds 1 1/2 in. (38 mm) to case line up. Optional view end with end bumper adds 3 3/4 in. (95 mm).	PHYSICAL DATA Merchandiser Drip Pipe (in.)1 1/4 Schedule 40 PVC Merchandiser Liquid Line (in.)3/8 Merchandiser Suction Line (in.)7/8																		
ESTIMATED SHIPPING WEIGHT † <table><tr><td>Case</td><td></td><td></td><td></td><td></td><td>Solid End</td></tr><tr><td></td><td>4 ft</td><td>6 ft</td><td>8 ft</td><td>12 ft</td><td>(each)</td></tr><tr><td>lb (kg)</td><td>850 (386)</td><td>1050 (476)</td><td>1250 (567)</td><td>1650 (748)</td><td>100 (45)</td></tr></table> † Actual weights will vary according to optional kits included.		Case					Solid End		4 ft	6 ft	8 ft	12 ft	(each)	lb (kg)	850 (386)	1050 (476)	1250 (567)	1650 (748)	100 (45)
Case					Solid End														
	4 ft	6 ft	8 ft	12 ft	(each)														
lb (kg)	850 (386)	1050 (476)	1250 (567)	1650 (748)	100 (45)														

Shelf Options

Approved shelf sizes for standard (horizontal, 2-3 position brackets) displays:

14-inch
16-inch
18-inch

Contact engineering for non-standard (4 position brackets or other) display recommendations.




Minimum number of Shelves: 4

Optimal number of Shelves: 5

Maximum number of Shelves: 8

Maximum number of Lighted Shelves: 7

Standard shelf complement for test purposes: (5) rows of 18-in. shelves evenly distributed vertically.

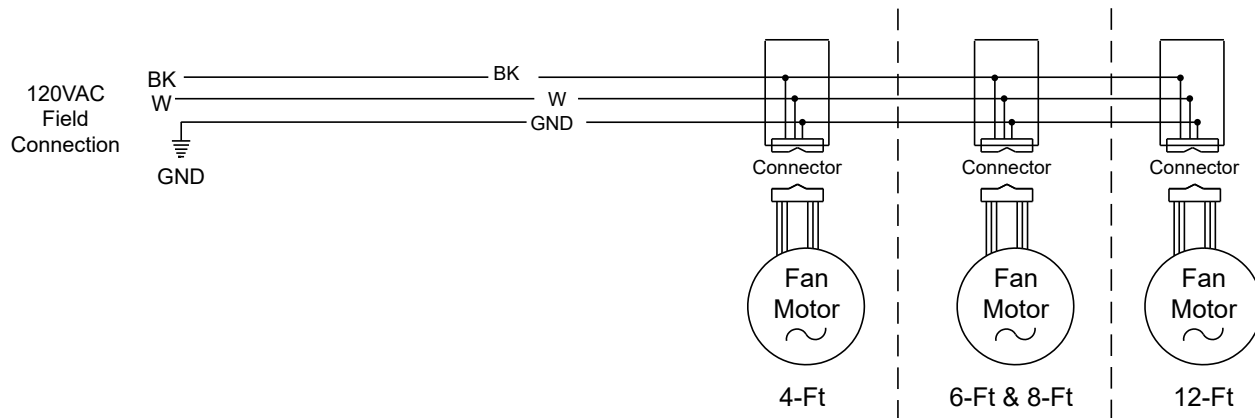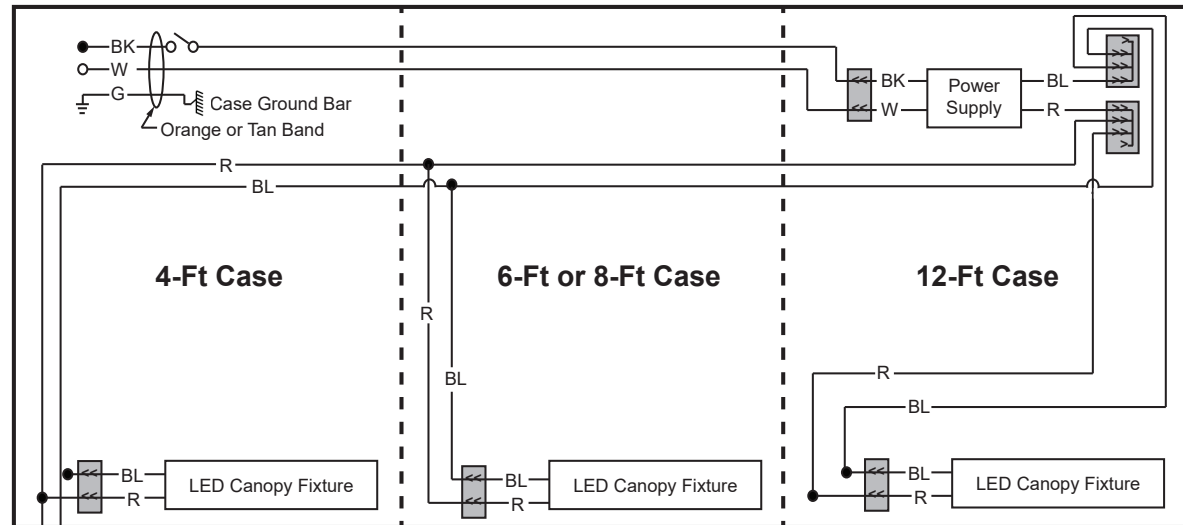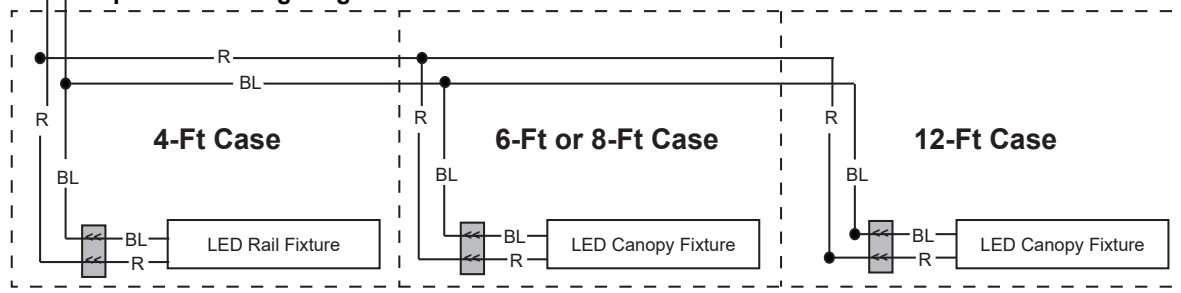
**Fan Wiring
Offtime Defrost****LED Canopy Light Circuits****LED Canopy Lighting - 2 Rows****Optional LED Lighting - LED Rail - 1 Row****WARNING**

All components must have mechanical ground, and the merchandiser must be grounded.

R = Red Y = Yellow G = Green BL = Blue BK = Black W = White
 ● = 120V POWER ○ = 120V NEUTRAL ⚡ = FIELD GROUND ⏏ = CASE GROUND

Optional Shelf Lighting—LED Fixtures

Optional Shelf Harness and LED Light Circuits for 4 or 5 Rows of Shelves

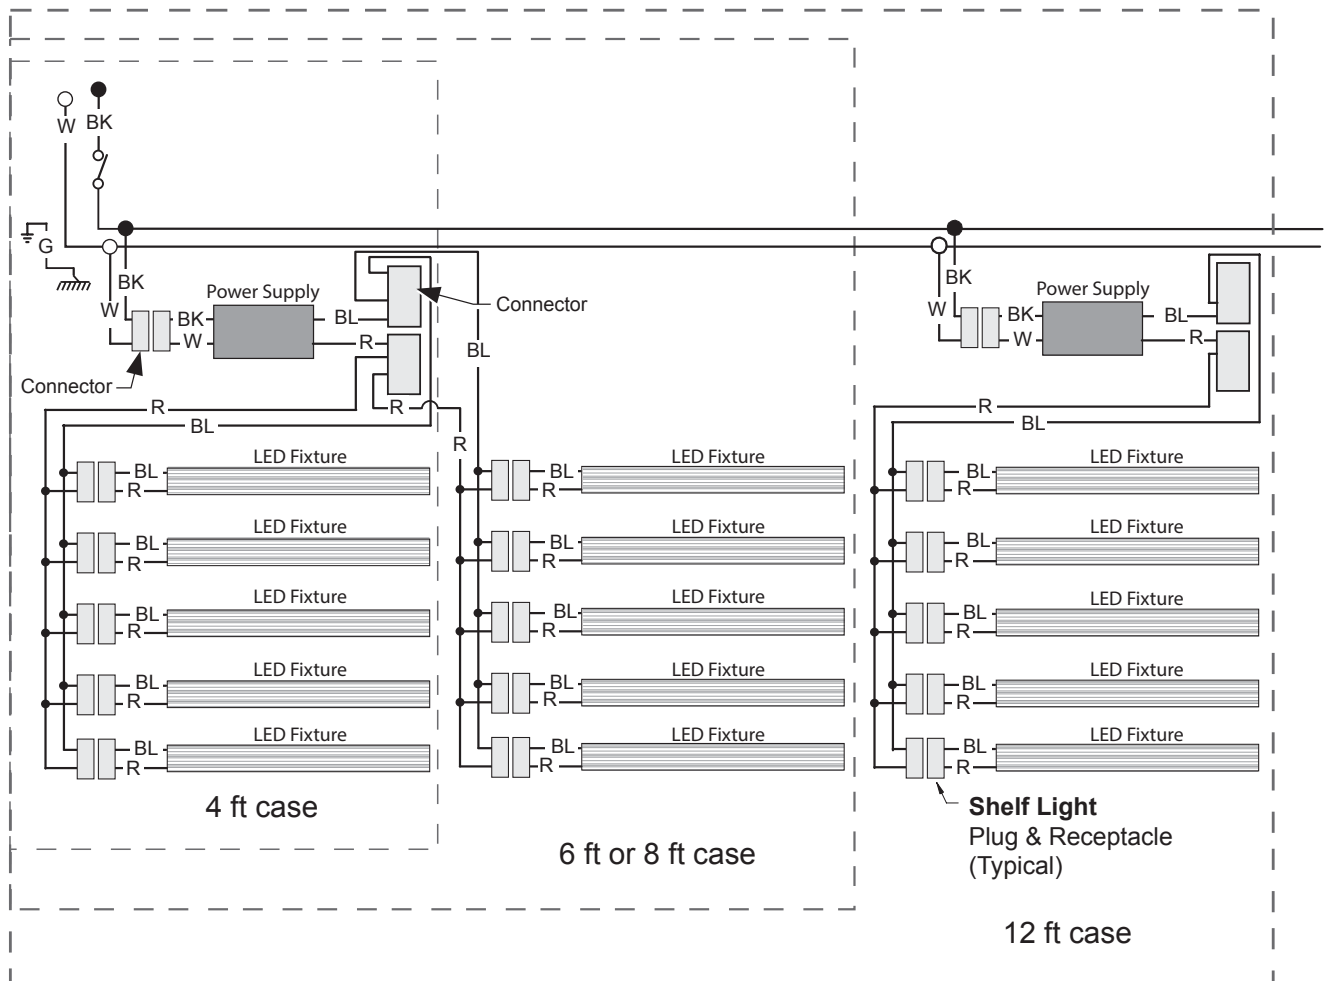


WARNING

All components must have mechanical ground, and the merchandiser must be grounded.

R = Red Y = Yellow G = Green BL = Blue BK = Black W = White
 ● = 120V POWER ○ = 120V NEUTRAL ⚡ = FIELD GROUND ⏏ = CASE GROUND

Optional Shelf Lighting—LED Fixtures

Optional Shelf Harness and LED Light Circuits for 6 or 7 Rows of Shelves

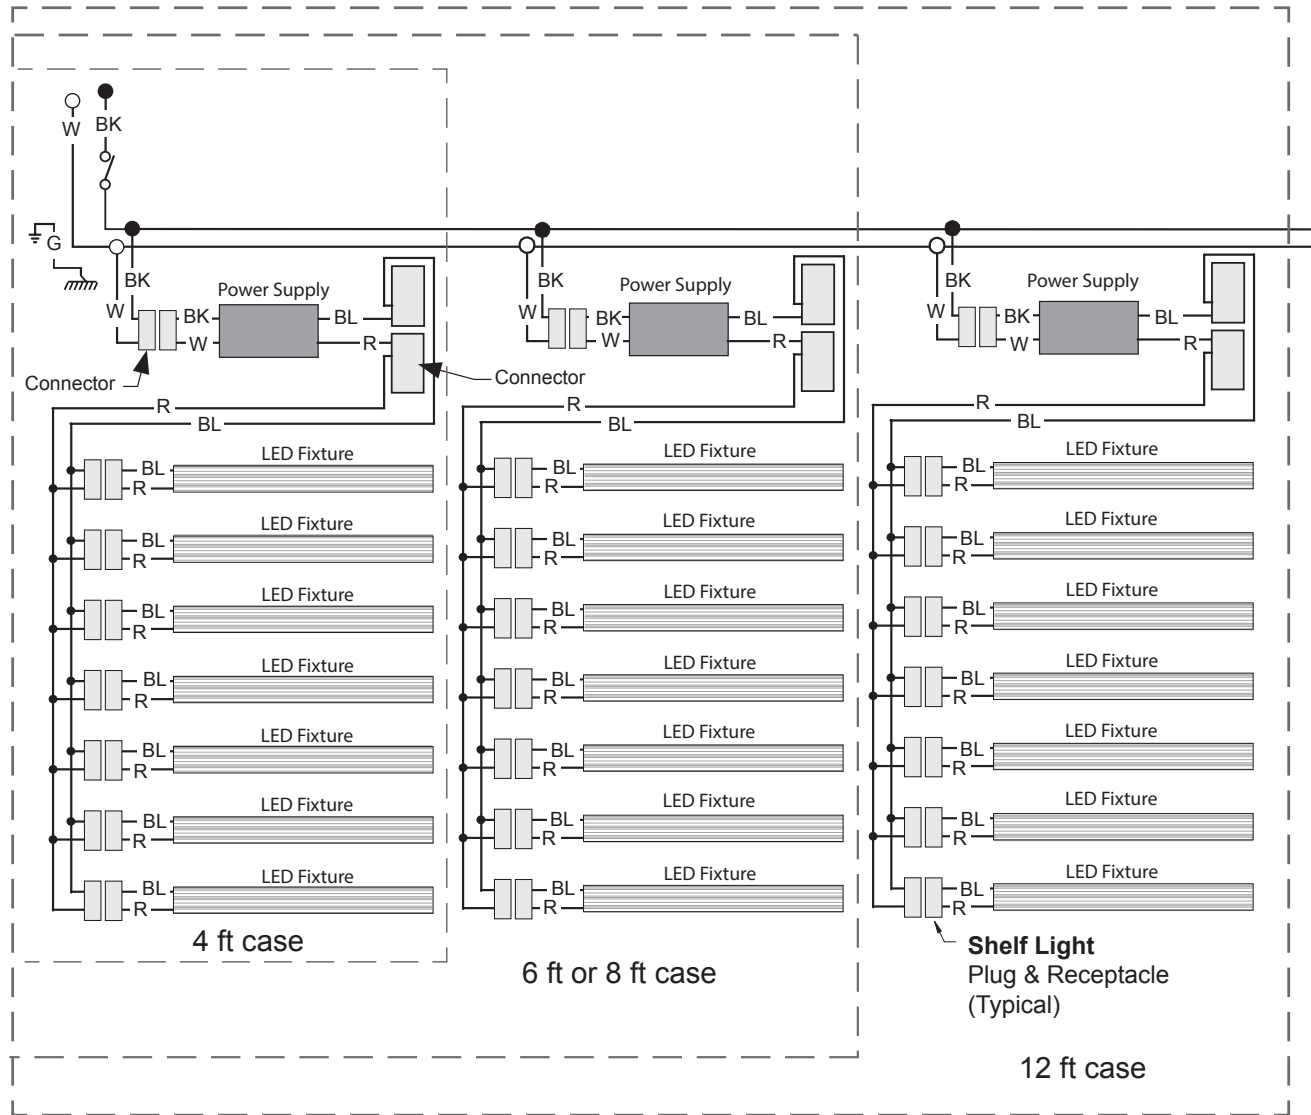**WARNING**

All components must have mechanical ground, and the merchandiser must be grounded.

R = Red Y = Yellow G = Green BL = Blue BK = Black W = White
 ● = 120V POWER ○ = 120V NEUTRAL ⊥ = FIELD GROUND mm = CASE GROUND

Wiring diagram for a 14GA gas detect insight Danfoss unit. The diagram shows a power supply section with four units (1, 2, 3, and Canopy) connected to a raceway. The raceway feeds three fan motors and three sets of shelf and canopy LEDs. Wire color codes and abbreviations are provided at the bottom.

WIRE COLOR
UL COLOR CODES / ABBREVIATIONS

— RED = RD	— WHITE = WT
— BLACK = BK	— GREEN = GN
— BLUE = BL	— BROWN = BN
— YELLOW = YL	— ORANGE = OR
— GRAY = GY	— VIOLET = VT


FACTORY 14GA WIRE
FACTORY 10GA WIRE
 — FIELD WIRE —

DO NOT SCALE DRAWING FIN
 SHEET 1 OF 4

HUSSmann®
DIAGRAM-A2L GAS
DETECT INSIGHT
DANFOSS


3220871
 REV C

QSP 3.2 WIRE DIAGRAM SIZE D-14

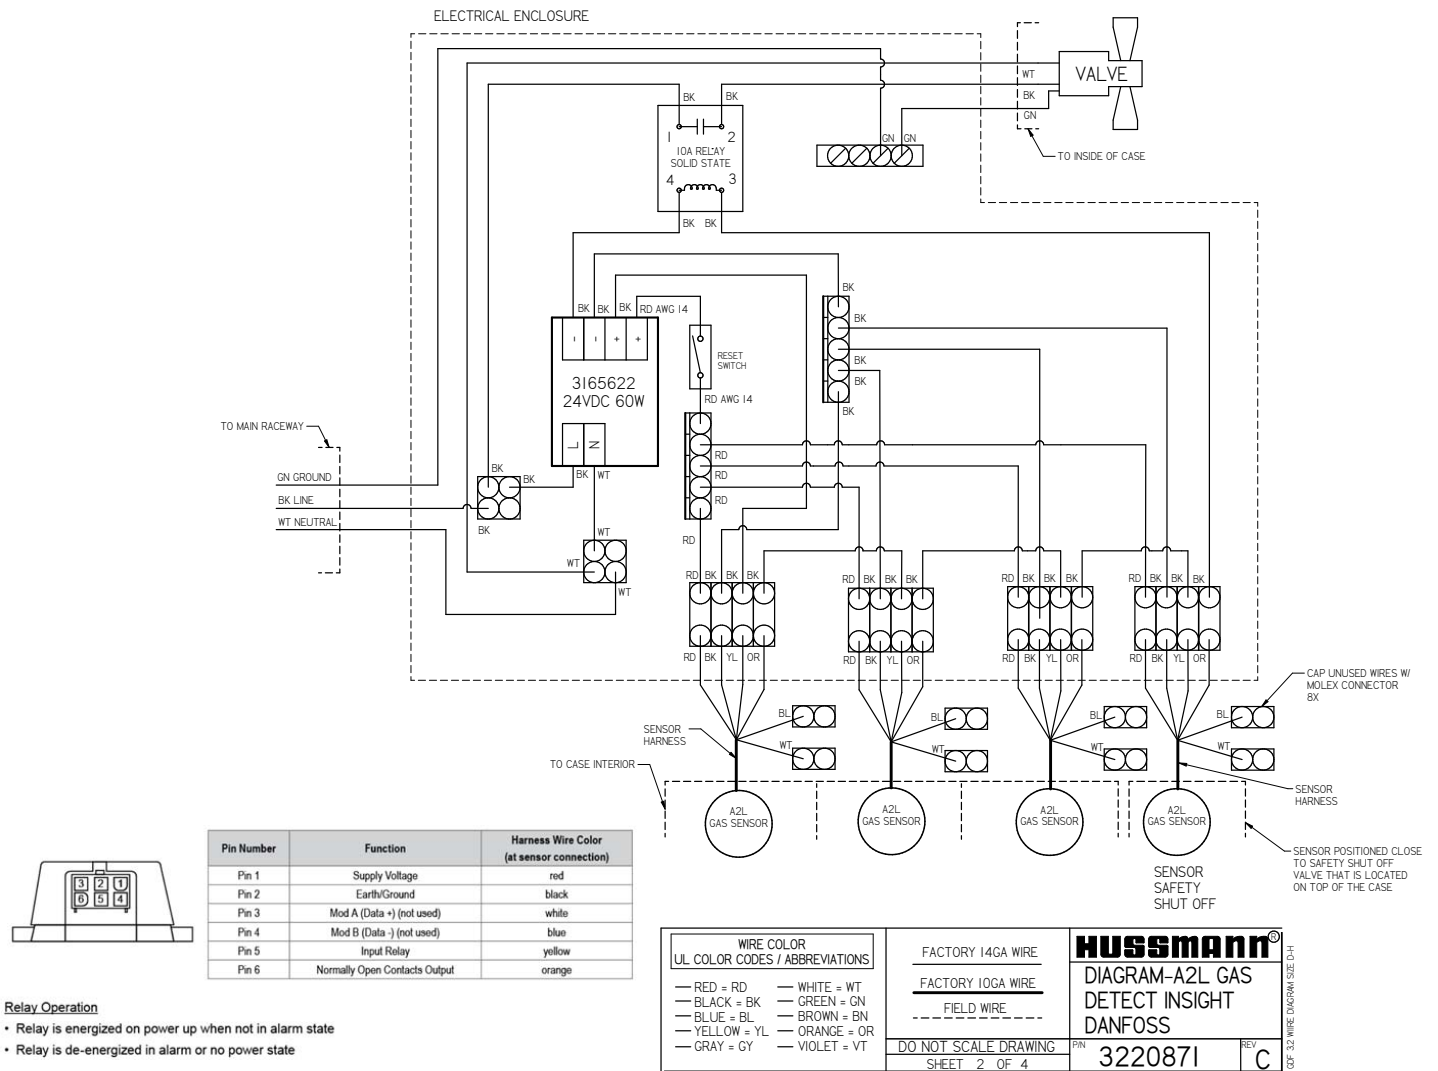Wiring Diagram (ID6NU12, A2L detection and mitigation system)**Relay Operation**


- Relay is energized on power up when not in alarm state
- Relay is de-energized in alarm or no power state

Wiring Diagram (ID6NU6 / ID6NU8, A2L detection and mitigation system)

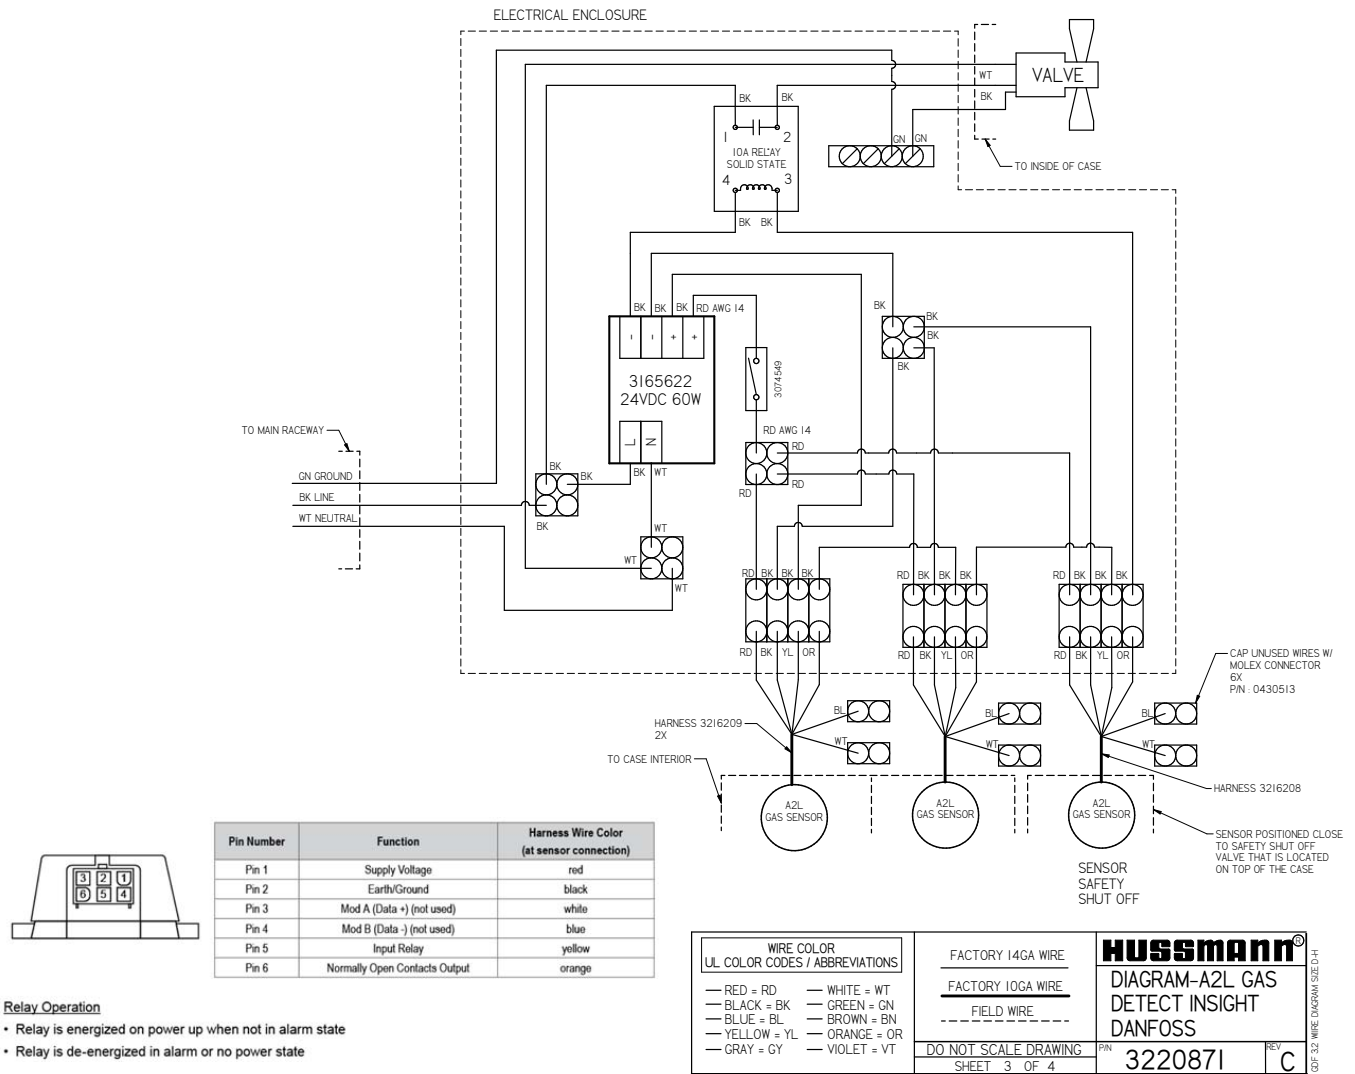

Relay Operation

- Relay is energized on power up when not in alarm state
- Relay is de-energized in alarm or no power state

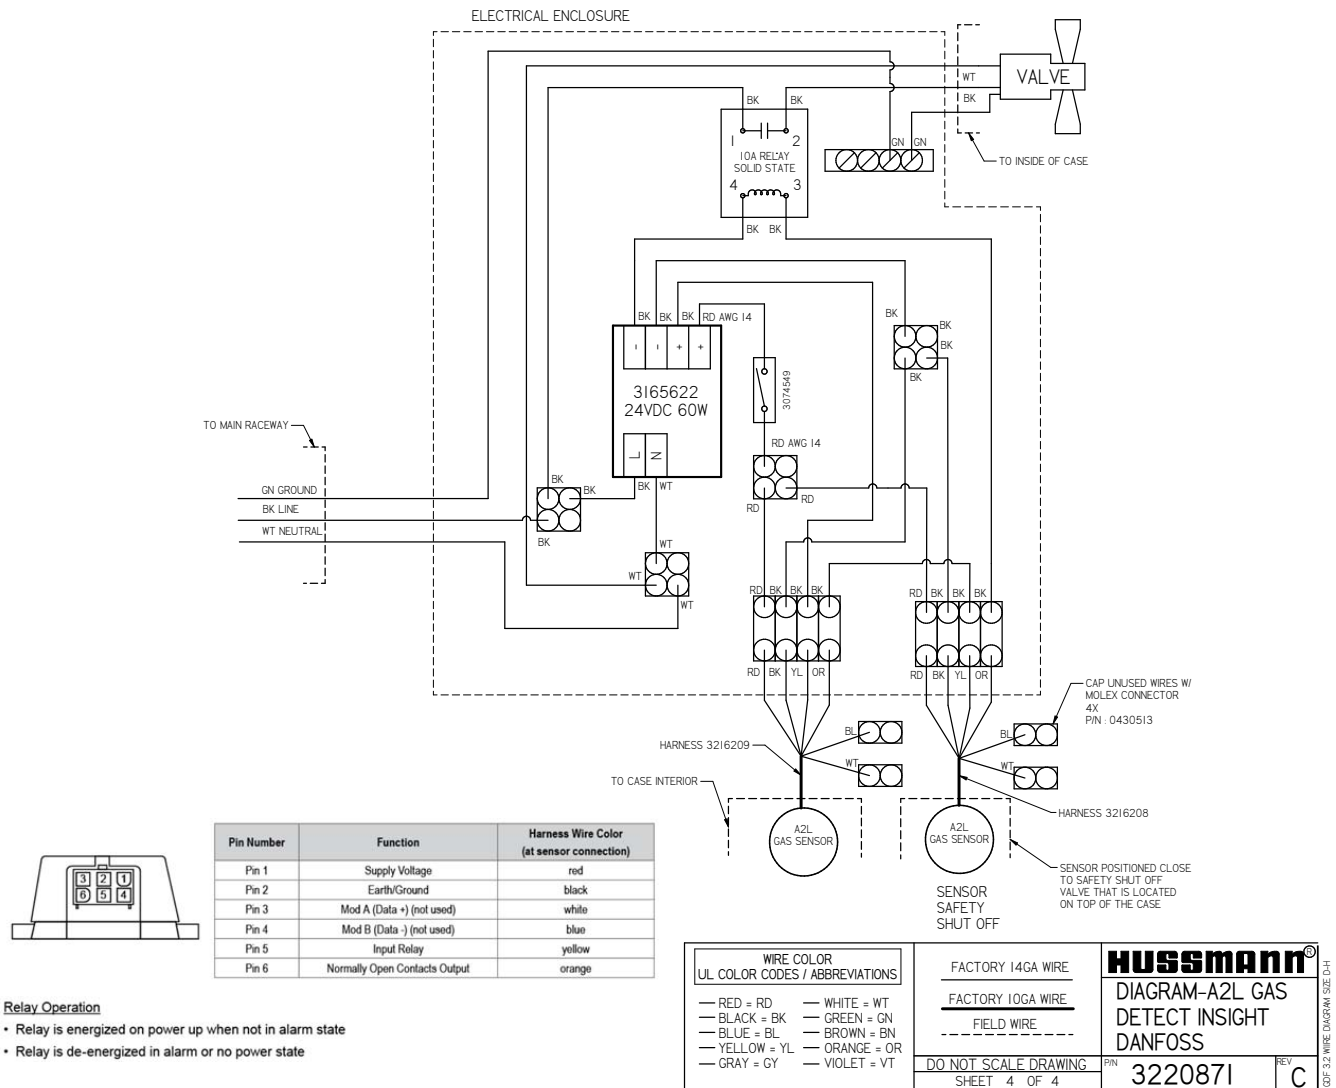Wiring Diagram (ID6NU4, A2L detection and mitigation system)**Relay Operation**

- Relay is energized on power up when not in alarm state
- Relay is de-energized in alarm or no power state

HUSSMANN®

Estimating Refrigeration and Electrical Load (for comparison purposes only)

Case Btu

To determine Btu for a case, refer to the performance data chart on page 2. Select lit or unlit shelves, then select the type of remote refrigeration system (parallel or conventional), which will give Btu/hr/ft. Multiply this number by the length of the case to determine Btu per hour.

Case Electrical

Refer to store legend to determine number of circuits. Lighting should be specified in store legend.

Fan electrical load for a case is computed by selecting the case length and fan voltage on page 6. For example, a 12 ft case uses 3 fans. The store legend specifies fans on a 230V circuit. In this instance, fans use 0.39 Amps and the MCA is 0.59. When applied, ambient fans, anti-sweat heaters, controllers, etc. must be included in the MCA. Include lights in the MCA if lights are on same circuit.

Lights may be on a separate circuit. To estimate lighting load: select case length (12 ft), canopy lighting [standard or optional] (here 0.70 for standard), and shelf or rail lighting [maximum for which case is wired] (1.48 for six shelves); then add together $[0.48 + 1.48 = 1.96 \text{ amps for 120V}]$ (for 230V, multiply $1.96 * 0.52 = 1.02$).

Line Sizing — Refer to store legend.

Hussmann Line Sizing Charts are engineered for use with Hussmann refrigeration equipment.

DS_ID6NU_3064394_H_EN

Revision History

Revision E: July 2022. Added notes for Extended Drain Kit Option.

Revision F: January 2023. Added CO2 note, Page 2.

Revision G: November 2023: Updated fan and lighting information.

Revision H: (APRIL 2026) Updated format and added A2L, CO₂, and glycol information.



Scan the QR code on your mobile device to access additional product information or order parts.

Parts may also be ordered at:

parts.hussmann.com

Call toll free: 1.855.487.7778

We reserve the right to change or revise specifications and product design in connection with any feature of our products. Such changes do not entitle the buyer to corresponding changes, improvements, additions or replacements for equipment previously sold or shipped.