




Protocol[®] A2L

COMPACT DISTRIBUTED RACK SYSTEM



ADVANTAGES

- A2Ls are synthetic, mildly flammable refrigerants that meet low GWP regulatory requirements and offer the greatest ease of use for technicians compared to other solutions
- Compact footprint provides broad range of options for new store and remodel applications
- Two families of outdoor distributed system solutions available including options for air and water-cooled applications
- Available options include integrated or remote condensers (tube and fin or microchannel)

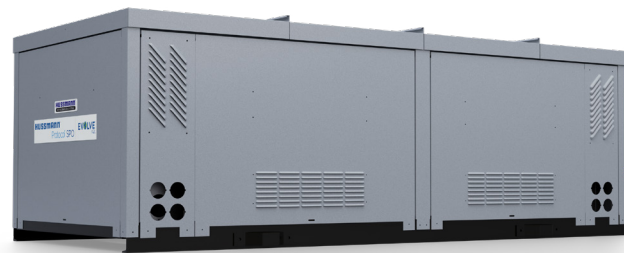

Protocol SPO



KEY FEATURES

- Capacities of up to 389.4 MBH (114.1 kW) for medium temp and up to 237.9 MBH (69.7 kW) for low temp¹
- Most common voltage, defrost, and cooling options available
- Available with popular Copeland, Danfoss, and Micro Thermo controllers
- Every Protocol leverages advanced Copeland scroll compressor technology



¹ 95° F (35° C) ambient and SST of 20° F (-6.7° C) for medium temp and -20° F (-28.9° C) for low temp.



Protocol A2L Compact Distributed Rack System

SPECIFICATIONS

Model		Protocol A2L	
Applications		Low or Medium Temperature	
Available Refrigerants		R-454A R-454C	
Compressors		2-6 Copeland Scroll (quantity varies by unit size)	
Maximum Capacities ¹	OLP	LT	237.9 MBH (69.7 kW)
		MT	389.4 MBH (114.1 kW)
	SPO	LT	116.1 MBH (34 kW)
		MT	194.7 MBH (57.1 kW)
Supply Power		208 VAC / 3-phase / 60 Hz 460 VAC / 3-phase / 60 Hz 575 VAC / 3-phase / 60 Hz	


TECHNICAL INFORMATION



Scan or click QR to access additional A2L refrigerant information at hussmann.com

CONFIGURATIONS

Consult technical datasheet for detailed dimensional information.

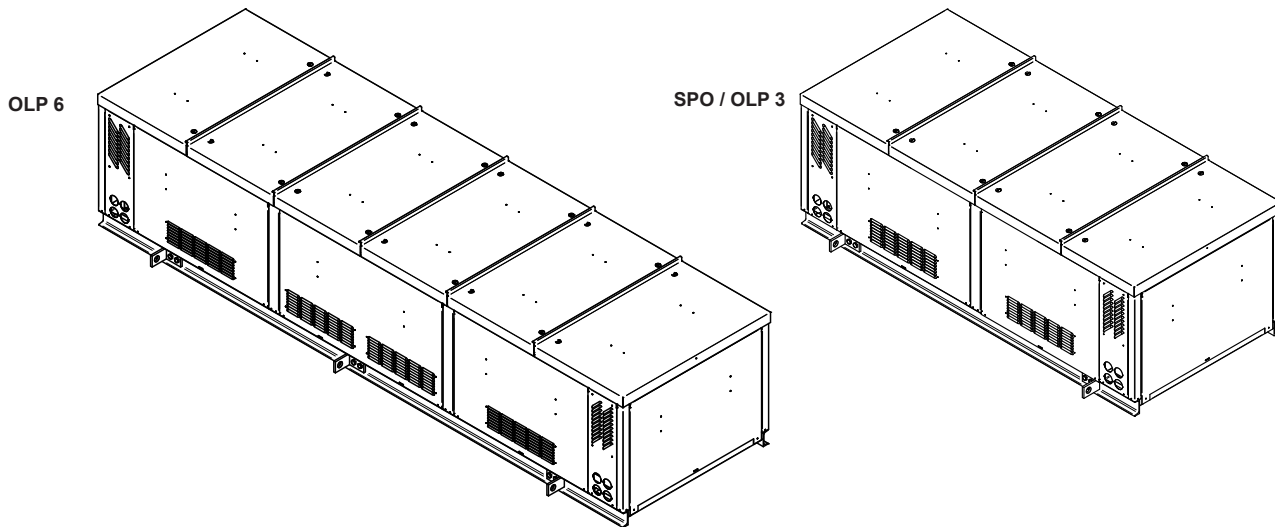

¹ 95° F (35° C) ambient and SST of 20° F (-6.7° C) for medium temp and -20° F (-28.9° C) for low temp.

NOTE: Use Hussmann's technical data sheets or request assistance from application engineering to get dimensions for all store layout purposes.

We reserve the right to change or revise specifications and product design in connection with any feature of our products. Such changes do not entitle the buyer to corresponding changes, improvements, additions, or replacements for equipment previously sold or shipped. For additional resources, contact your representative or visit www.hussmann.com.

©2026 Hussmann Corporation

HUSSMANN[®]

Hussmann Corporation
12999 St. Charles Rock Rd.
Bridgeton, MO 63044-2483
Ph: 1.800.592.2060

www.hussmann.com

PS_Protocol_A2L_M001171_B_EN