
HUSSMANN® Excel



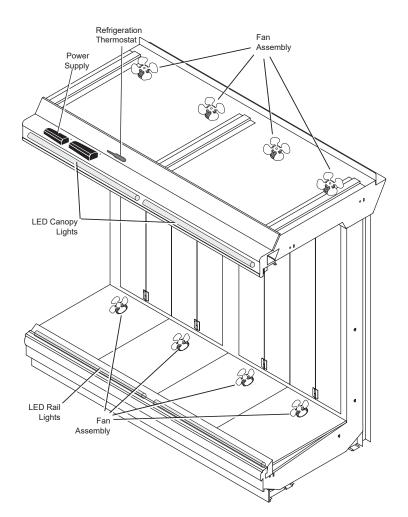

D6X-URLE

P/N 0498329_Q
NSF® Certified
July 2019

DOE 2017
Energy Efficiency
Compliant

IMPORTANT

ONE FLOOR DRAIN IS REQUIRED FOR EACH CASE.

NSF Certification

This merchandiser model is manufactured to meet NSF/ANSI (National Sanitation Foundation) Standard #7 requirements for construction, materials and cleanability.



Scan the QR code on your mobile device to access additional product information or order parts.

Parts may also be ordered at:

parts.hussmann.com
Call toll free: 1.855.487.7778

We reserve the right to change or revise specifications and product design in connection with any feature of our products. Such changes do not entitle the buyer to corresponding changes, improvements, additions or replacements for equipment previously sold or shipped.

Note: Revision Q: July 2019. Updated Lighting and CaseShieldPTM.


Data sheet-Excel D6X-URLE

Engineering Plan Views

PHYSICAL DATA
Merchandiser Drip Pipe (in.) 1 1/4
Merchandiser Liquid Line (in.) 3/8
Merchandiser Suction Line (in.) 7/8

Rear Load Ultra Low Front Dairy

Dimensions shown as in. & (mm).

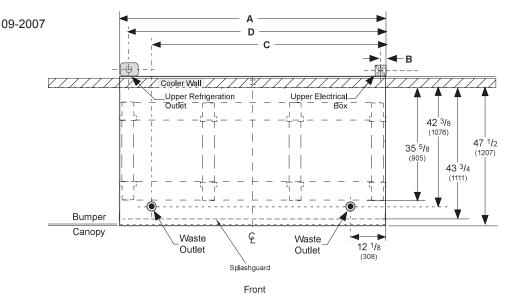


Note: ALL FIELD WIRING CONNECTION POINTS ARE ABOVE THE CASE. Case to case connections are made in the electrical box at the top of the case.

	6 ft	8 ft	12 ft
General			
(A) Case Length (without ends or partitions)	72 3/8 (1838)	96 ³ / ₈ (2448)	144 1/2 (3670)
(Each end and insulated partition adds $1^{-1/2}$ in. (38 mm) to case line up.)			
Maximum O/S dimension of case back to front	51 5/8 (1311)	51 5/8 (1311)	51 5/8 (1311)
(front of canopy through cooler wall not including electrical box)			
Cooler wall to front of splashguard	43 3/4 (1111)	43 ³ / ₄ (1111)	43 3/4 (1111)
Cooler wall to O/S edge of front rails	40 3/4 (1035)	40 3/4 (1035)	40 3/4 (1035)
Distance between edges of external rails and center rails	41 1/2 (1054)	41 1/2 (1054)	41 1/2 (1054)
Distance between edges of center rails	NA	NA	43 7/8 (1114)
Distance between front rails and splashguard	7 3/4 (197)	7 3/4 (197)	7 3/4 (197)
Electrical Service (Electrical Field Wiring connection point locate (B) RH End of case to center of 4 x 4 x 2 Electrical Box Back of case (cooler wall) to center of 4 x 4 x 2 Electrical Box	ed on top of case, 2 (51) 2 ½/4 (57)	2 (51) 2 ¹ / ₄ (57)	2 (51) 2 ¹ / ₄ (57)
Waste Outlets (One each end)			
(C) RH End of case to the center of LH waste outlet	60 1/4 (1530)	84 1/4 (2140)	132 3/8 (3363)
RH End of case to the center of RH waste outlet	12 1/8 (308)	12 1/8 (308)	12 1/8 (308)
Cooler wall to center of waste outlets	42 (1067)	42 (1067)	42 (1067)
Schedule 40 PVC drip pipe	1 1/4 (32)	1 1/4 (32)	1 1/4 (32)
Refrigeration Outlet			
Cooler wall to center of refrigeration outlet	4 1/4 (108)	4 1/4 (108)	4 1/4 (108)
(D) RH end of case to center of refrigeration outlet	69 1/4 (1759)	93 1/4 (2369)	141 3/8 (3591)

DOE 2017 Energy Efficiency Compliant Hussmann refrigerated merchandisers configured for sale for use in the United States meet or surpass the requirements of the DOE 2017 energy efficiency standards.

Dimensions shown as in. & (mm).

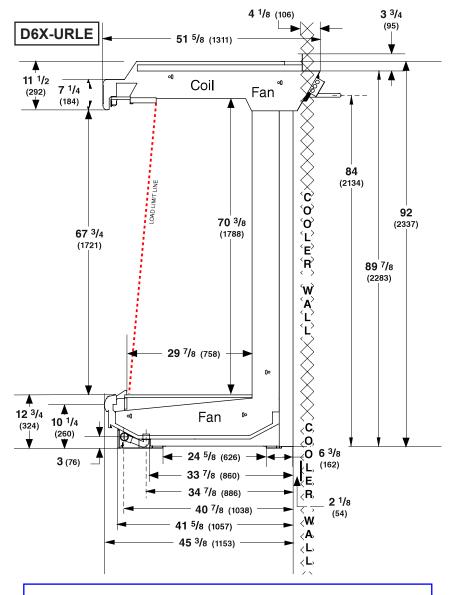

ALL FIELD WIRING CONNECTION POINTS ARE ABOVE THE CASE.

Estimat	ted Charge **	D6	X-URLE
6 ft	2.0 lb	32 oz	0.9 kg
8 ft	2.7 lb	43 oz	1.2 kg
12 ft	3.9 lb	62 oz	1.8 kg

^{**}This is an average for all refrigerant types. Actual refrigerant charge may vary by approximately half a pound (8 oz/0.2 kg).

Excel D6X-URLE Dairy

REFRIGERATION DATA

Note: This data is based on store temperature and humidity that does not exceed 75°F and 55% R.H.

	D6X-URLE§
Discharge Air (°F)	27
Evaporator (°F)	21
Unit Sizing (°F)	19

§ Average evaporator temperature shown. Use dew point for high glide refrigerants for unit sizing. Care should be taken to use the dew point in PT tables for measuring and adjusting superheat. Adjust evaporator pressure as needed to maintain discharge air temperature shown.

Important Note: Btu numbers are for the D6X-URLE when installed to a cooler operating at a 36°F air temperature. The unit cooler coil must be sized for an additional load of 1160 Btu/hr/ft of D6X-URLE case installed to the cooler.

Btu/hr/ft	D6X-URLE
Parallel	1130
Conventional	1305
Reduce refrigeration load l CaseShieldPTM.	by 15% if fitted with

DEFROST DATA

D6X-UKL	H
---------	---

Frequency (hr)	6
Defrost Water (lb/ft/day)	6
(± 15% based on case configurat	tion and
product loading).	

O FF T IME	D6X-URLE
Time Terminated (minutes) 45
ELECTRIC OR GAS	Not Recommended

Standard Defrost Thermostat — NA

CONVENTIONAL CONTROLS

Low Pressure Backup Control

D6X-URLE

CI/CO (Temp °F)* 14/4
Indoor Unit Only, Pressure Defrost
Termination (Temp °F)* NA
*Use a Temperature Pressure Chart to
determine PSIG conversions.

Excel D6X-URLE Dairy

Electrical Data

Number of Dischar Return - Return -	ge — 13W — 12W	,	6 ft 4 - 4	8 ft 4 4 —	12 ft 6 6			
				Amperes	S		Watts	
			6 ft	8 ft	12 ft	6 ft	8 ft	12 ft
Discharge	Fan							
120V	50/60Hz	Standard Energy Efficient	1.20	1.20	1.80	80	80	120
230V	50/60Hz	Standard Energy Efficient	0.60	0.60	0.90	80	80	120
230V	60Hz	Export	1.56	1.56	2.34	244	244	366
230V	50Hz	Export	1.92	1.92	2.88	280	280	420
Return Fa	n							
120V	50/60Hz	Standard Energy Efficient	0.76	1.20	1.80	56	72	108
230V	50/60Hz	Standard Energy Efficient	0.40	0.60	0.90	56	72	108
230V	60Hz	Export	1.00	1.32	1.98	156	200	300
230V	50Hz	Export	1.12	1.52	2.28	168	228	342
Minimum	Circuit A	mpacity						
120V	50/60Hz	Standard Energy Efficient	2.16	2.60	3.80			
230V	50/60Hz	Standard Energy Efficient	1.20	1.40	2.00			
230V	60Hz	Export	2.76	3.08	4.52			
230V	50Hz	Export	3.04	3.64	5.36			
		errent Protection 120V ent Protection 230V	20 15	20 15	20 15			

Only lighting configurations that are compliant with the U.S. Dept. of Energy (DOE) 2017 regulation are available for sale for use in the U.S.A.

LED LIGHTING	6ft	Amperes 8 ft	12 ft	6 ft	Watts 8 ft	12 ft
EcoShine ULTRA Canopy Lights 1 Row EcoShine ULTRA	0.26	0.36	0.54	31	43	64
EcoShine II Canopy Lights						
1 Row EcoShine II 1 Row EcoShine II HO	0.26 0.33	0.32 0.44	0.48 0.66	32 40	39 53	58 79
I Now Leadinine II 110	0.55	0.11	0.00	10	55	17
Lighted shelves are not available for rear-load models.						
EcoShine II Rail Light — 1 Row	0.12	0.16	0.25	14	20	30
Standard Lighting (T-8 Fluorescent) 1 Row Canopy						
Each Row of Canopy or Rail	0.51	0.51	0.77	59	59	85
Lights						

120V Lighting Circuit Total = Standard Lighting + Total Optional Lighting

120V LED Lighting Circuit Total = Canopy Lighting + Optional Rail Lighting

230V Lighting Circuit Total = Multiply 120V Lighting Circuit Total by 0.52

Please note: some combinations of fluorescent lights on this case model may not be compliant with DOE 2017 and may not be available to order in the US and Canada. More lighting options are available with LED lights. The Hussmann Product Configurator will not allow lighting options that do not comply with the DOE 2017 standards.


Product Data

Recommended Usable Cube ¹ (Cu Ft/Ft) Total Display Area ² (Sq Ft/Ft) Shelf Area ³ (Sq Ft/Ft) 10.47 ft³ /ft (0.97 m³ /m) 5.65 ft² /ft (1.72 m² /m) 9.86 ft² /ft (3.01 m² /m)

- ¹ Refrigerated Volume less shelving and other unusable space: Refrigerated Volume/Unit of Length, ft³/ft [m³/m]
- ² Total Display Area, ft² [m²]/Unit of Length, ft [m]
- ³ Shelf surface area is composed of bottom deck plus standard shelf complement, as shown in the Hussmann *Product Reference Guide*. The standard shelf complement for this model is (5) rows of 22-inch shelves.


ESTIMATED SHIPPING WEIGHT 4					
Case				Solid End	
	6 ft	8 ft	12 ft	(each)	
lb (kg)	900 (408)	1170 (531)	1750 (794)	90 (41)	
⁴ Actual weights will vary according to optional kits included.					


Fan Wiring Offtime Defrost

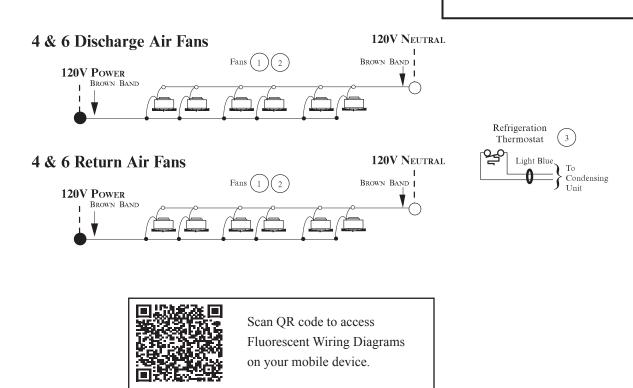


LED Canopy and Rail Light Circuits


LED Canopy Lighting — 1 Row

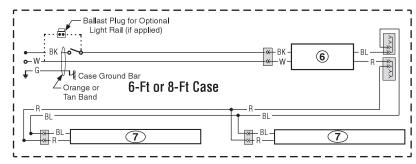

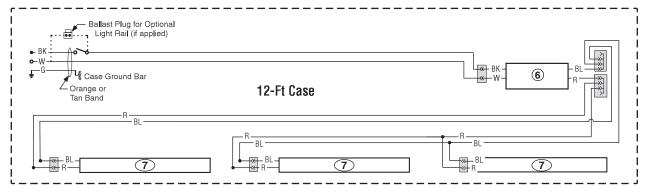

LED Rail Lighting — 1 Row

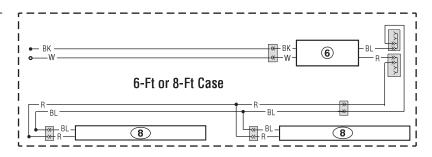

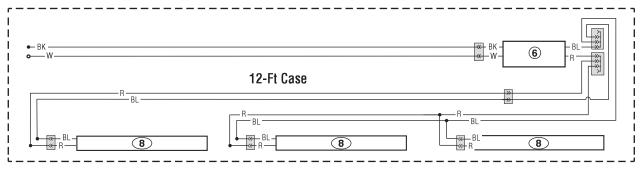


WARNING


All components must have mechanical ground, and the merchandiser must be grounded.

CIRCLED NUMBERS = PARTS LIST ITEM NUMBERS


• = 120V Power \bigcirc = 120V Neutral $\frac{1}{7}$ = Field Ground \overrightarrow{mm} = Case Ground

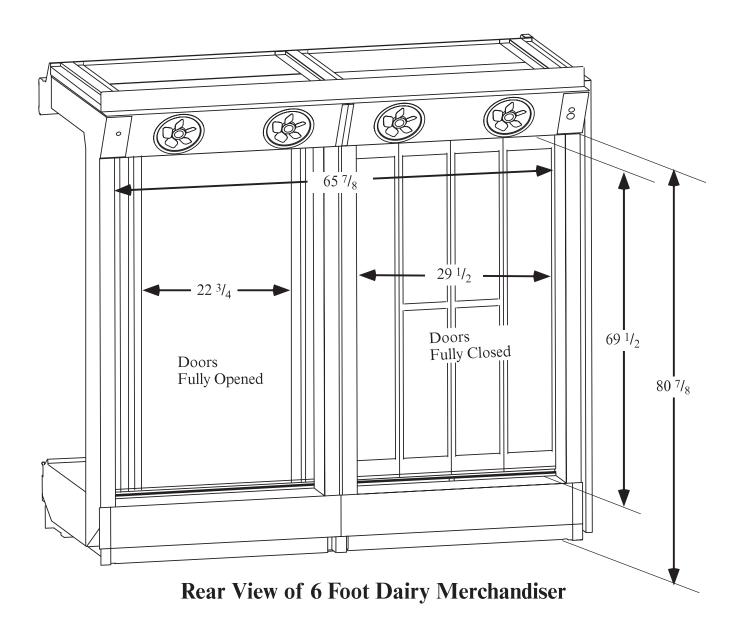

NOTE: Consult Ultra-Low Front Installation manual for instructions on connecting the merchandiser to the cooler.

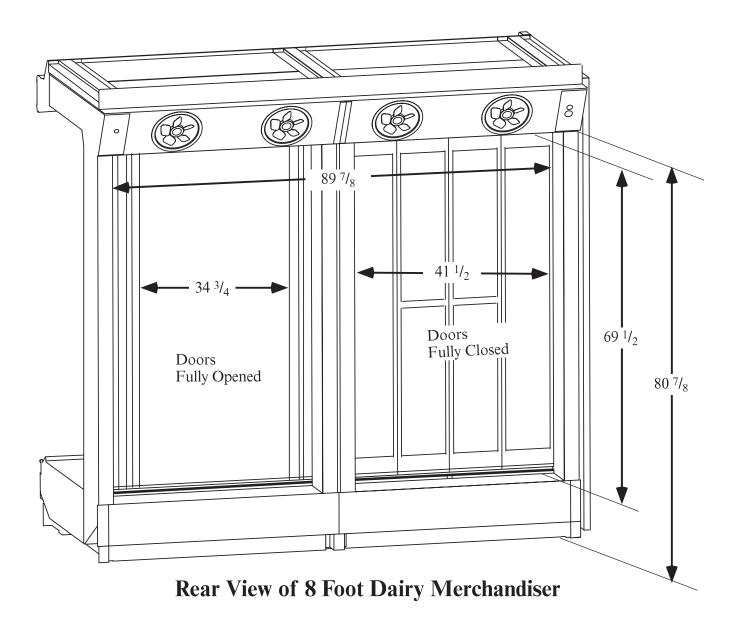

NOTE: Consult Ultra-Low Front Installation manual for instructions on connecting the merchandiser to the cooler.

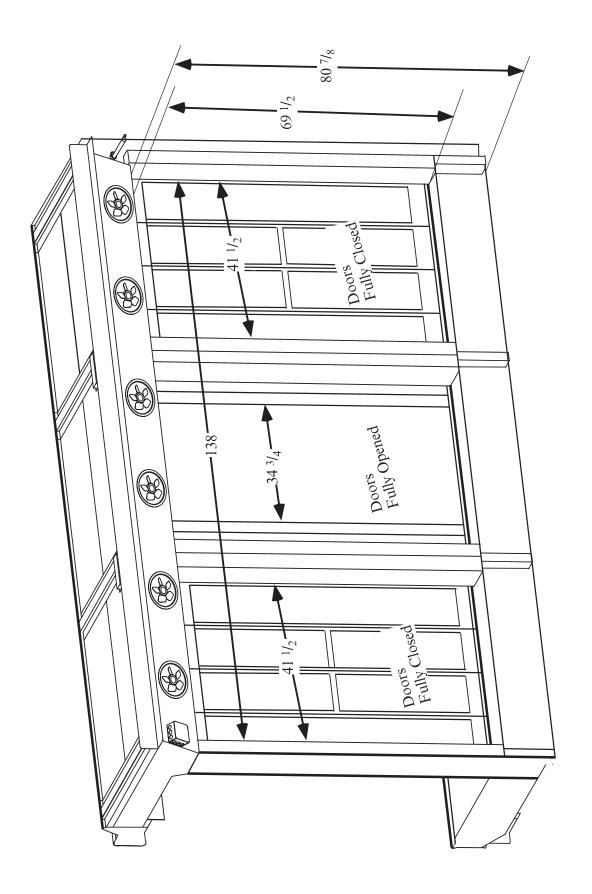

NOTE: Consult Ultra-Low Front Installation manual for instructions on connecting the merchandiser to the cooler.

Rear View of 12 Foot Dairy Merchandiser