
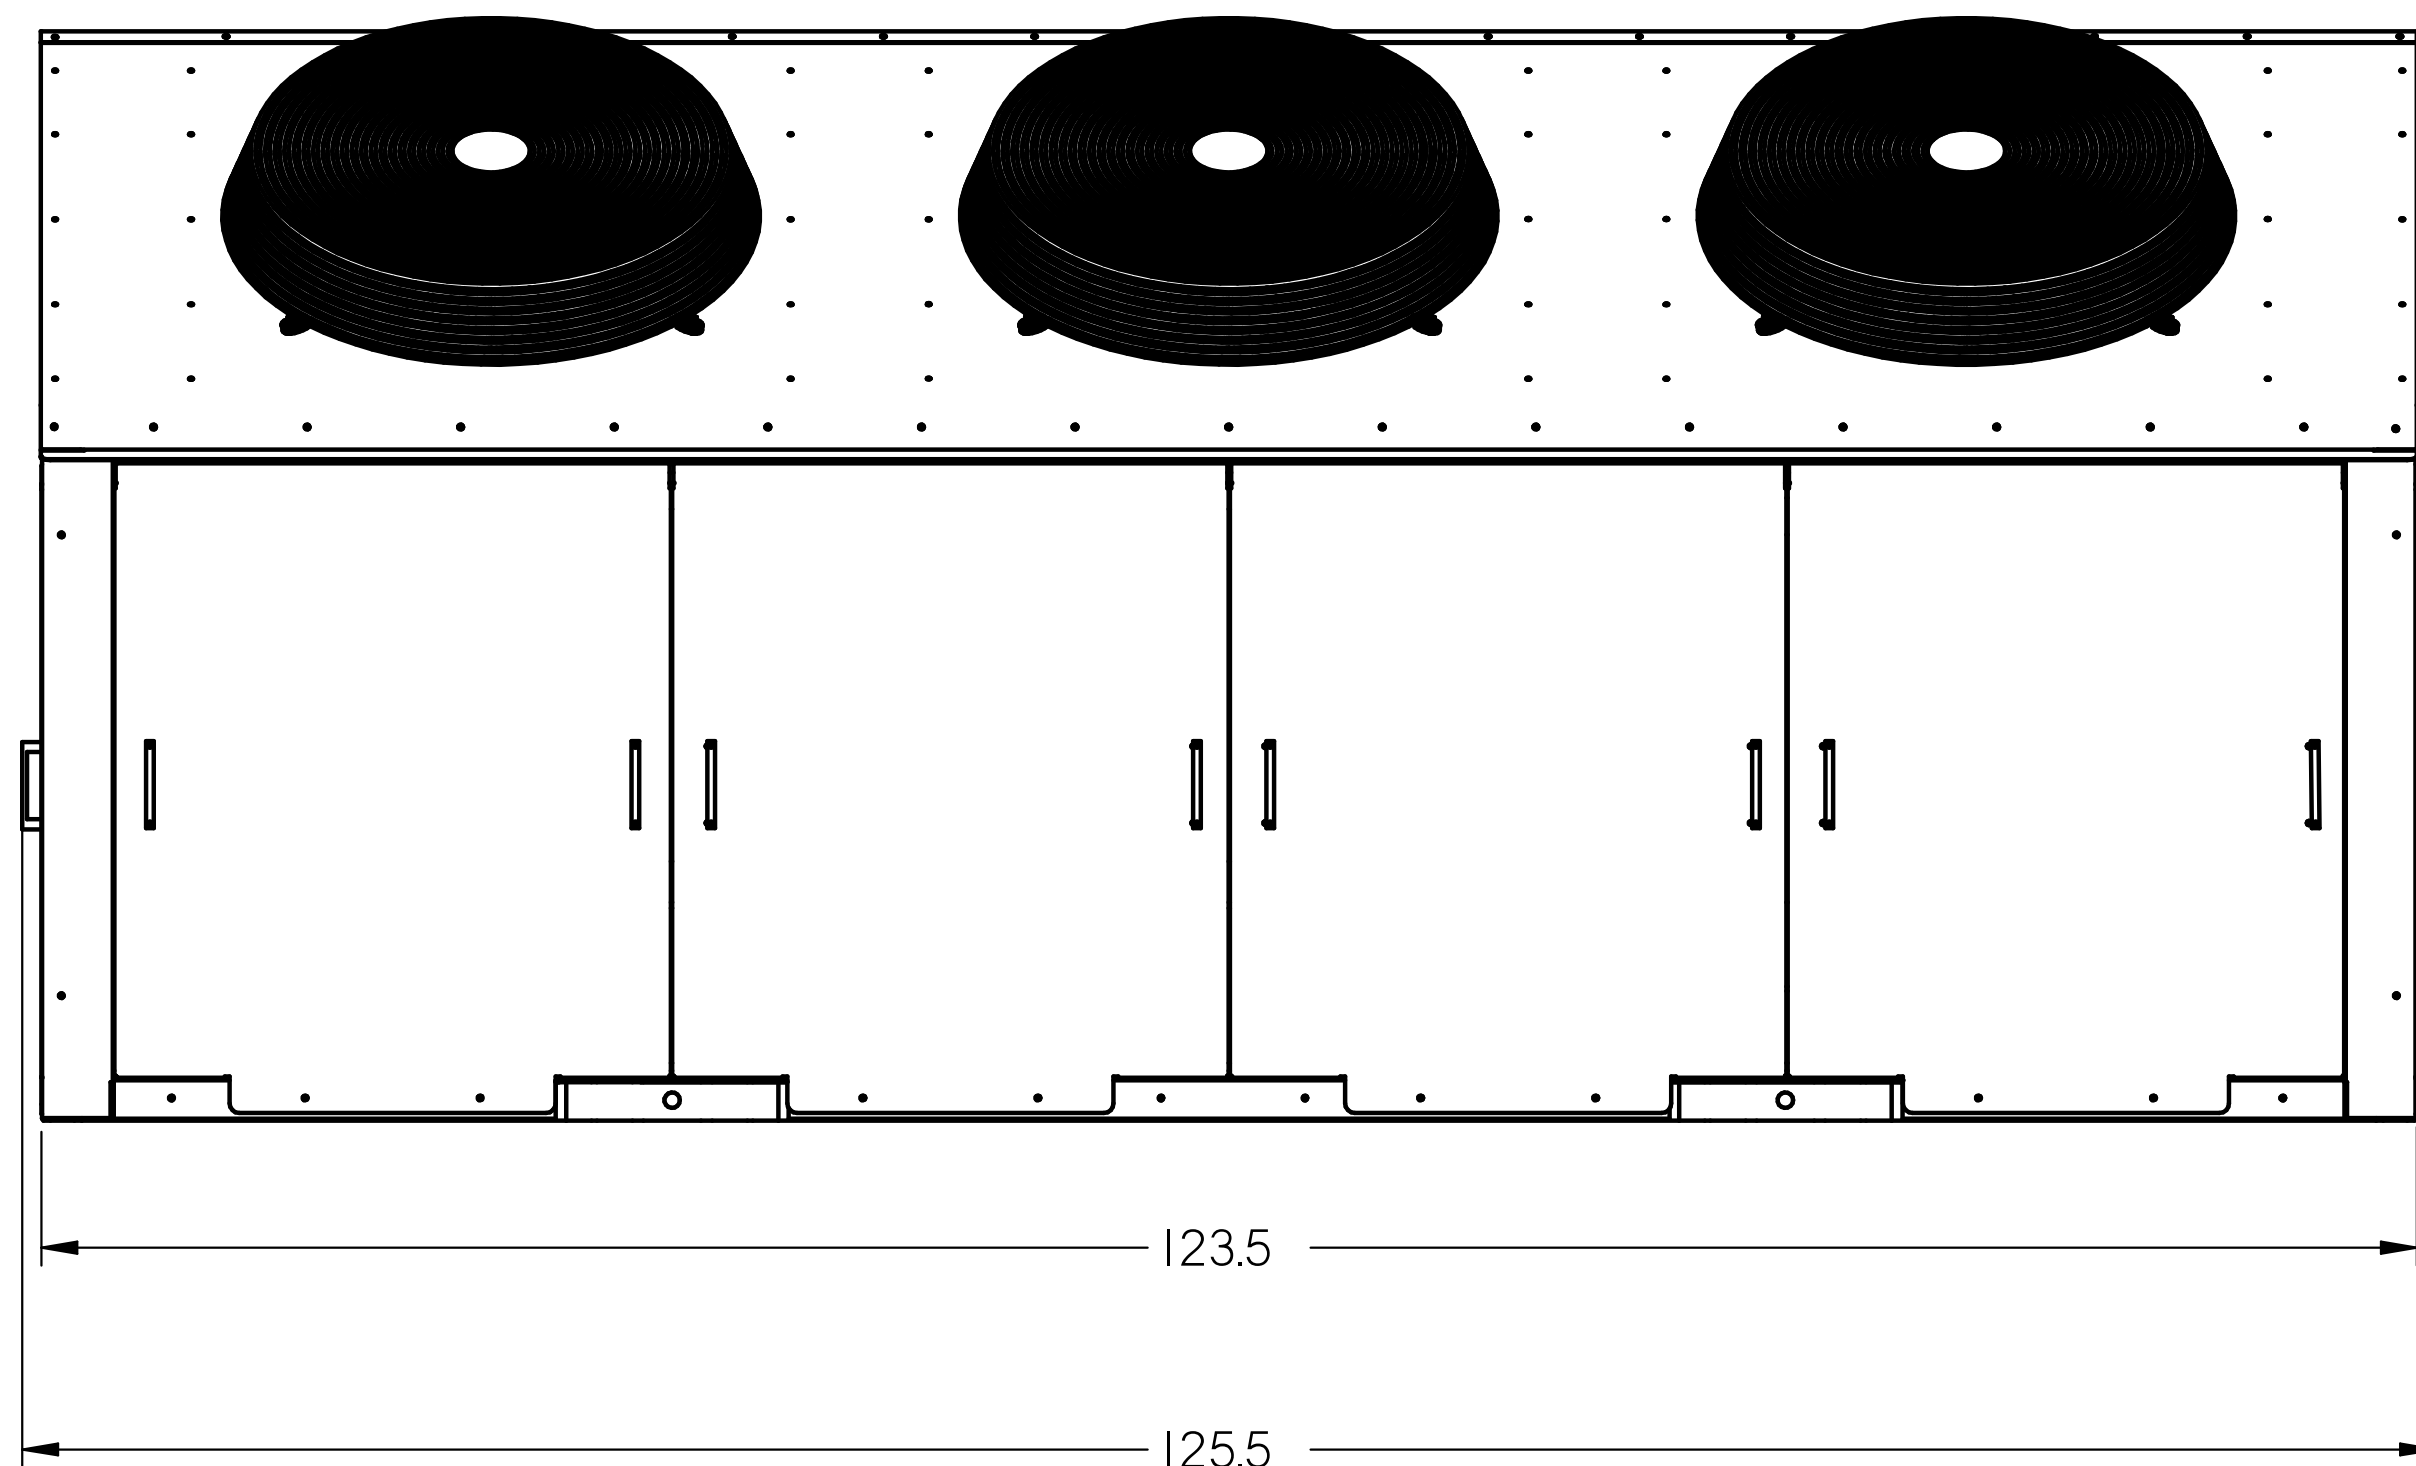




SEE SHEET 3 FOR MINIMUM CLEARANCE REQUIREMENTS

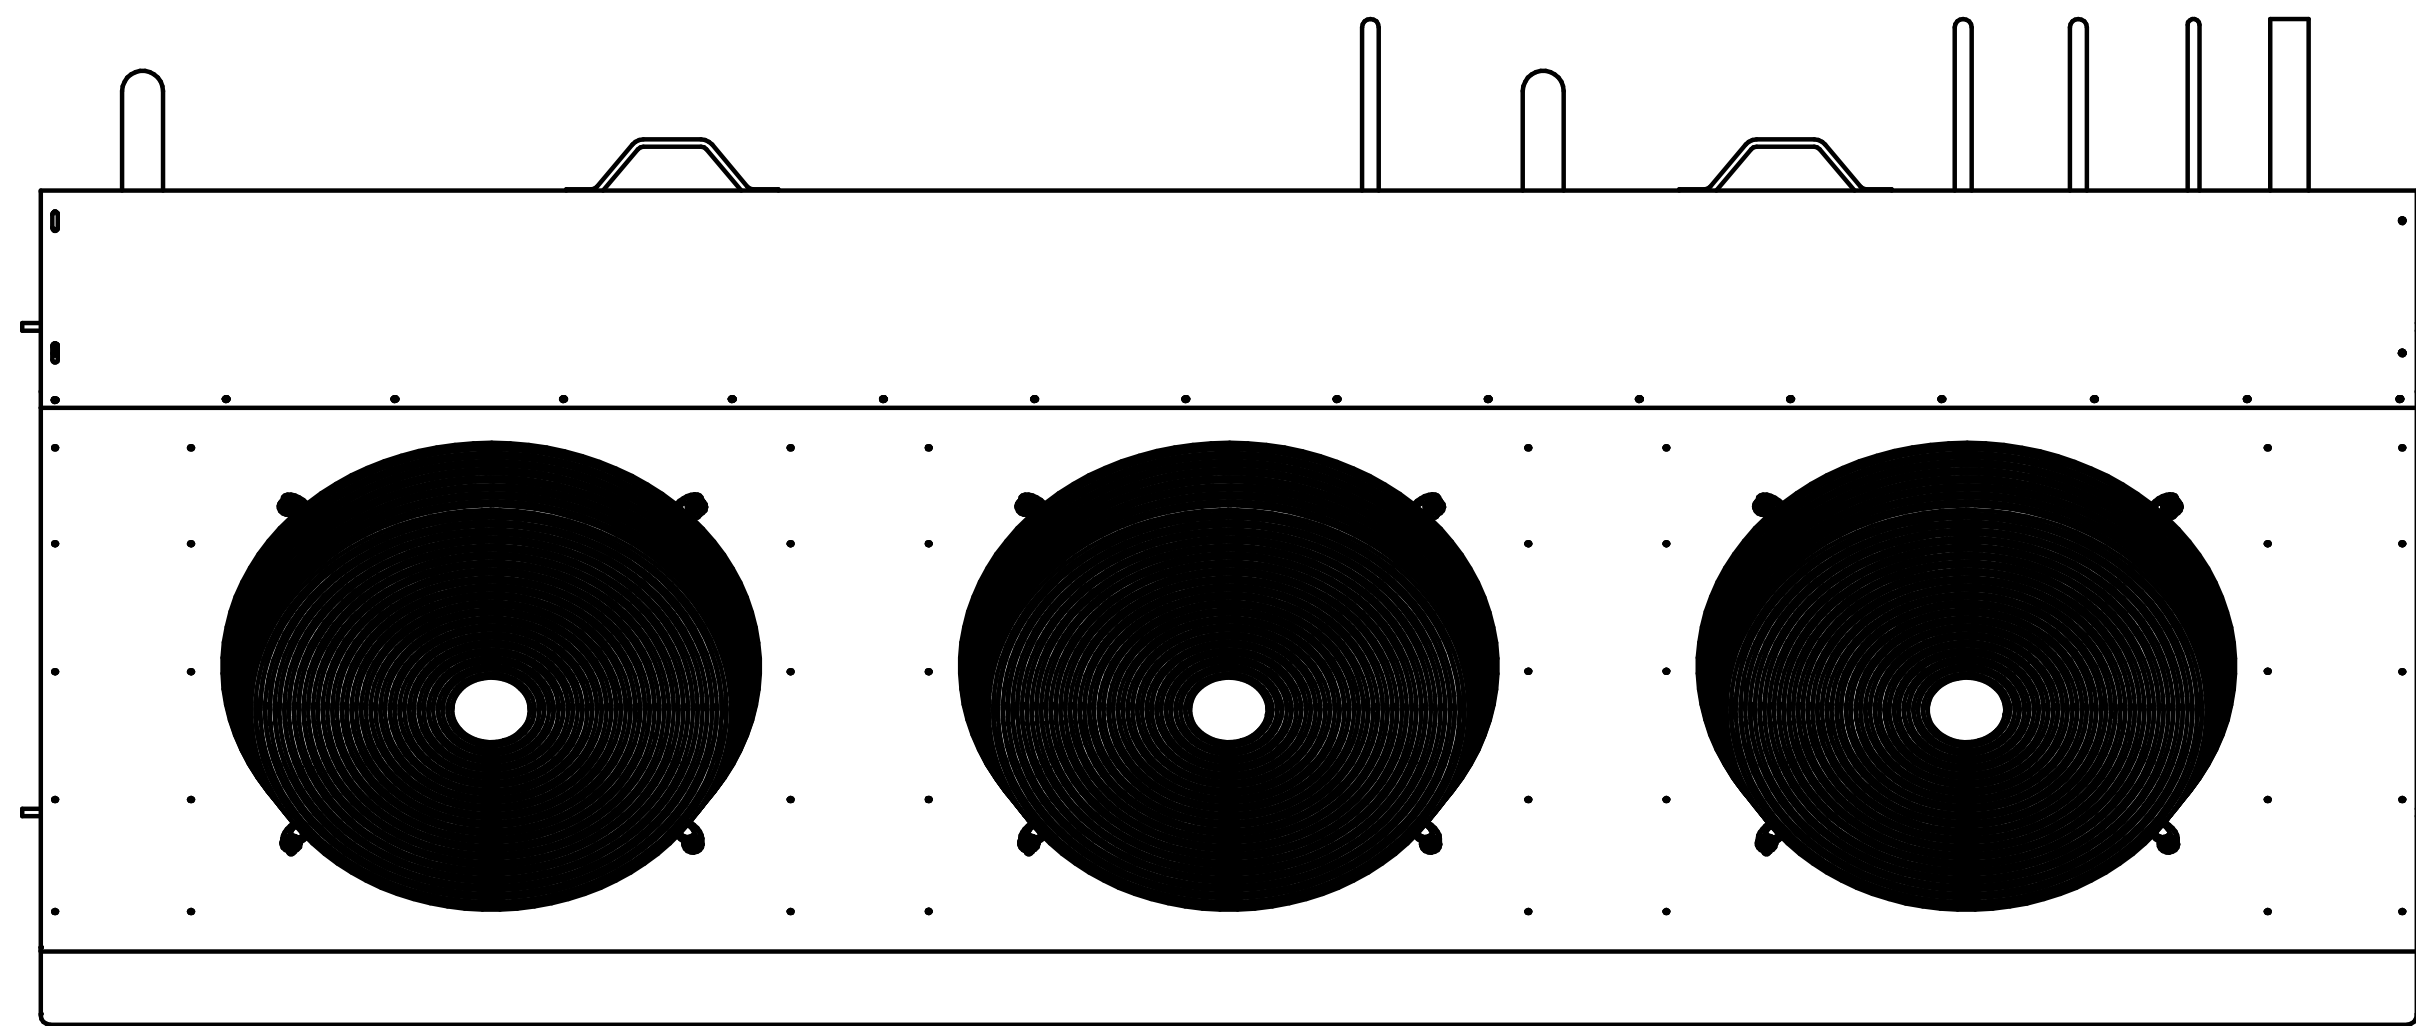


RECEIVER SIZES SHOWN ARE BASED UPON 80% CAPACITY

MAXIMUM TOTAL UNIT WEIGHT (POUNDS)	SHIPPING	OPERATING
72 POUND RECEIVER	2597	2708
OPTIONAL 200 POUND RECEIVER	2704	2933

- NOTES:
- 1. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
 - 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
 - 3. OVERALL DIMENSIONS: 125.5 L X 53.0 W X 57.5 H

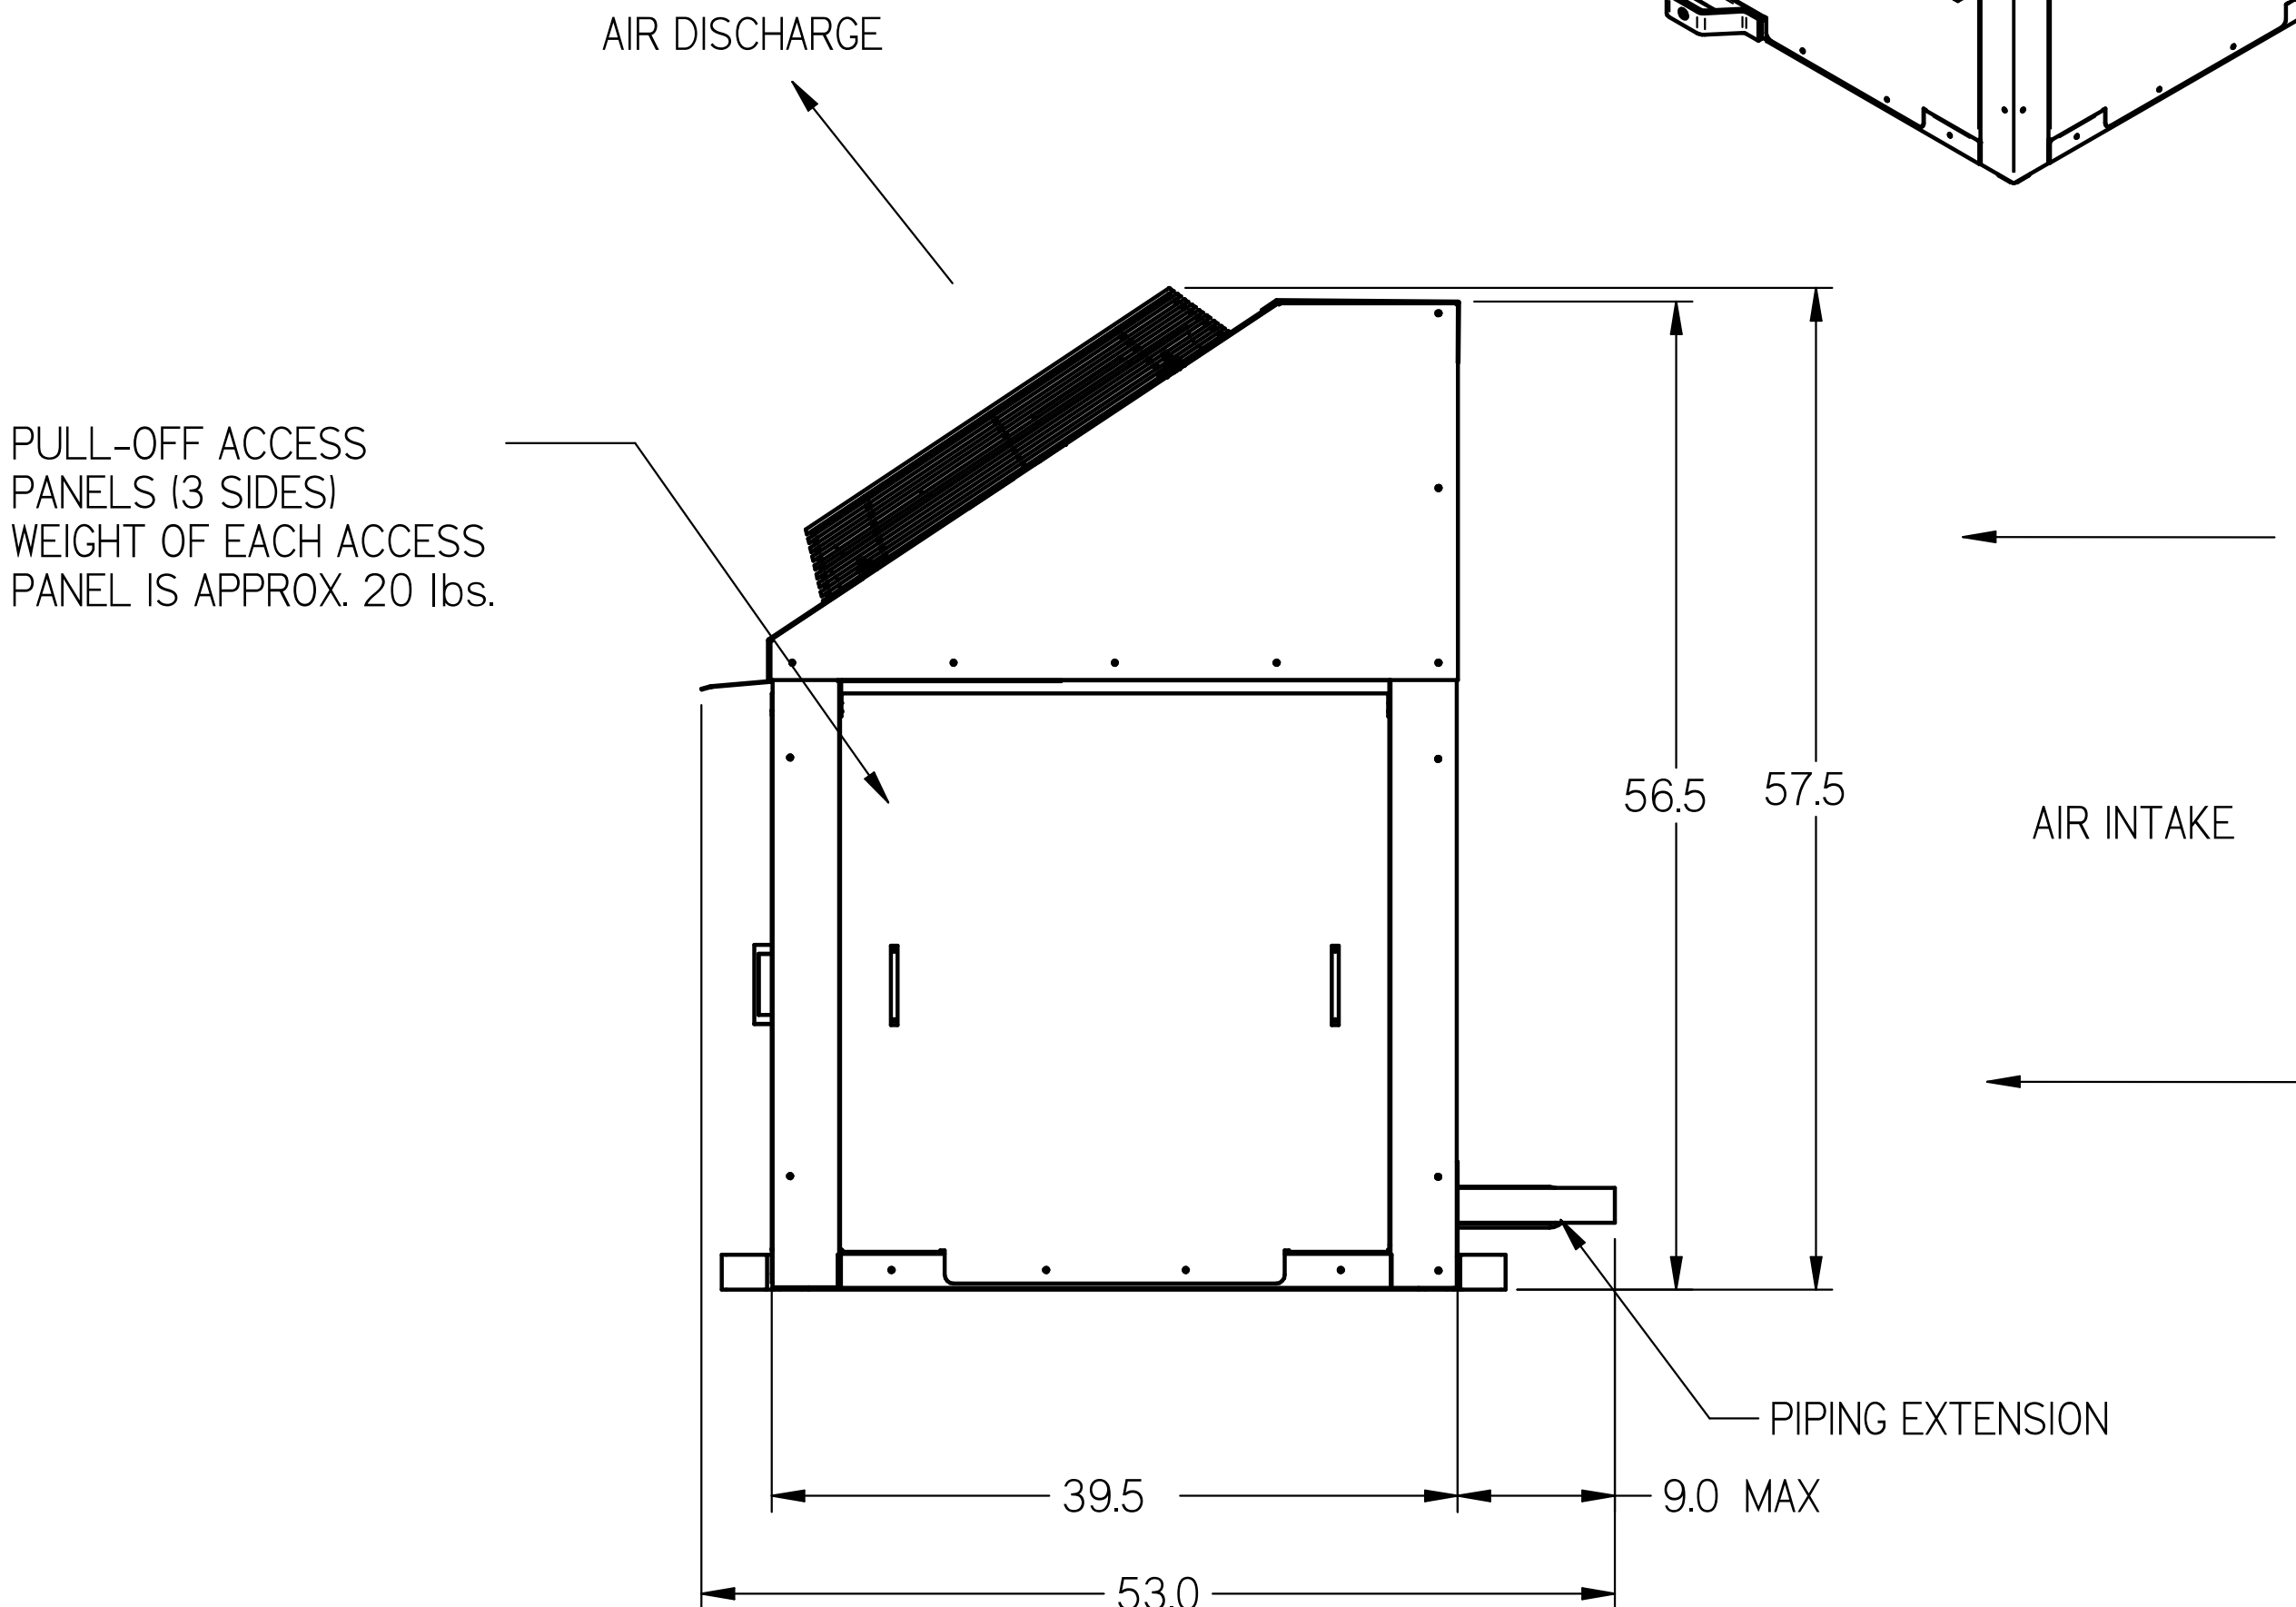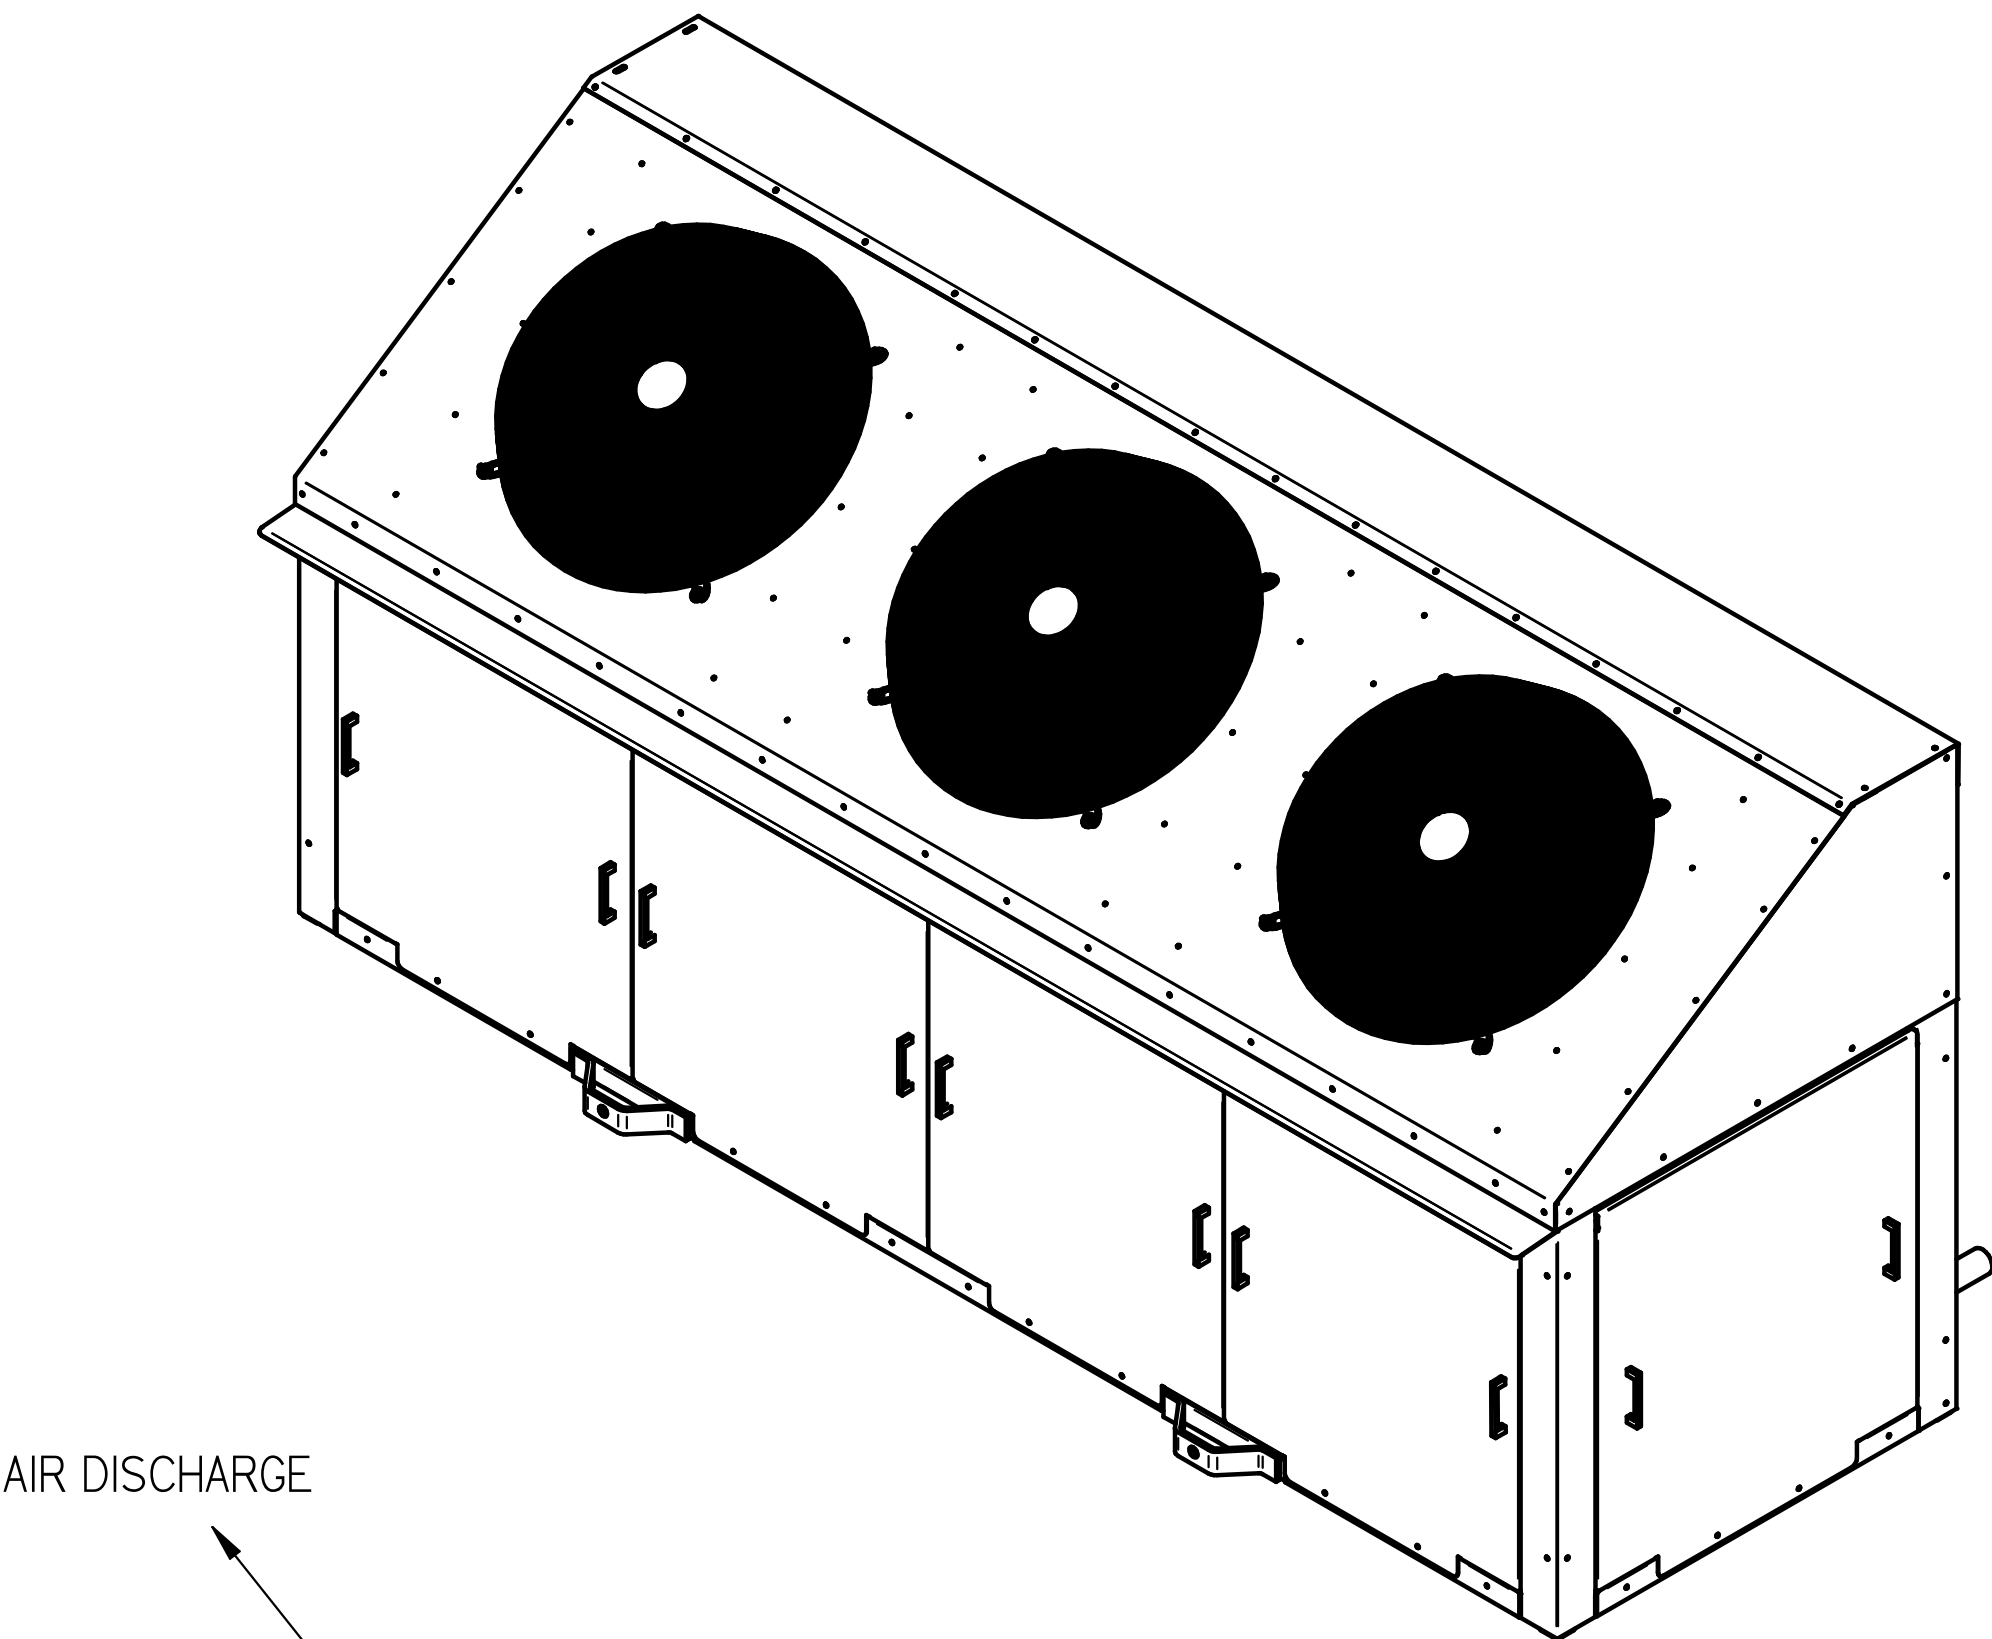

DIMENSIONS ARE IN INCHES.
DATE DRAWN: 2017/09/14

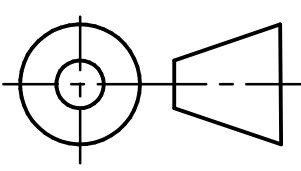THIRD
ANGLE
PROJECTION

SHEET 1 OF 3

HUSSmann[®]



3-FAN PROTOAIRE
WITH PULL OFF
PANELS

DOC PD-000000080

REV B

INFORMATION SUBJECT TO CHANGE

SWN 1.0 SUBMITTAL SHEET SIZE D

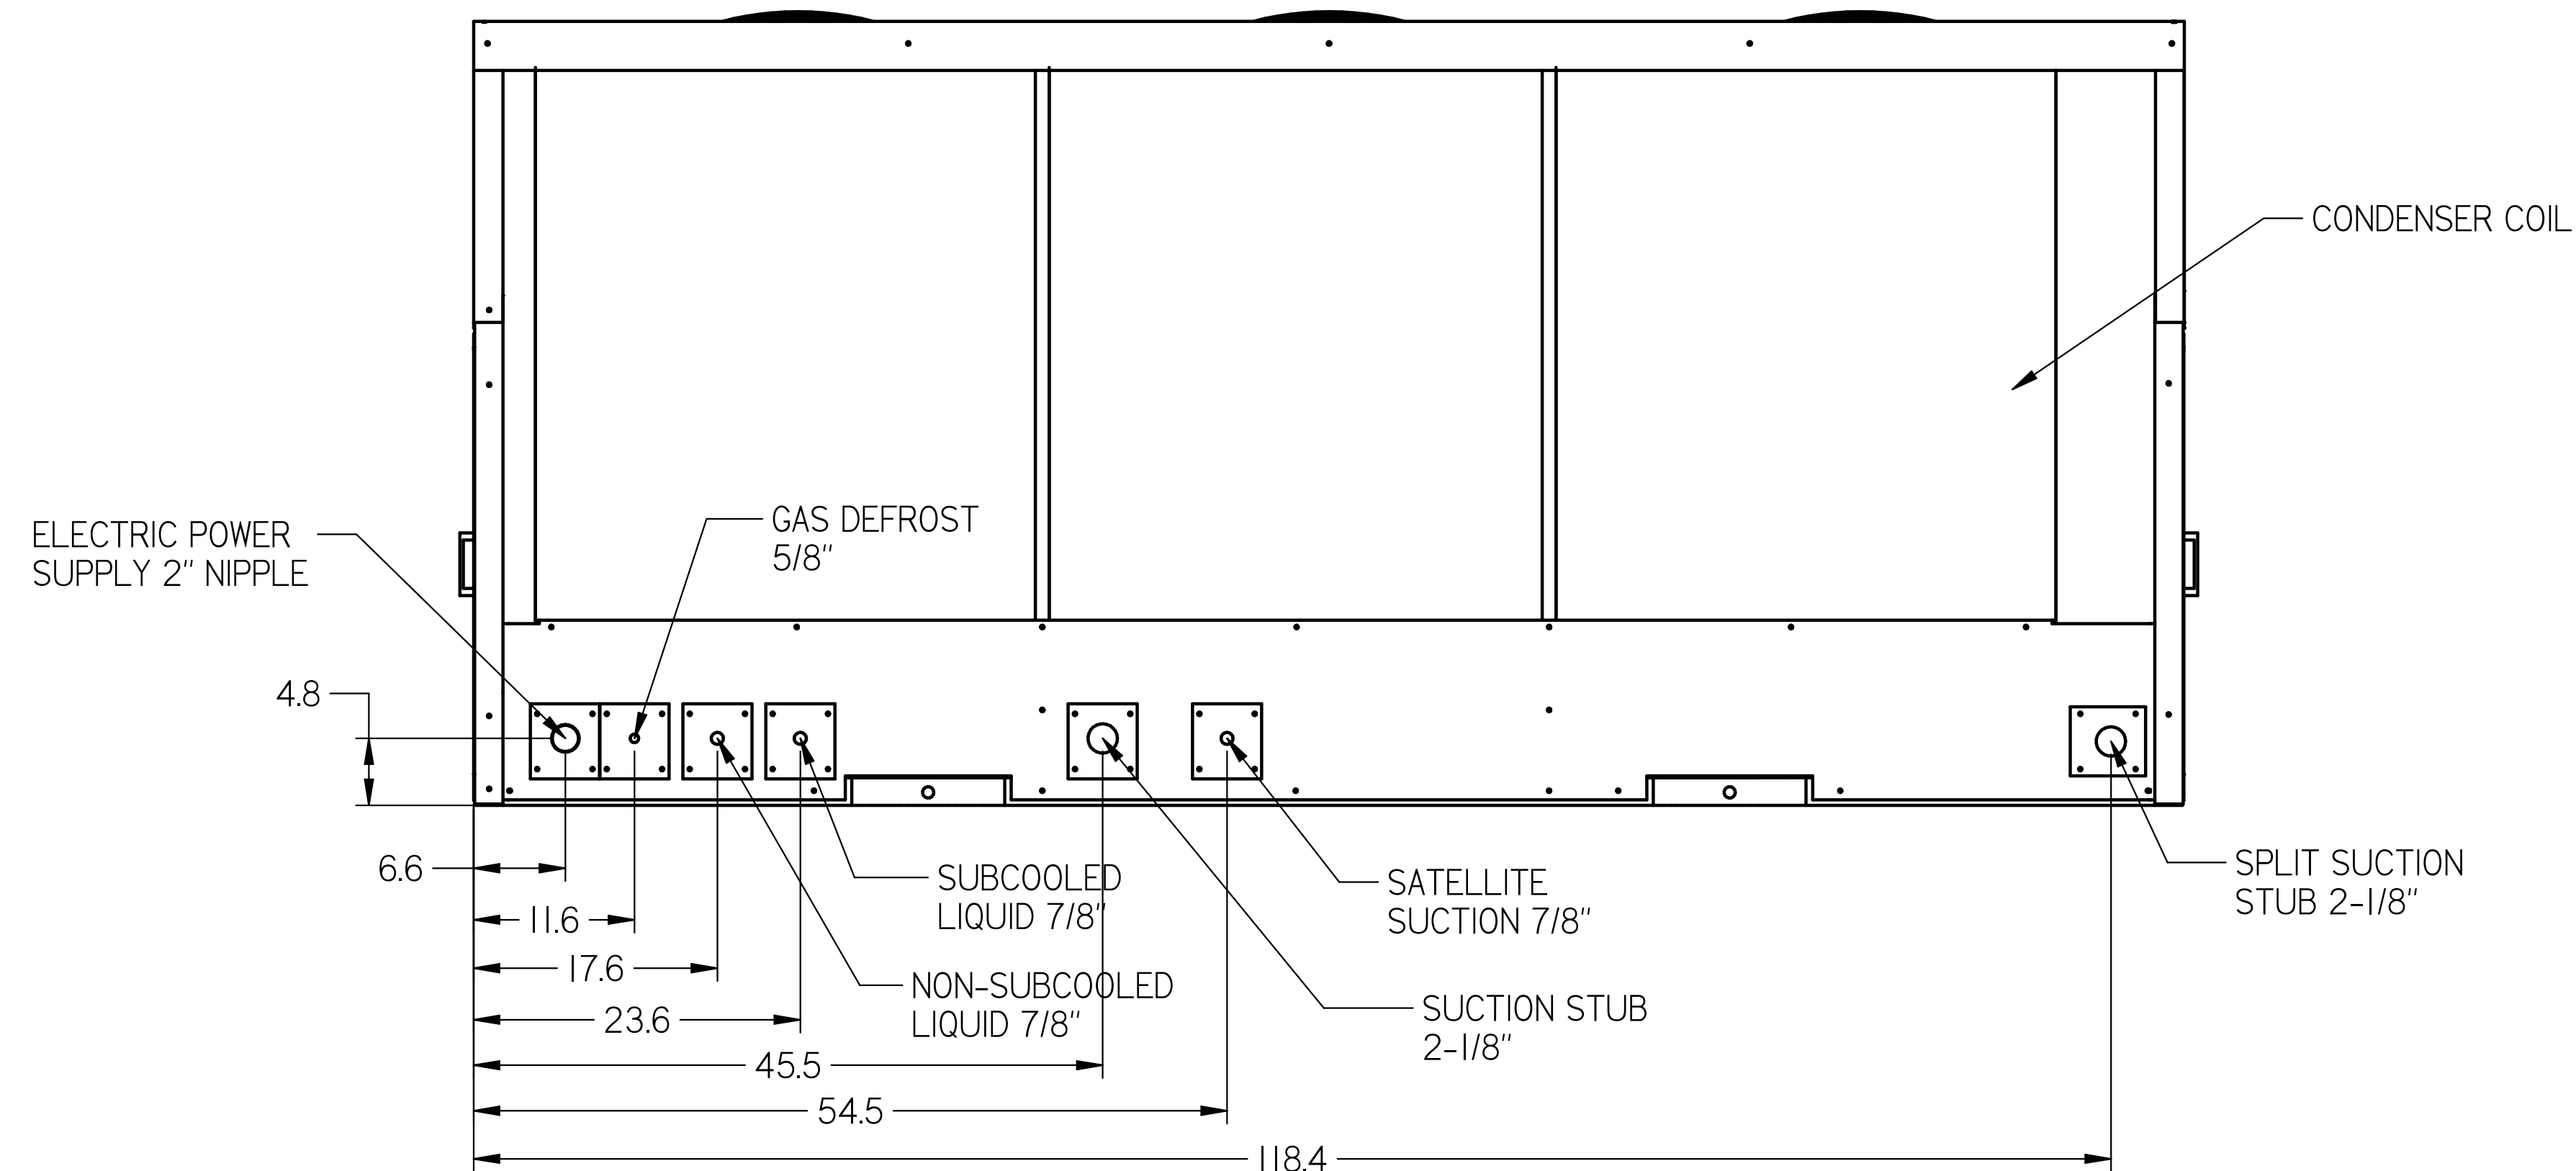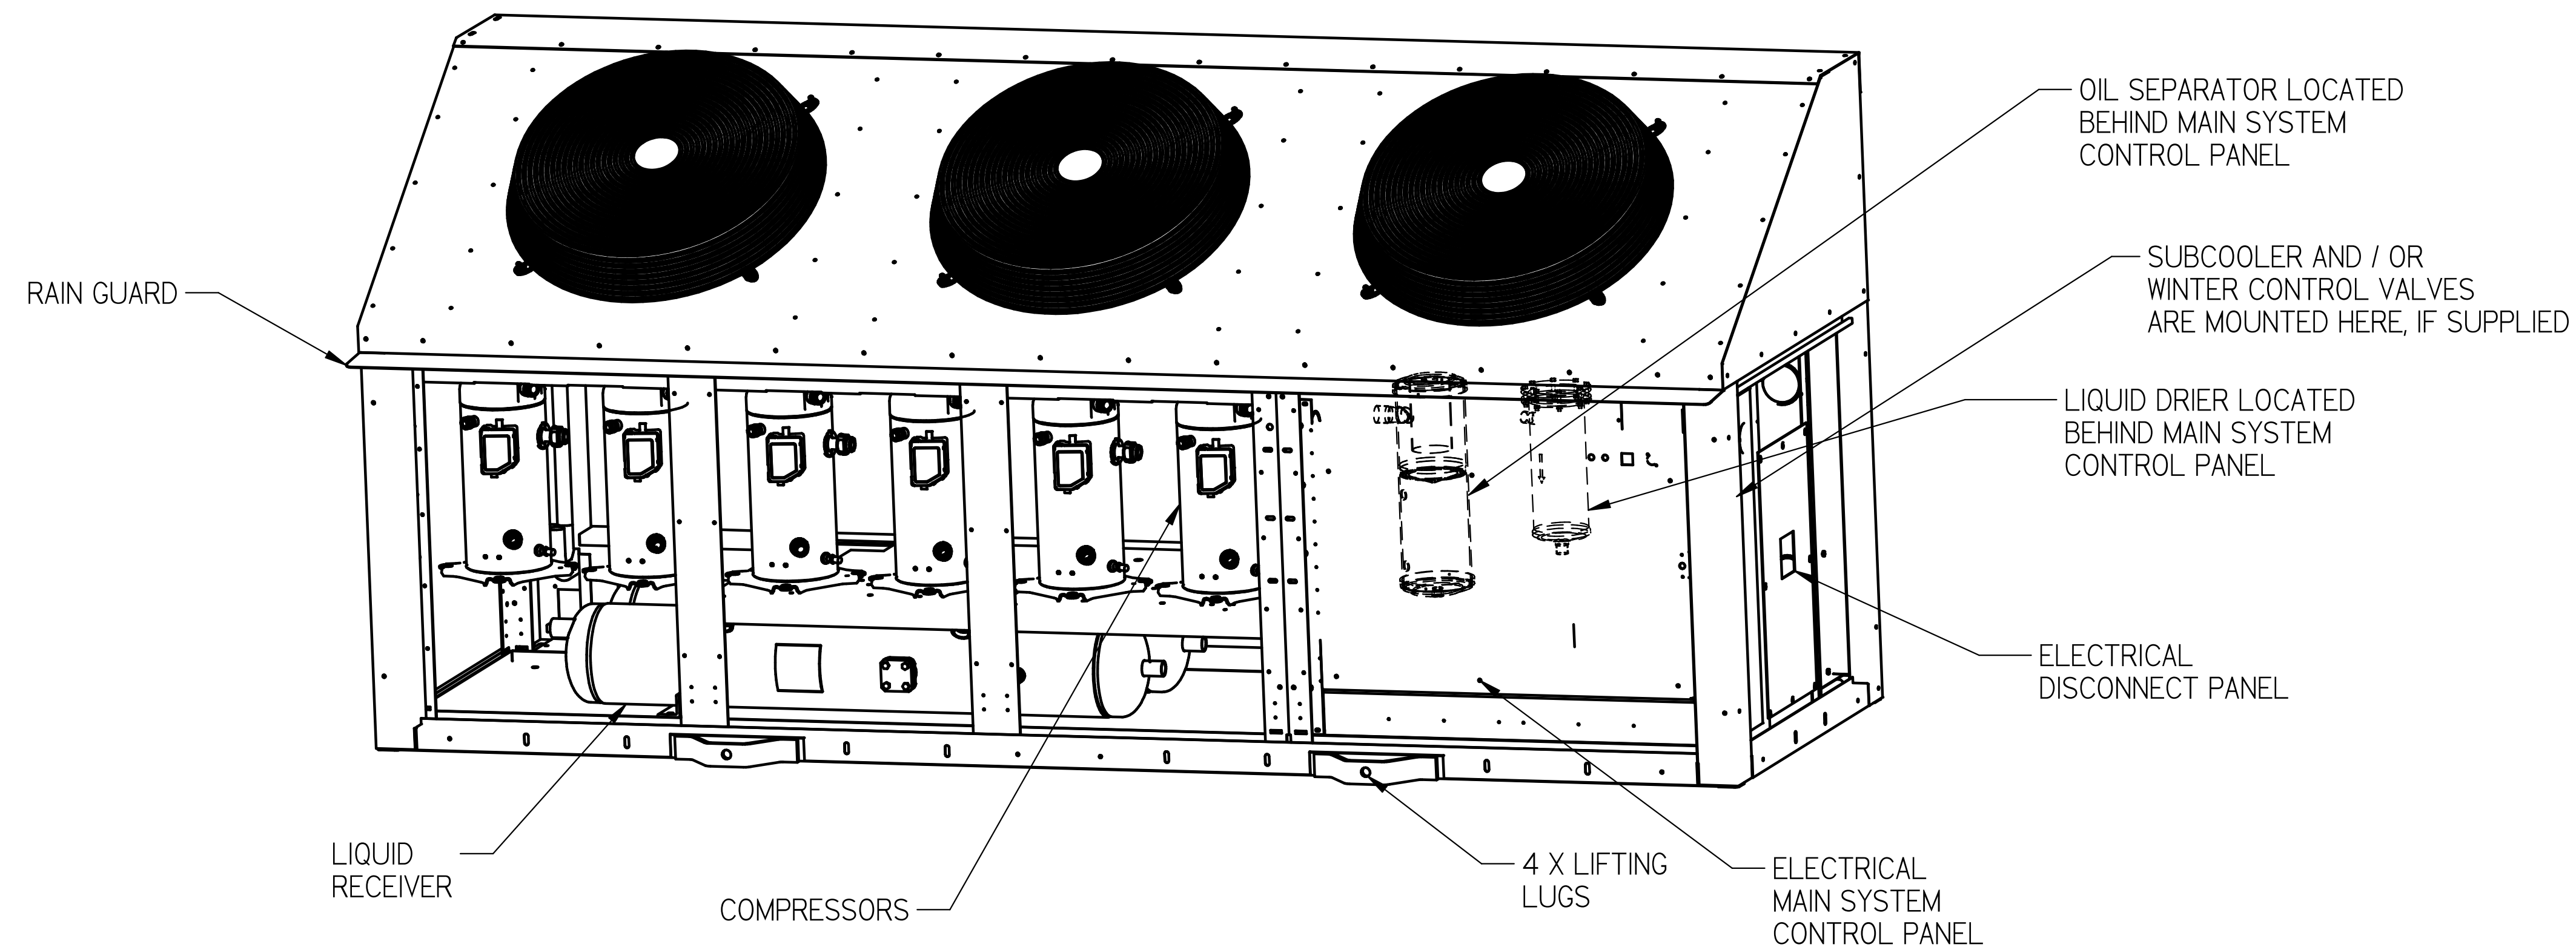

GENERAL UNIT SPECIFICATIONS :
 MATERIAL : GALVANIZED G90U STEEL
 FINISH : POWDER-COATED BEIGE
 CONDENSER COIL : COPPER TUBING, ALUMINUM FINS
 OPTIONAL COIL/FIN COATINGS : ELECTROFIN OR POLYFIN
 NOMINAL FAN SPEED : 1140 RPM
 OPTIONAL VFD AVAILABLE

EACH UNIT ACCOMODATES UPTO SIX COMPRESSORS,
 ILLUSTRATION SHOWN FOR REPRESENTATION ONLY.
 ACTUAL PRODUCT MAY VAY DEPENDING UPON UNIT
 CONFIGURATION.
 OPTIONAL DOOR HOLD-OPEN HARDWARE AVAILABLE

NOTES:

1. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
3. OVERALL DIMENSIONS: 125.5 L X 53.0 W X 57.5 H

INFORMATION SUBJECT TO CHANGE





DIMENSIONS ARE IN INCHES. DATE DRAWN: 2017/09/14	HUSSmann®	
	3-FAN PROTOAIRE WITH PULL OFF PANELS	
THIRD ANGLE PROJECTION	DOC PD-000000080	REV B
SHEET 2 OF 3		

SWN 1.0 SUBMITTAL SHEET SIZE D

MINIMUM CLEARANCE REQUIREMENTS:
ACTUAL CLEARANCE REQUIREMENTS ARE
DEPENDENT UPON AUTHORITY HAVING
JURISDICTION, AND MAY EXCEED
DIMENSIONS SHOWN.


PROVIDE CLEARANCES AS SHOWN TO ENSURE
ADEQUATE AIRFLOW, REDUCE THE POTENTIAL
FOR AIR RECIRCULATION, FACILITATE SERVICE
ACCESSIBILITY, AND TO MAINTAIN COMPLIANCE
WITH ELECTRICAL CODE REQUIREMENTS

SUGGESTED RIGGING SETUP IS ILLUSTRATED.
BE SURE THAT LIFTING CABLES/STRAPS DO NOT
DAMAGE PIPING STUBS, COIL SURFACE, OR RAIN GUARD.
FULL PERIMETER SUPPORT FOUNDATION REQUIRED

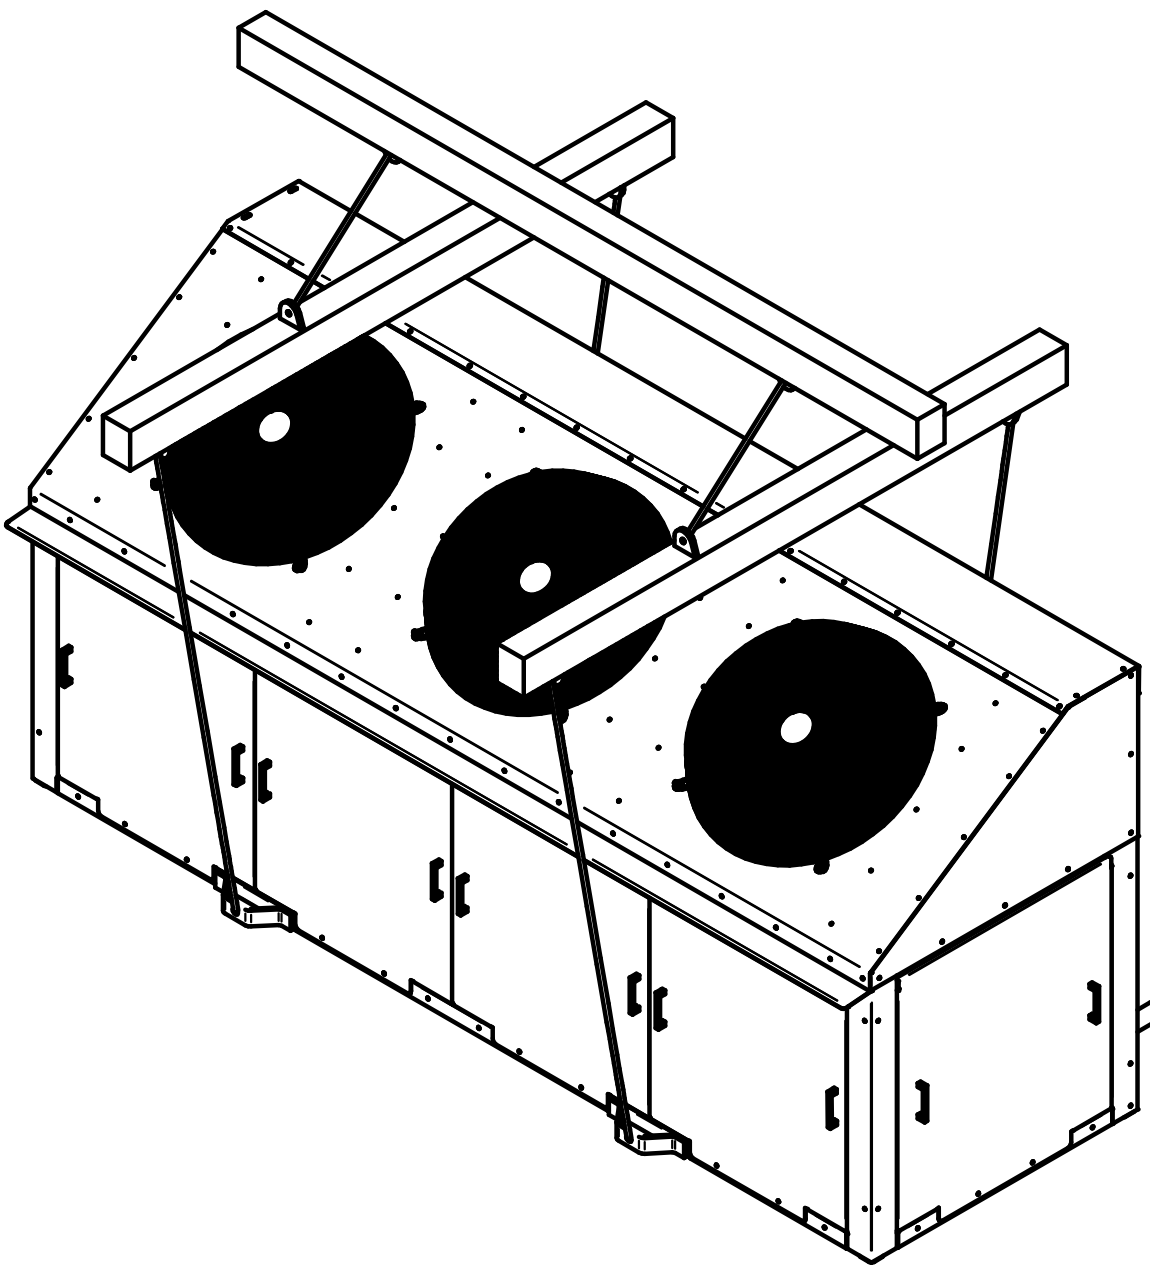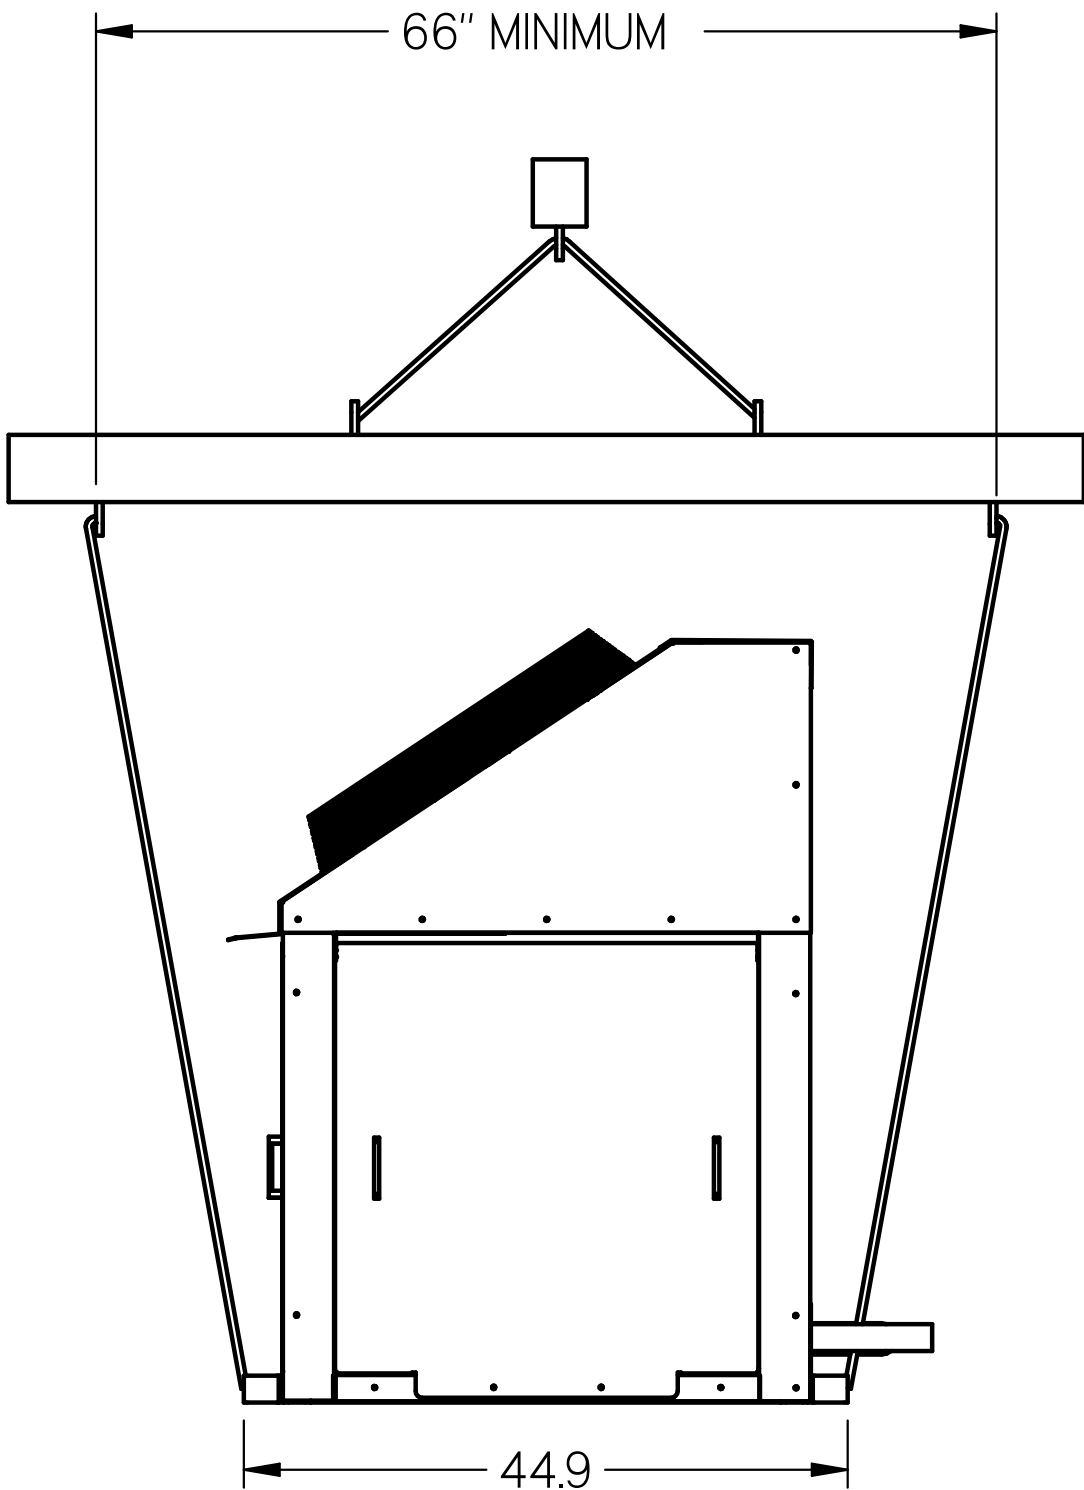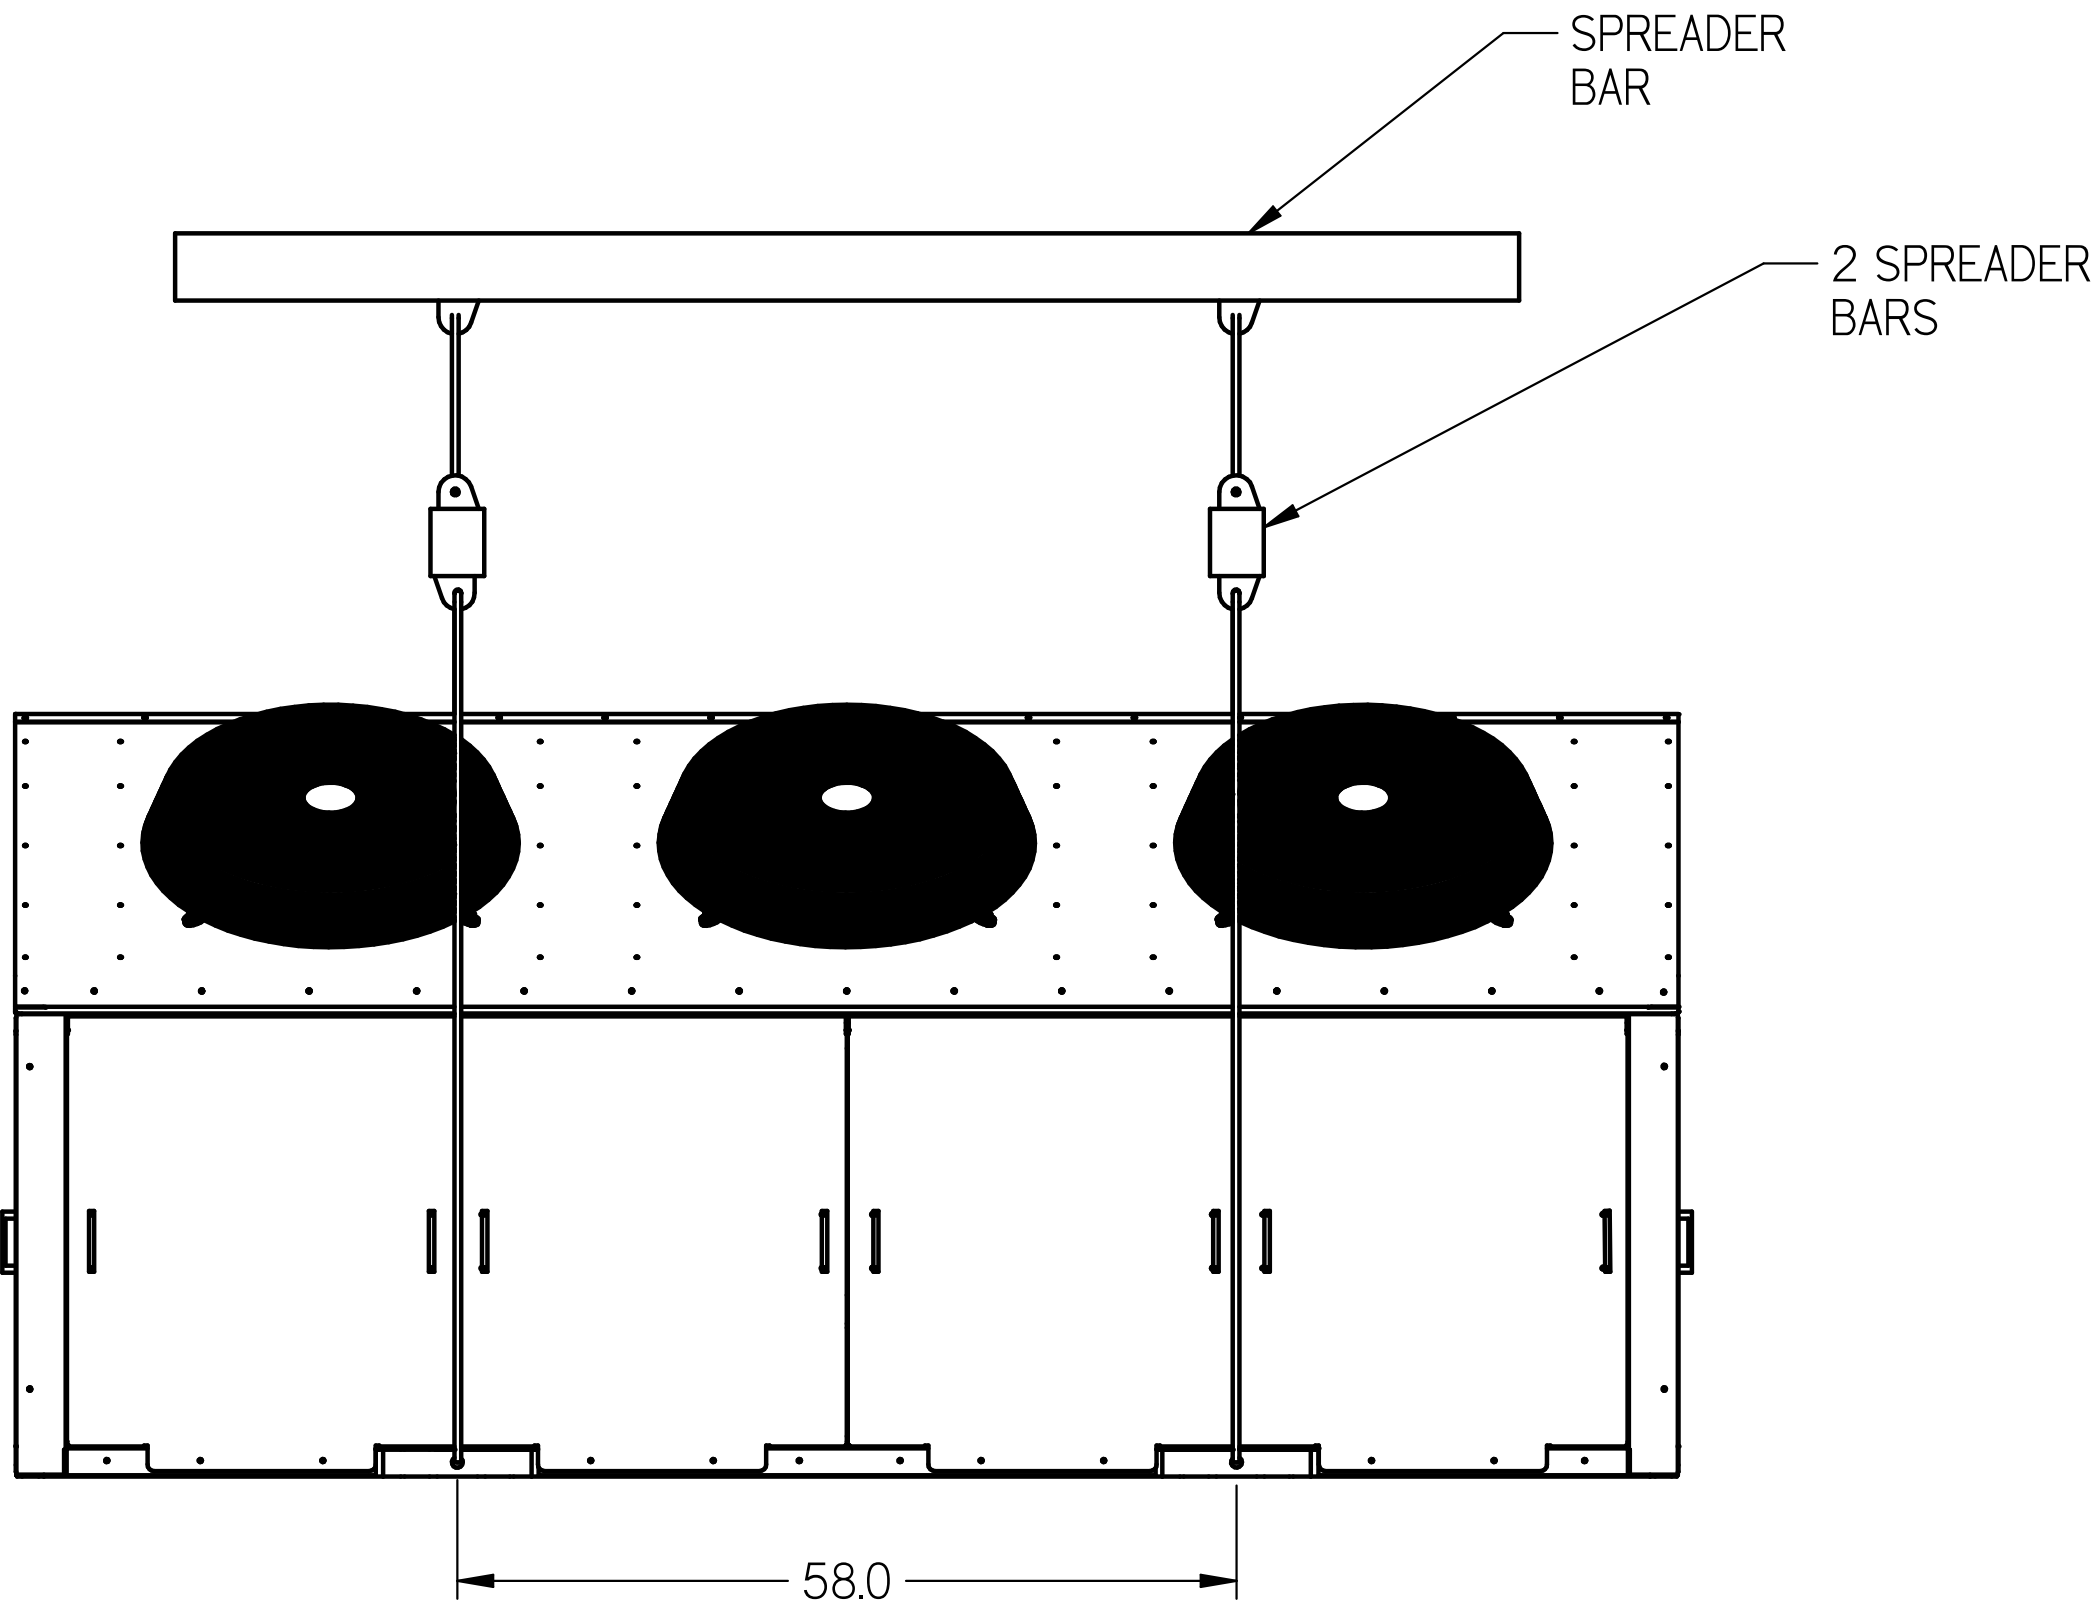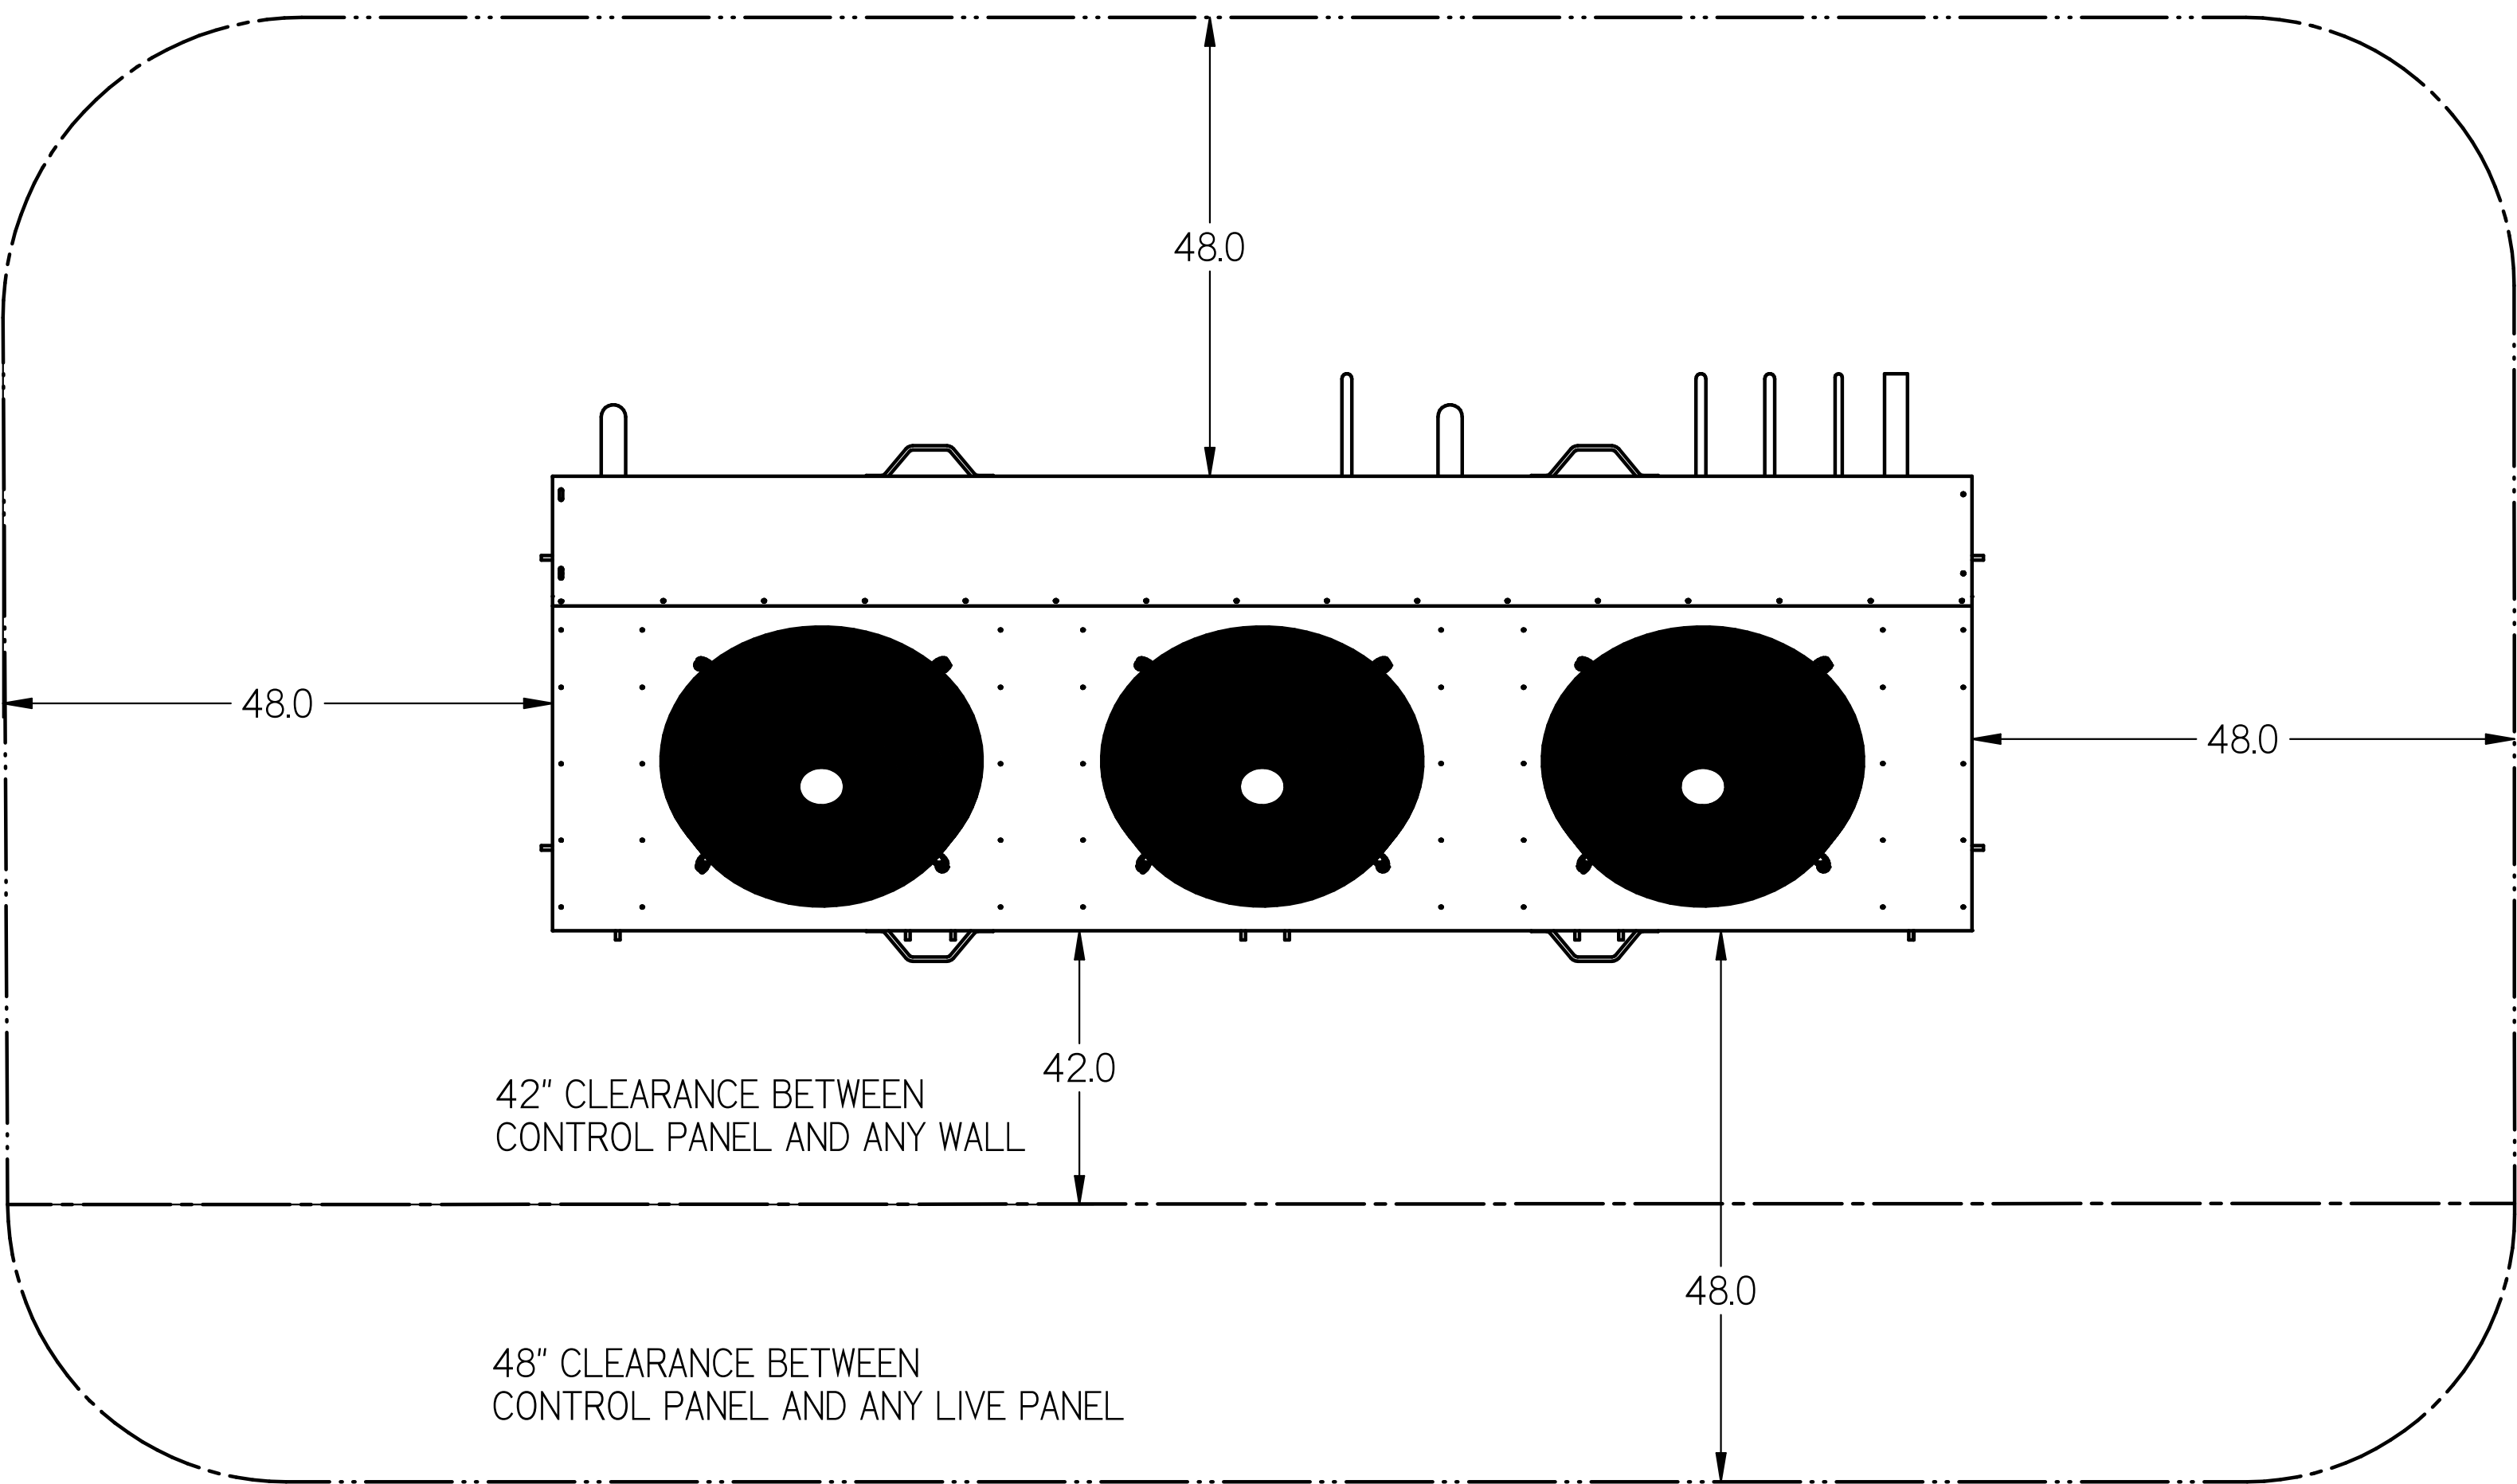

- NOTES:
1. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
 3. OVERALL DIMENSIONS: 125.5 L X 53.0 W X 57.5 H

INFORMATION SUBJECT TO CHANGE

DIMENSIONS ARE IN INCHES. DATE DRAWN: 2017/09/14		HUSSMANN [®]	
 THIRD ANGLE PROJECTION		3-FAN PROTOAIRE WITH PULL OFF PANELS	
SHEET 3 OF 3		DOC PD-000000080	REV B

SWN 1.0 SUBMITTAL SHEET SIZE D