

MINIMUM CLEARANCE REQUIREMENTS:
ACTUAL CLEARANCE REQUIREMENTS
ARE DEPENDENT UPON AUTHORITY
HAVING JURISDICTION, AND MAY
EXCEED DIMENSIONS SHOWN.

42" CLEARANCE BETWEEN
CONTROL PANEL AND ANY WALL

48" CLEARANCE BETWEEN
CONTROL PANEL AND ANY LIVE PANEL

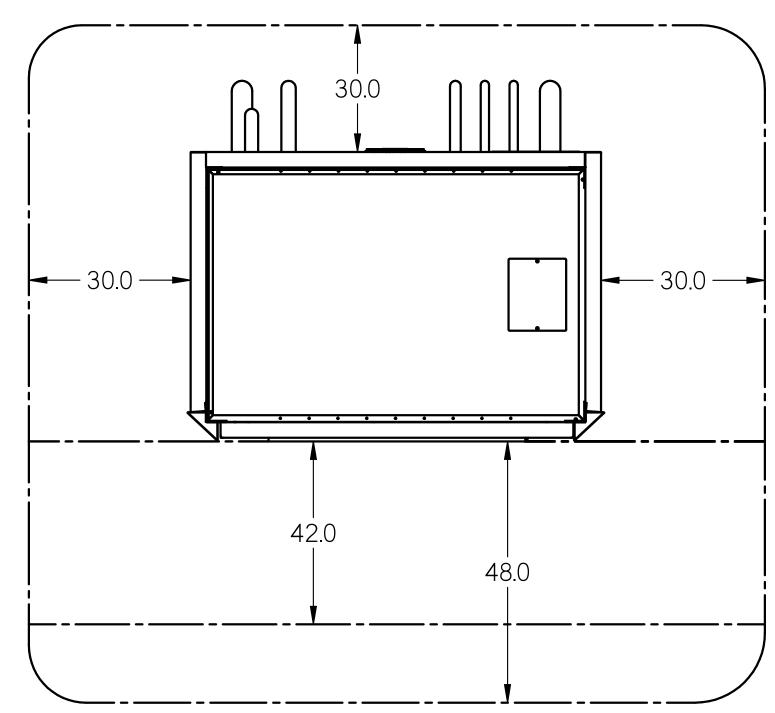

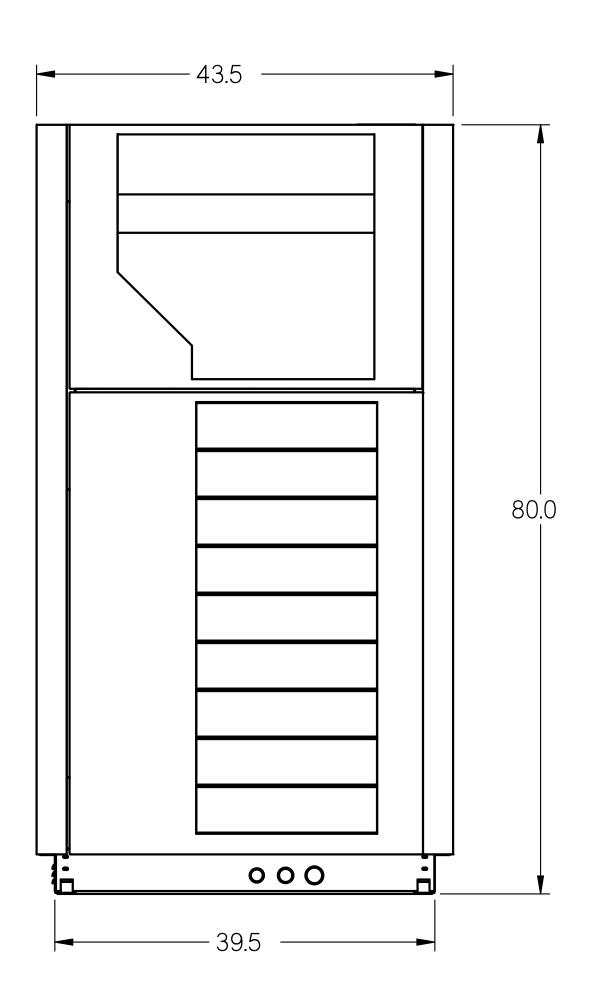


LIFT FRONT PANEL TO OPEN -CONTROL PANEL DOOR — IN OPEN POSITION — PIPING EXTENSION → 9.0 MAX HUSSMANN DIMENSIONS ARE IN INCHES. DATE DRAWN: 2017/09/14 ASSM 3 WIDE VERTICAL PROTOCOL THIRD - ANGLE PROJECTION

SHEET I

INFORMATION SUBJECT TO CHANGE


NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
- 3. OVERALL DIMENSIONS: 43.5 L X 37.5 W X 80.0 H.
- 4. APPROXIMATE WEIGHT OF UNIT = 1,500 LBS.

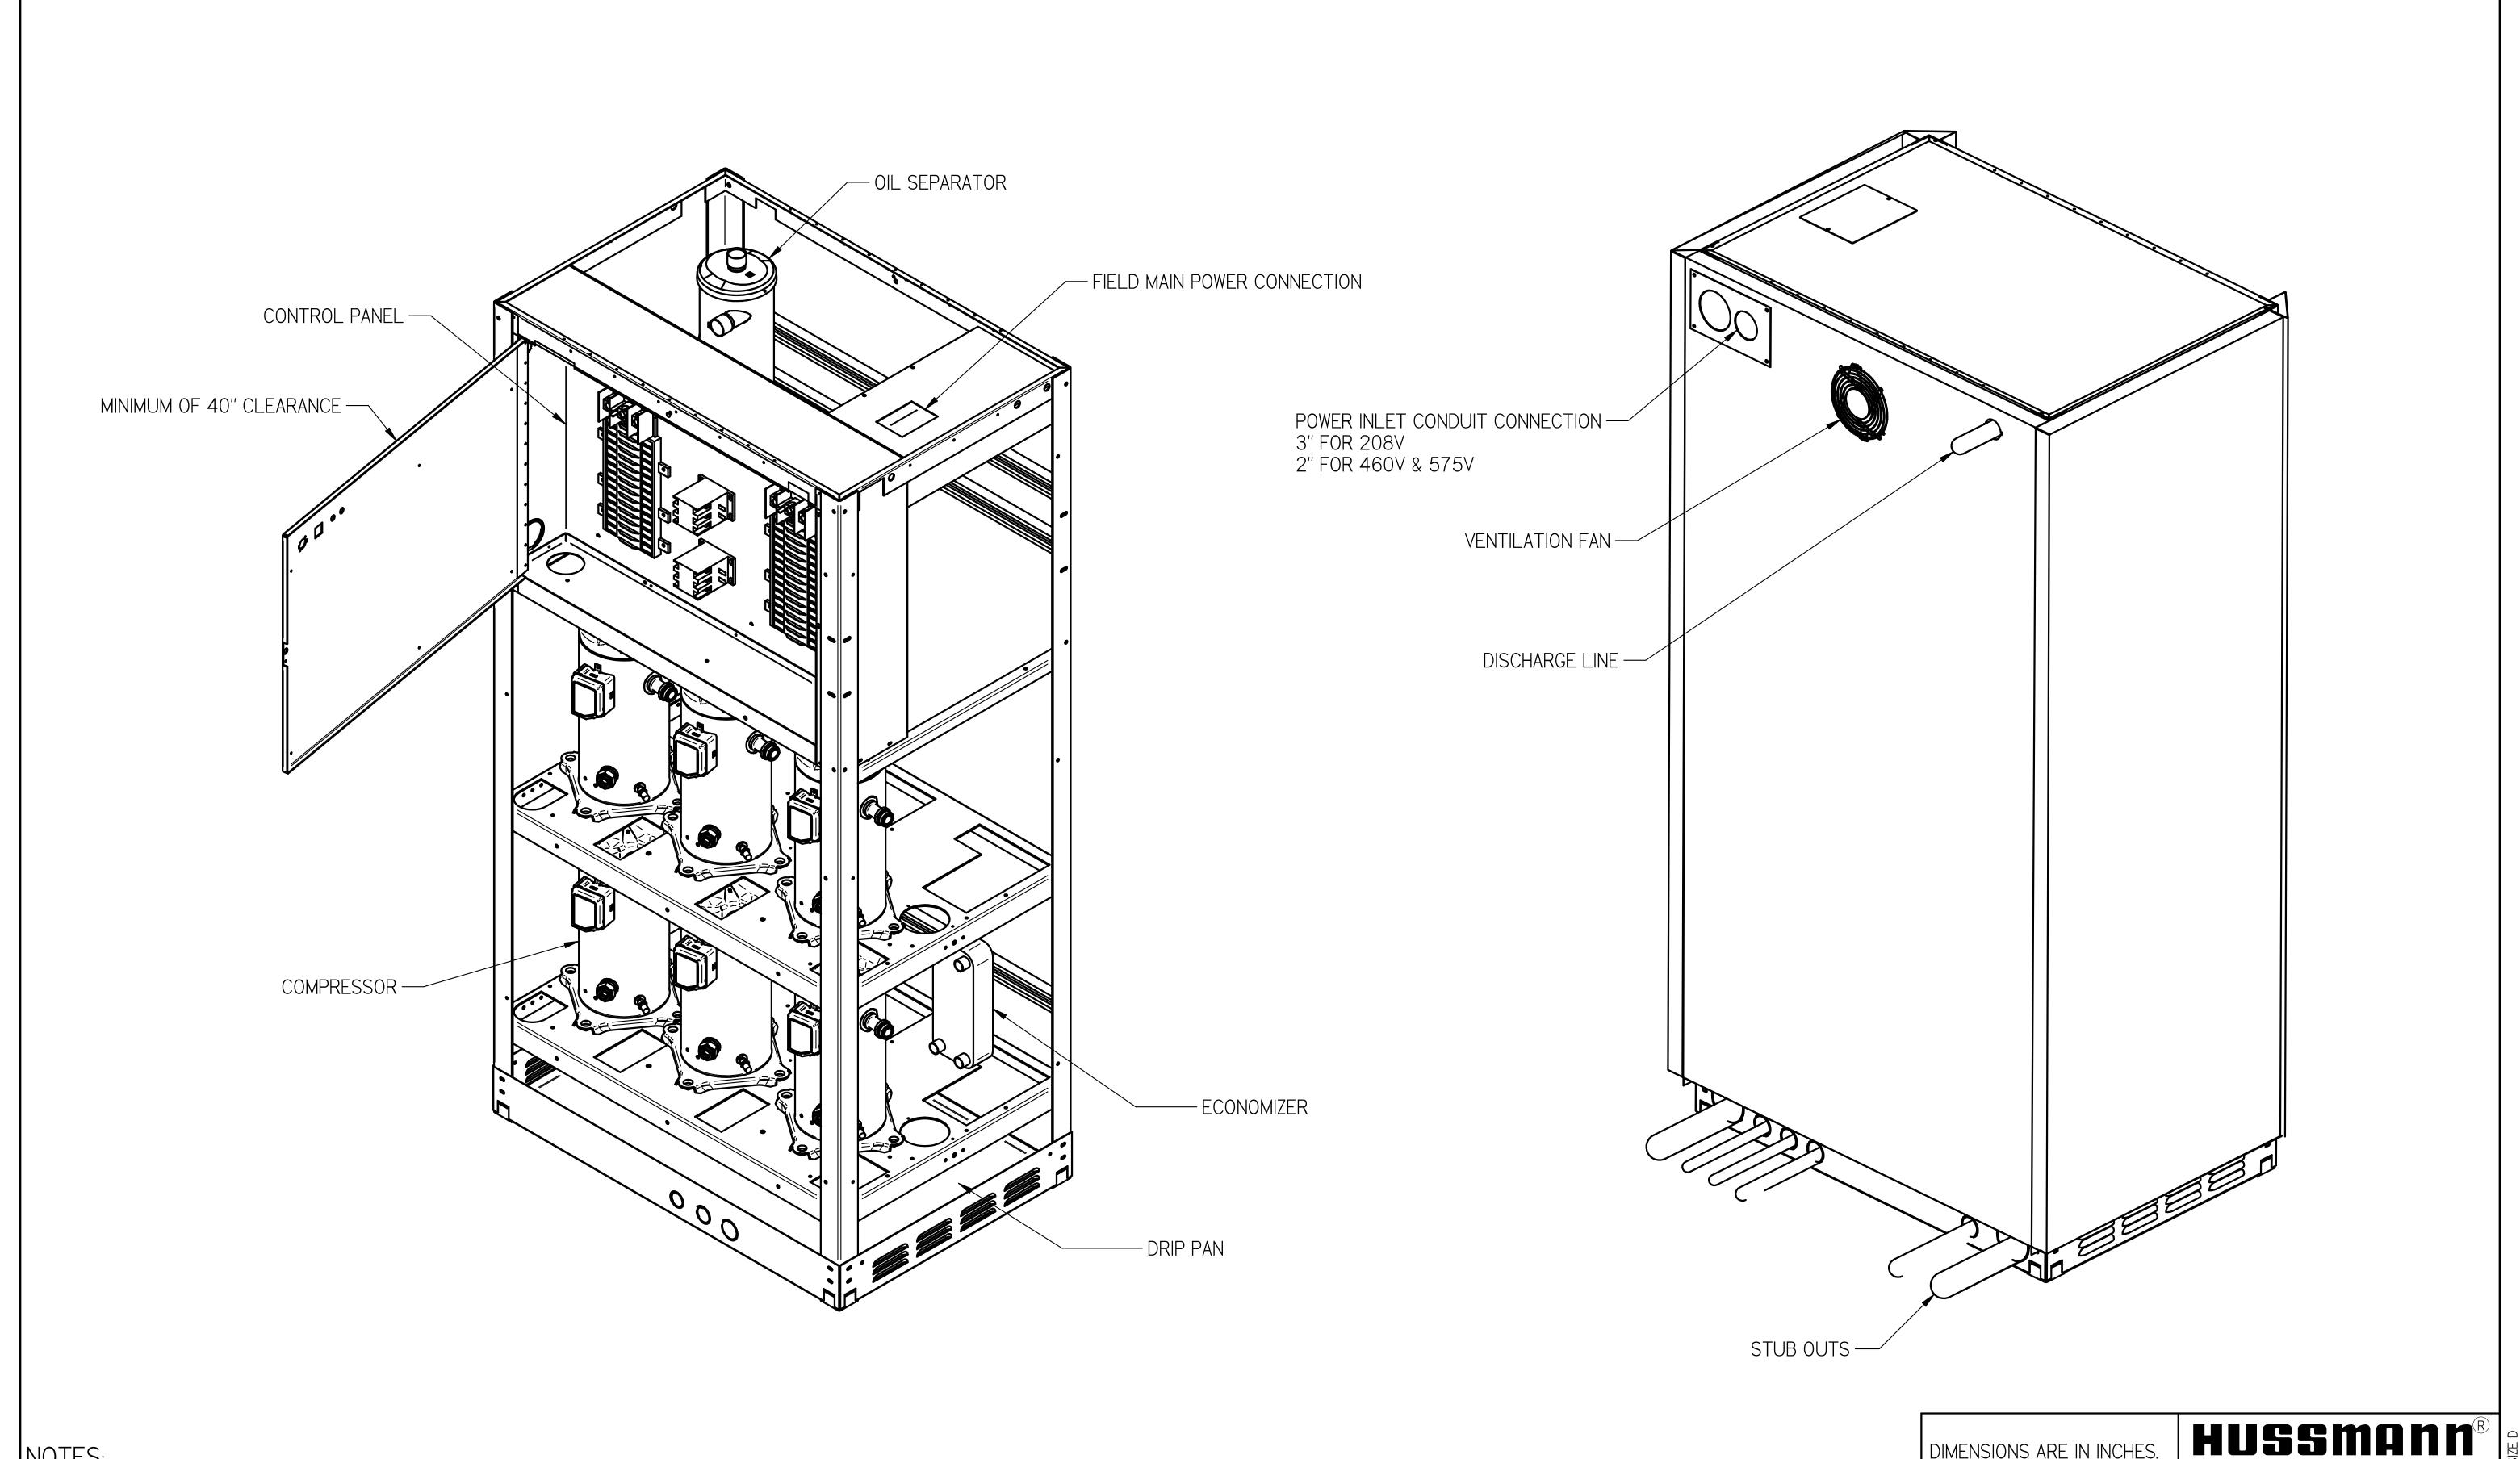

NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
- 3. OVERALL DIMENSIONS: 43.5 L X 37.5 W X 80.0 H.
- 4. APPROXIMATE WEIGHT OF UNIT = 1,500 LBS.

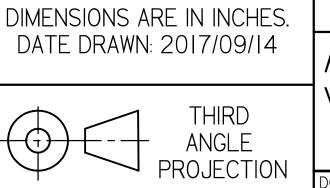

SHEET 2 OF 2

INFORMATION SUBJECT TO CHANGE

ASSM 3 WIDE VERTICAL PROTOCOL