



## SEE SHEET 3 FOR MINIMUM CLEARANCE REQUIREMENTS

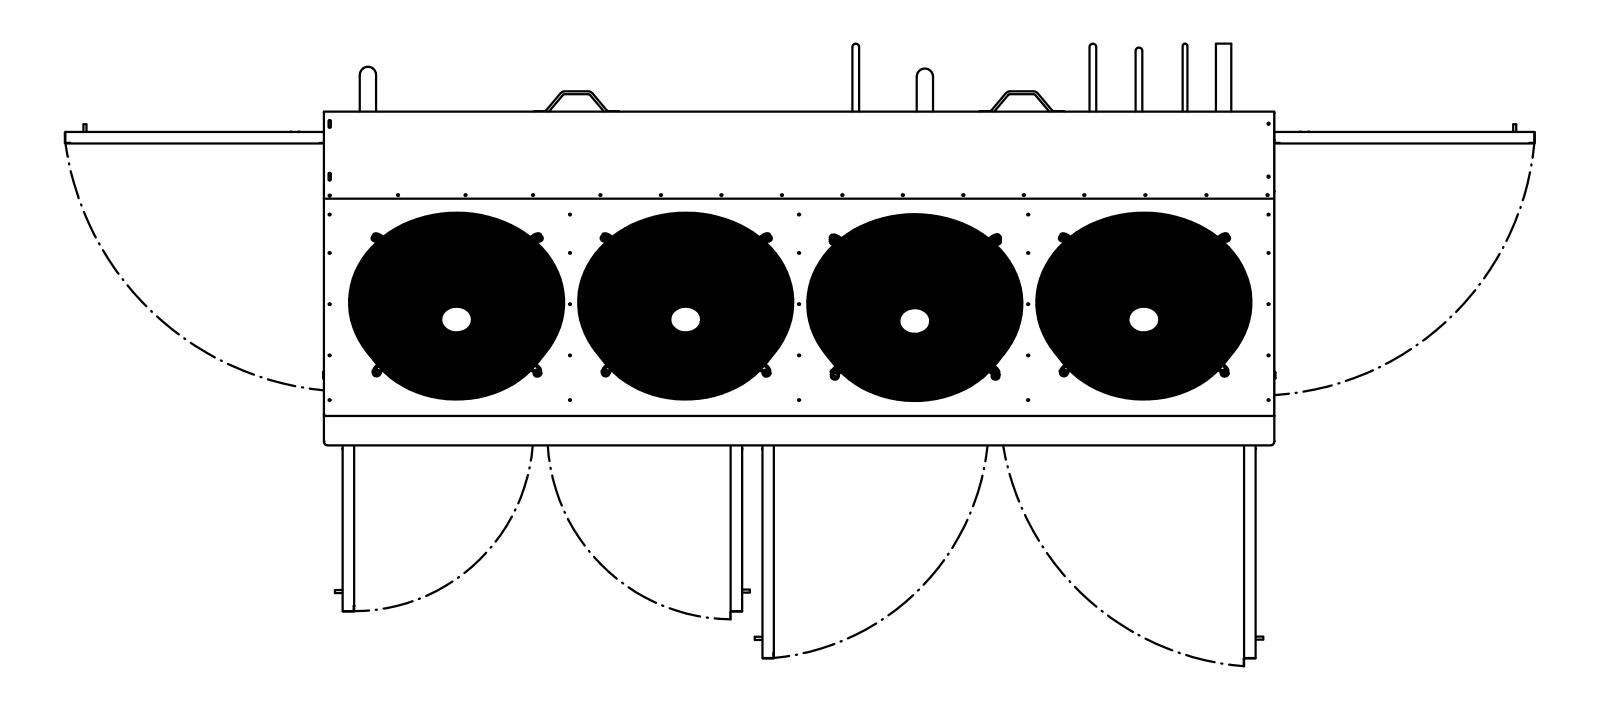

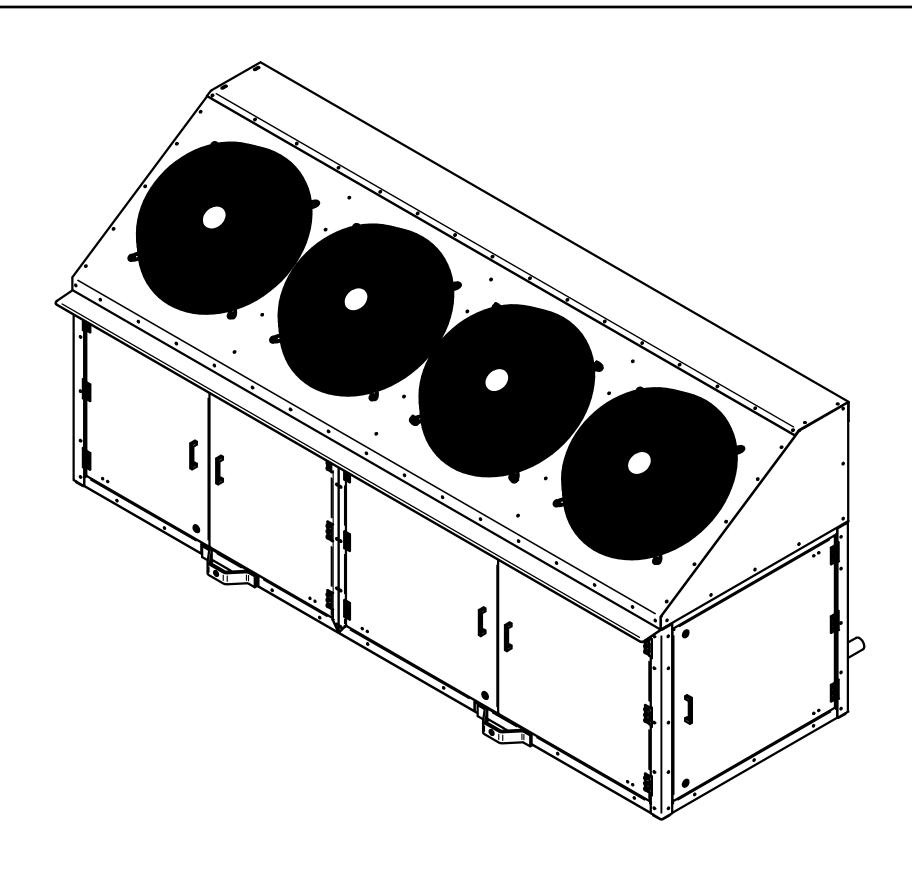

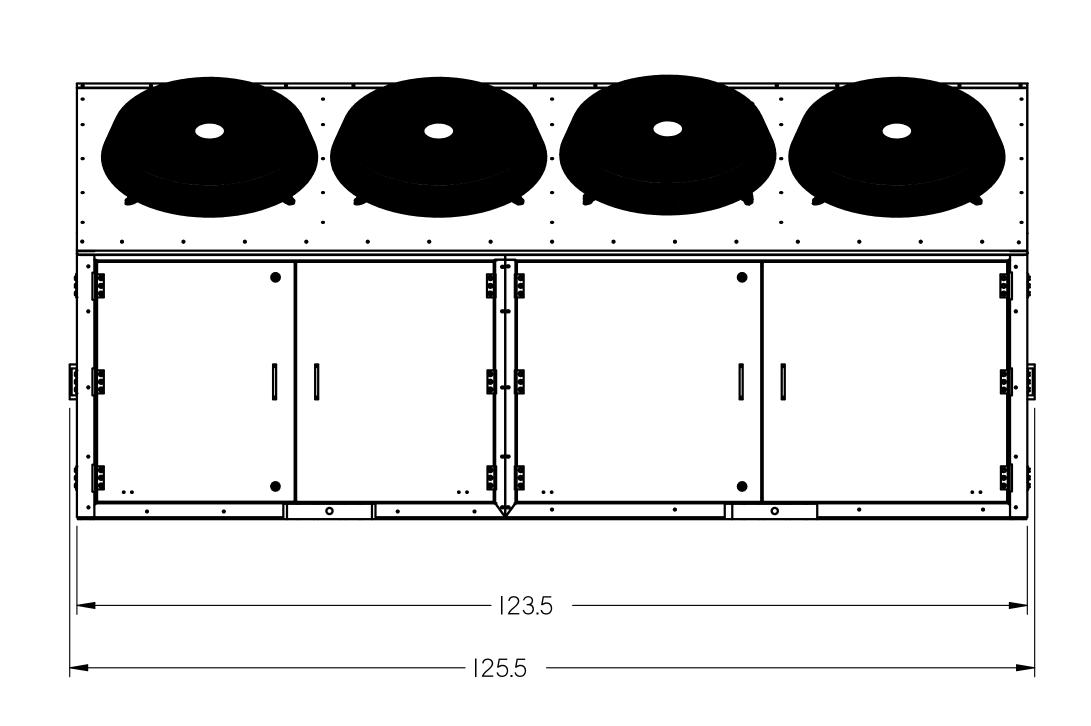

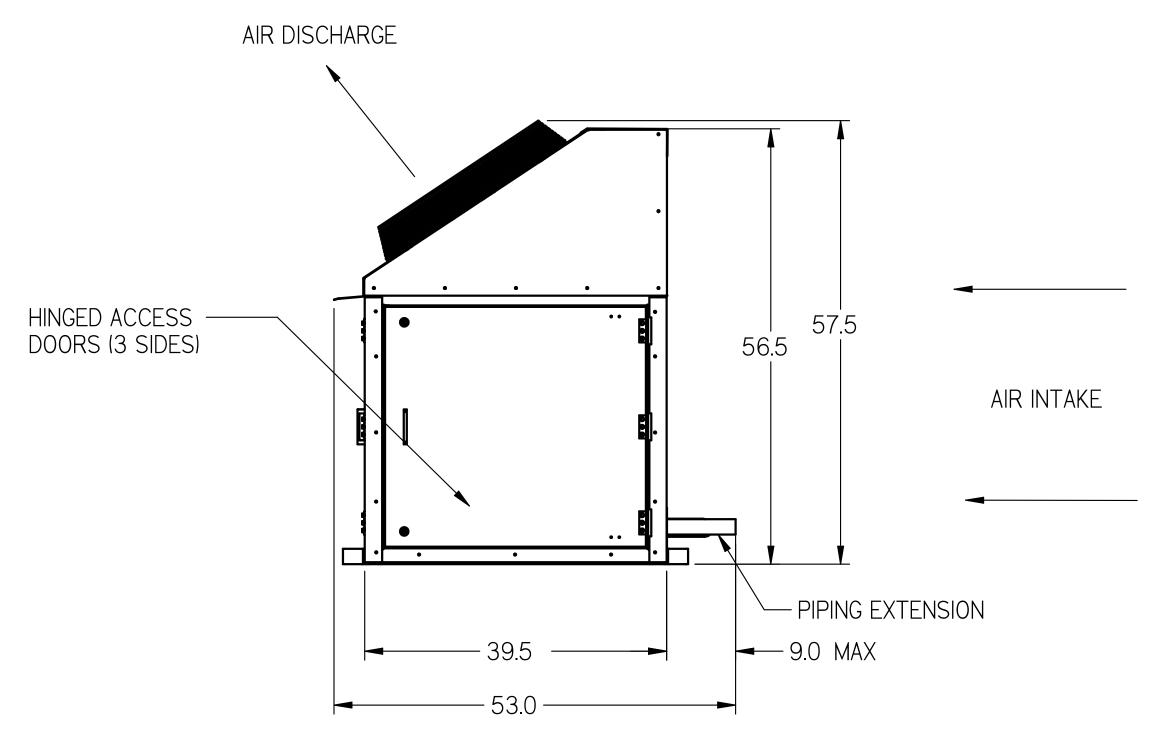

## RECEIVER SIZES SHOWN ARE BASED UPON 80% CAPACITY


MAXIMUM TOTAL UNIT WEIGHT (POUNDS)	SHIPPING	OPERATING
72 POUND RECEIVER	2681	2799
OPTIONAL 200 POUND RECEIVER	2788	3024

## NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
- 3. OVERALL DIMENSIONS: 125.5 L X 53.0 W X 57.5 H


INFORMATION SUBJECT TO CHANGE

DIMENSIONS ARE IN INCHES.	HUSS
DATE DRAWN: 2017/09/14	4-FAN PF
THIRD	WITH HING



HUSSMANN
4-FAN PROTOAIRE
WITH HINGED DOORS


PD-00000081 REV B

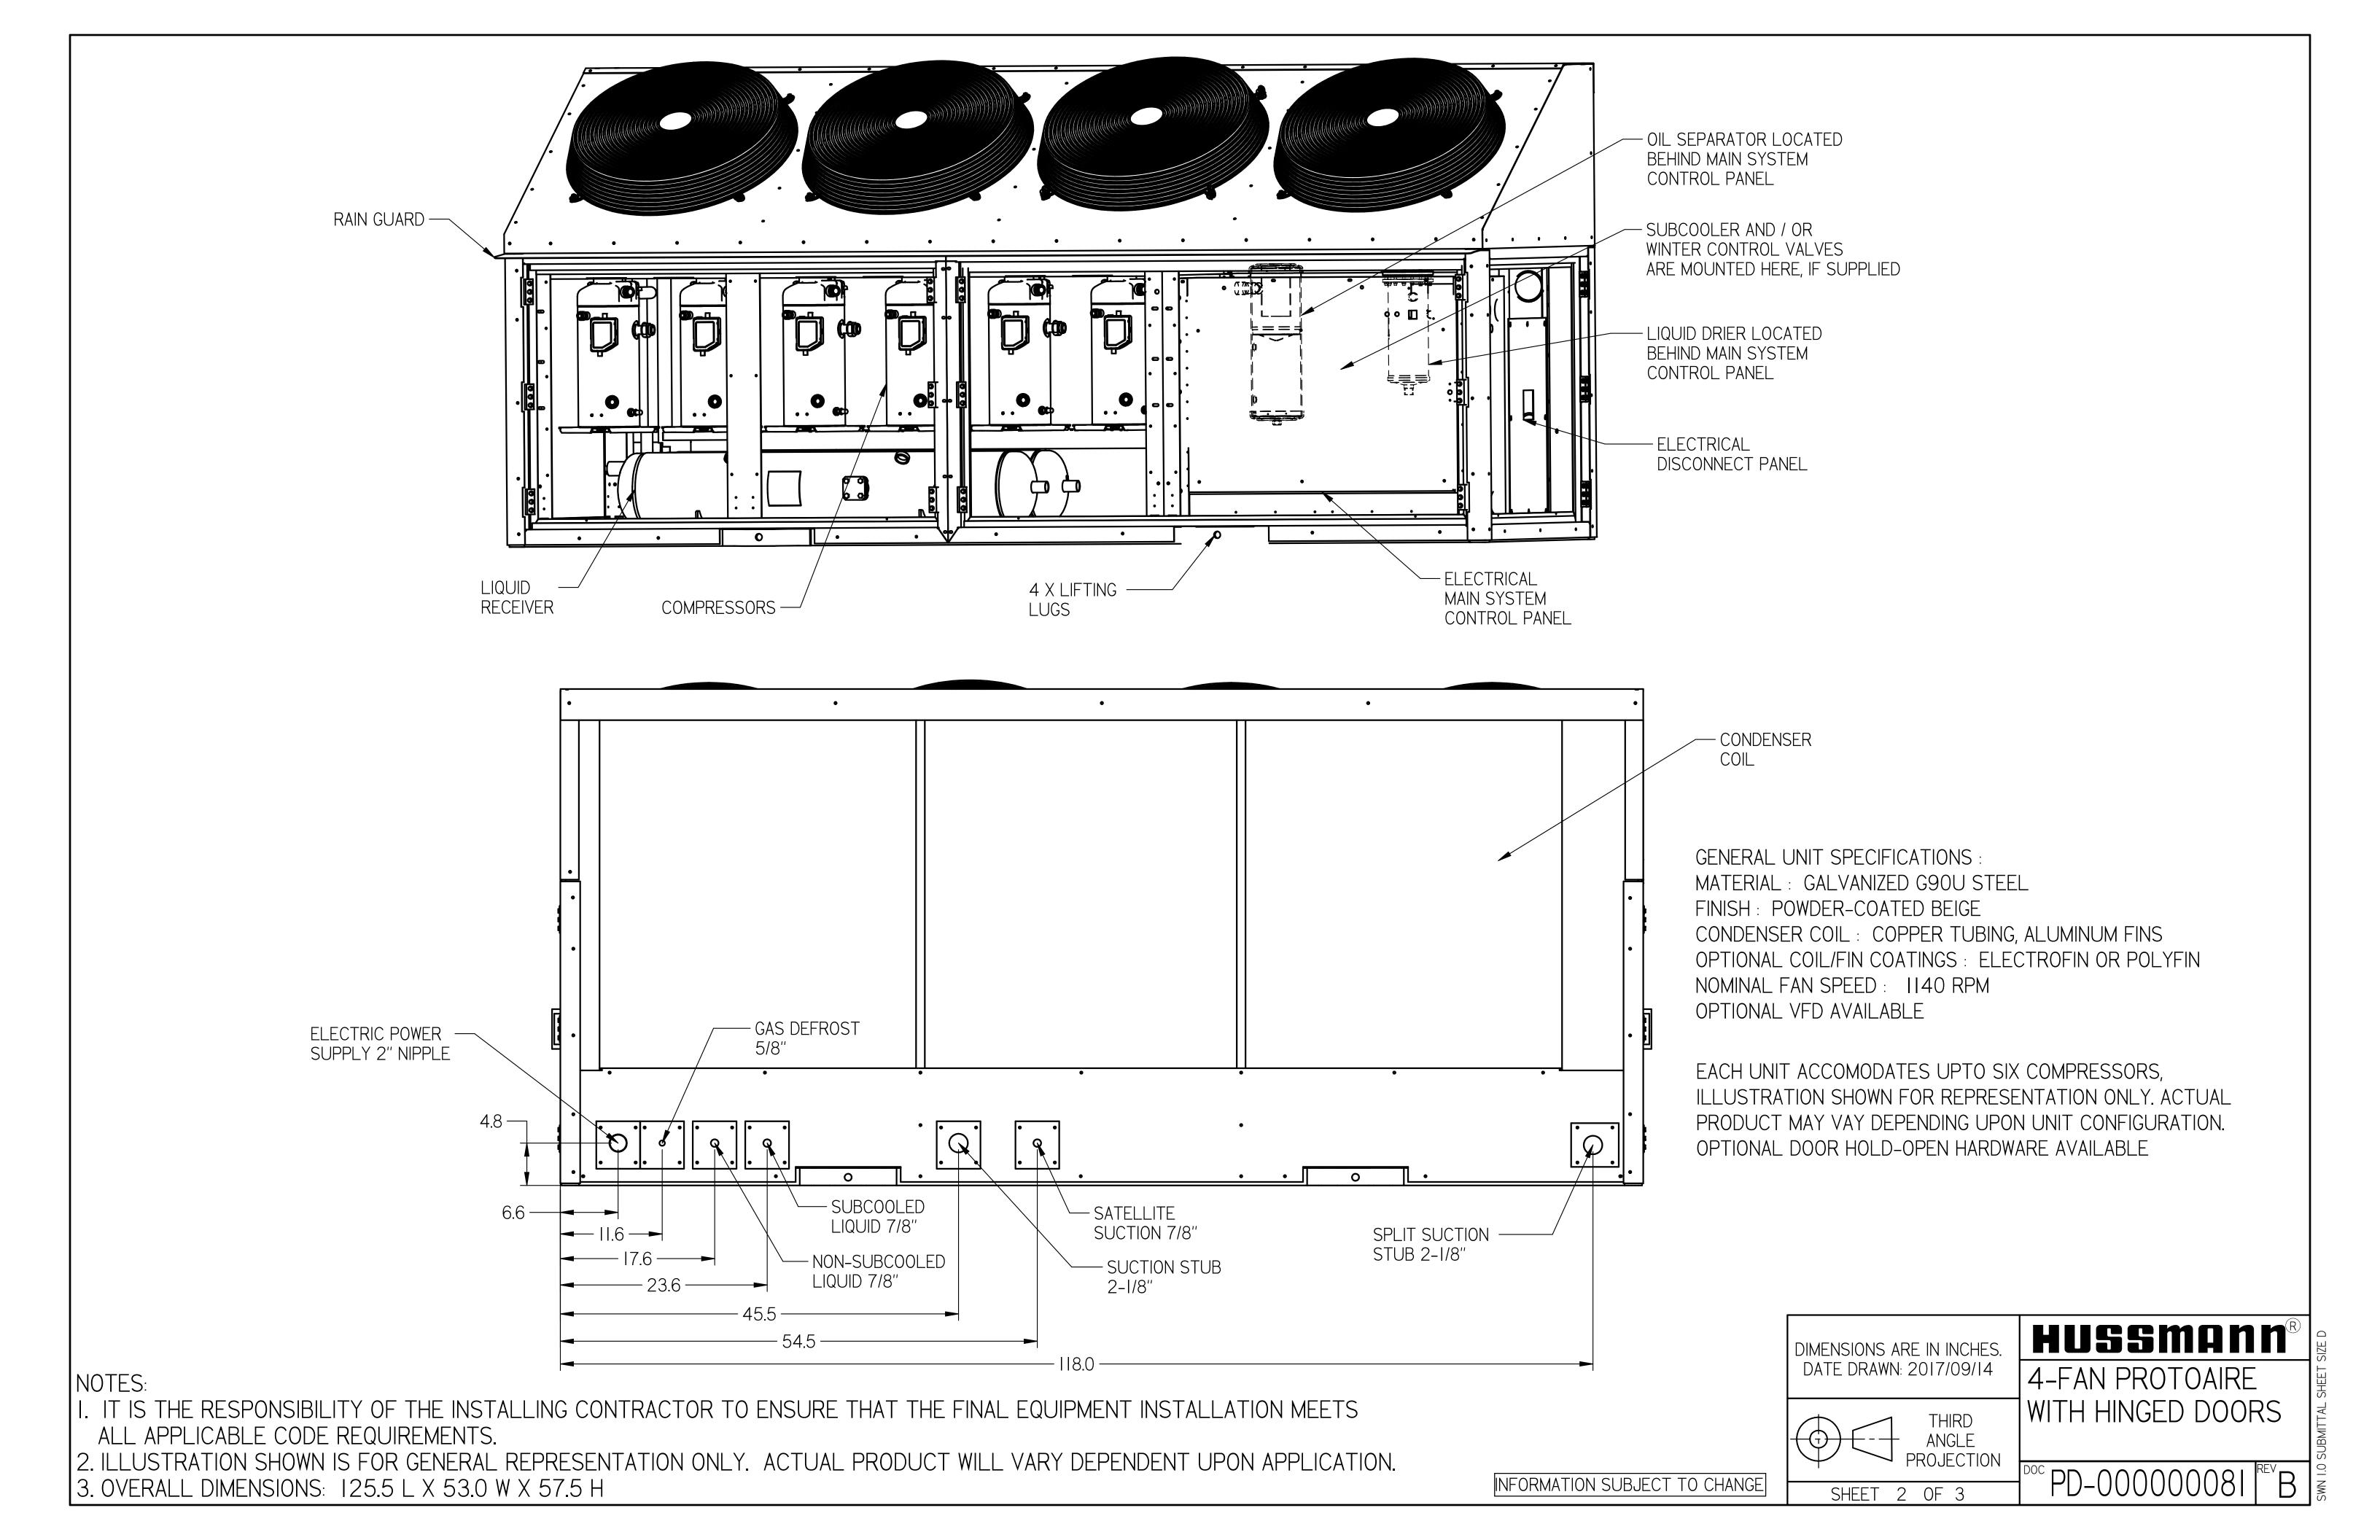



MINIMUM CLEARANCE REQUIREMENTS: ACTUAL CLEARANCE REQUIREMENTS ARE DEPENDENT UPON AUTHORITY HAVING JURISDICTION, AND MAY EXCEED DIMENSIONS SHOWN.

PROVIDE CLEARANCES AS SHOWN TO ENSURE ADEQUATE AIRFLOW, REDUCE THE POTENTIAL FOR AIR RECIRCULATION, FACILITATE SERVICE ACCESSIBILITY, AND TO MAINTAIN COMPLIANCE WITH ELECTRICAL CODE REQUIREMENTS

SUGGESTED RIGGING SETUP IS ILLUSTRATED. BE SURE THAT LIFTING CABLES/STRAPS DO NOT DAMAGE PIPING STUBS, COIL SURFACE, OR RAIN GUARD. FULL PERIMETER SUPPORT FOUNDATION REQUIRED

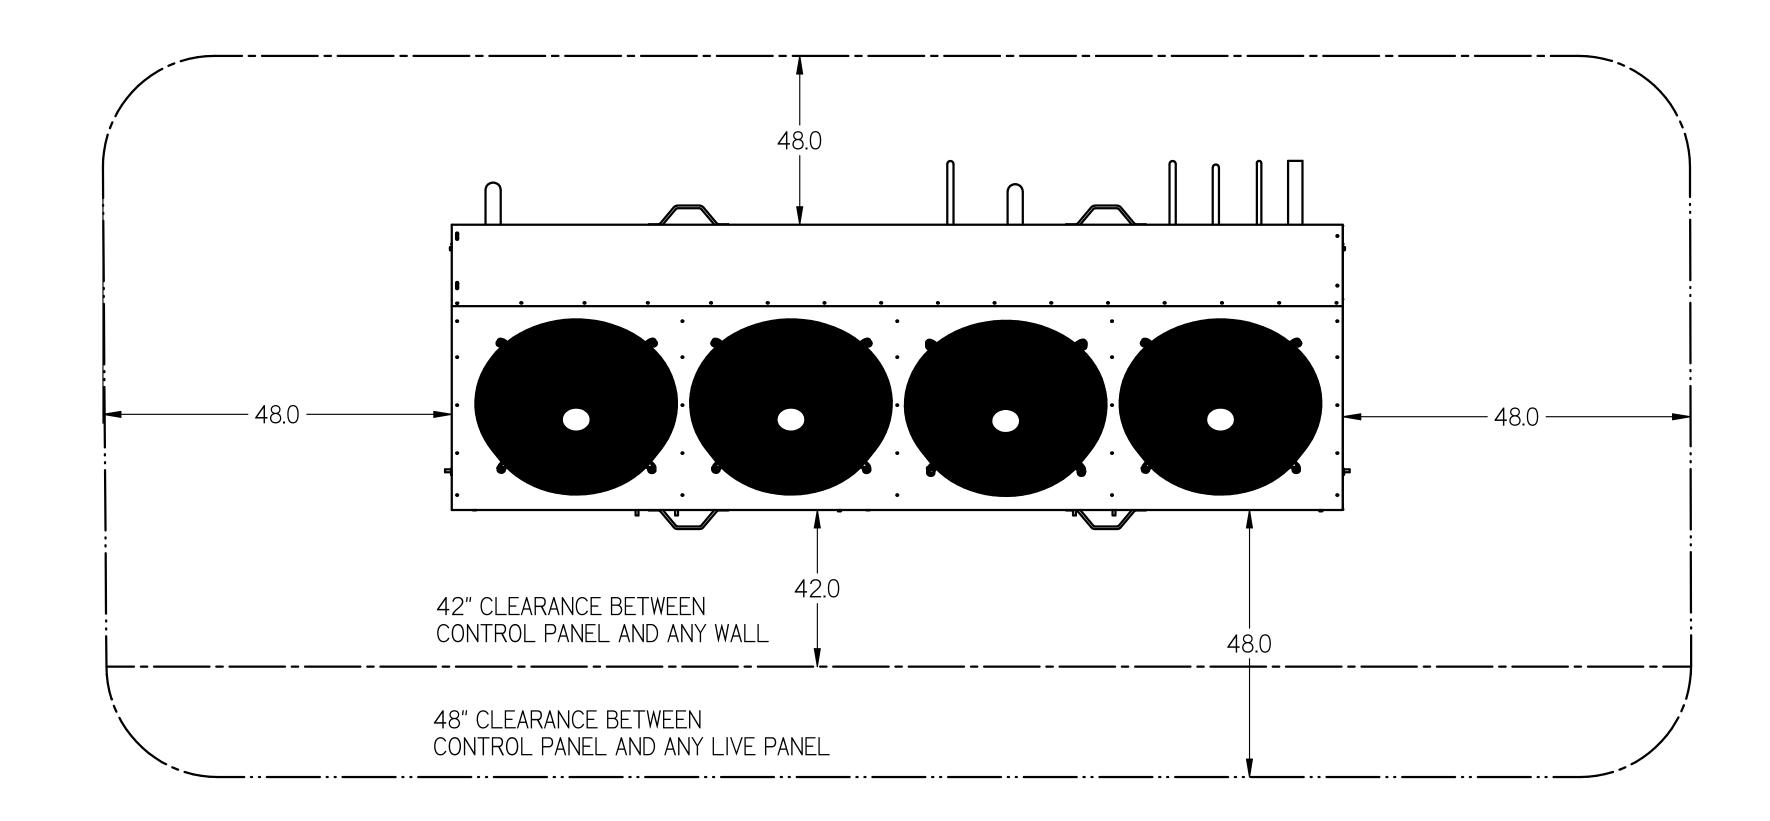

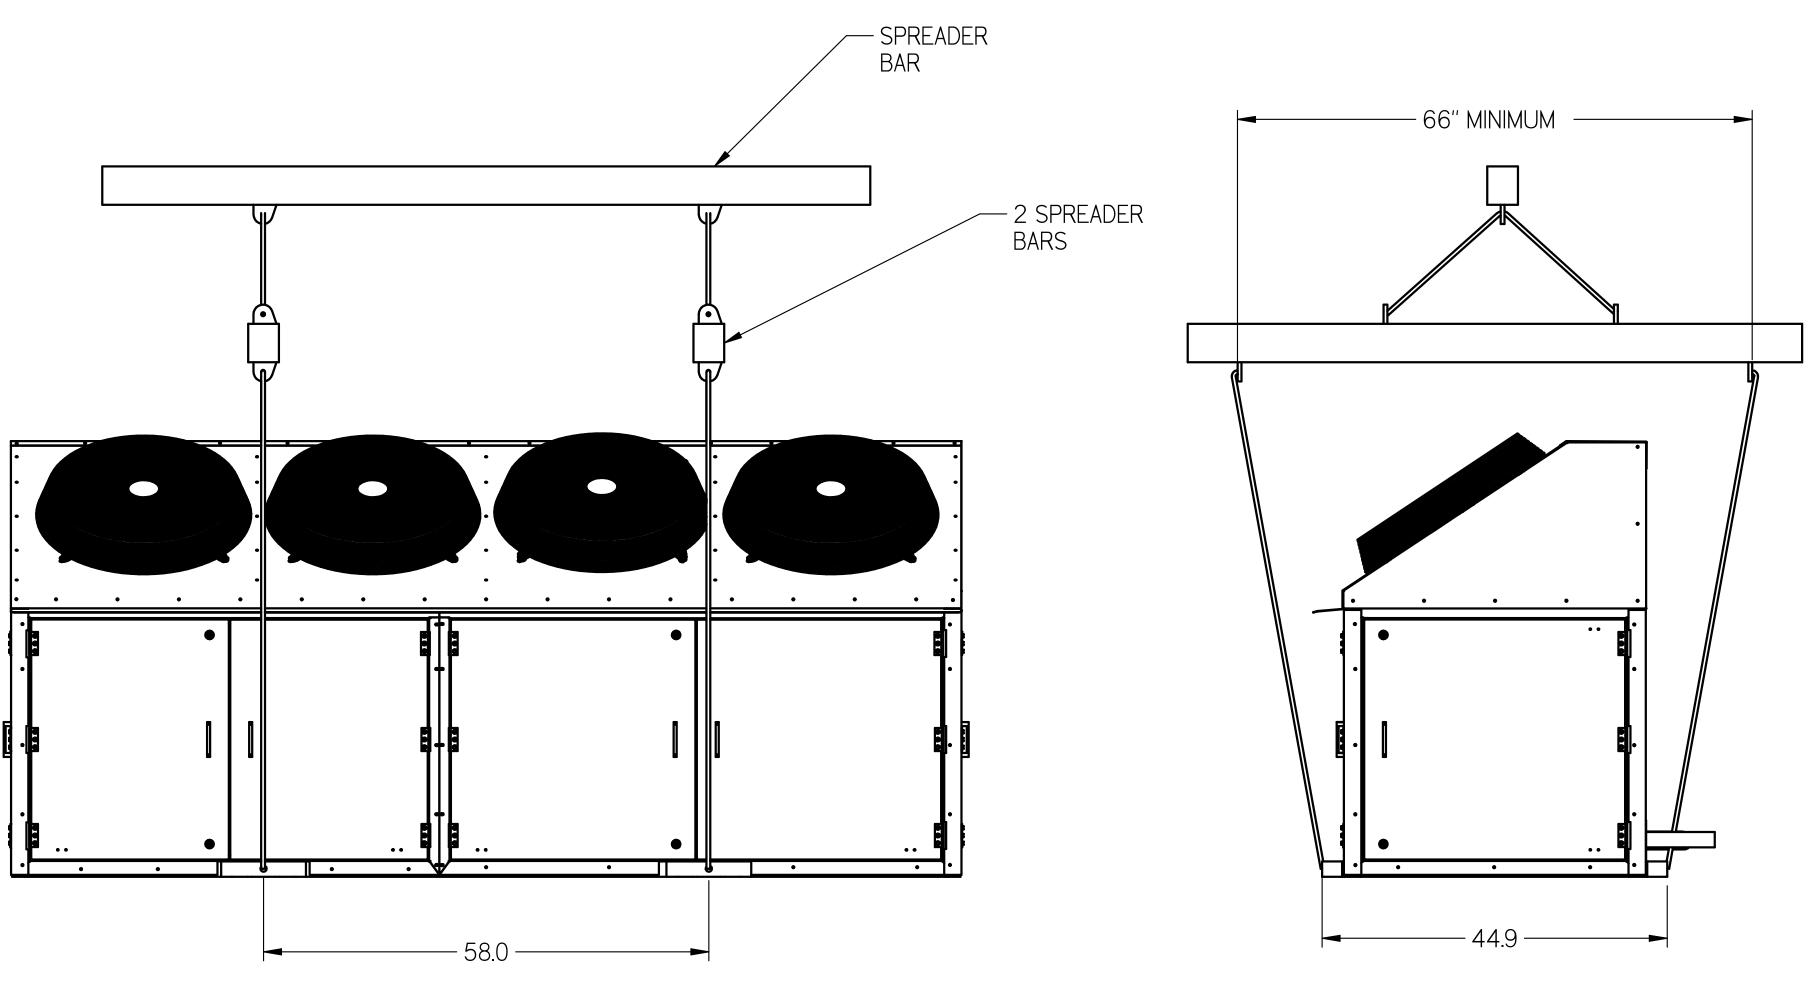

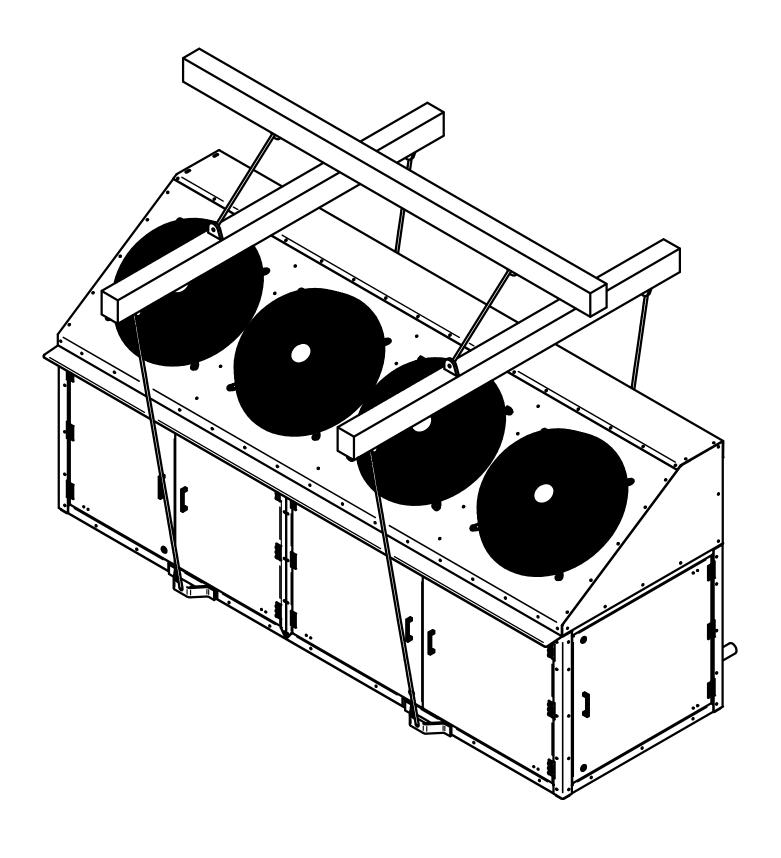

NOTES:


I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.

2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.

3. OVERALL DIMENSIONS: 125.5 L X 53.0 W X 57.5 H

INFORMATION SUBJECT TO CHANGE

HUSSMANN DIMENSIONS ARE IN INCHES.



DATE DRAWN: 2017/09/14

4-FAN PROTOAIRE WITH HINGED DOORS