

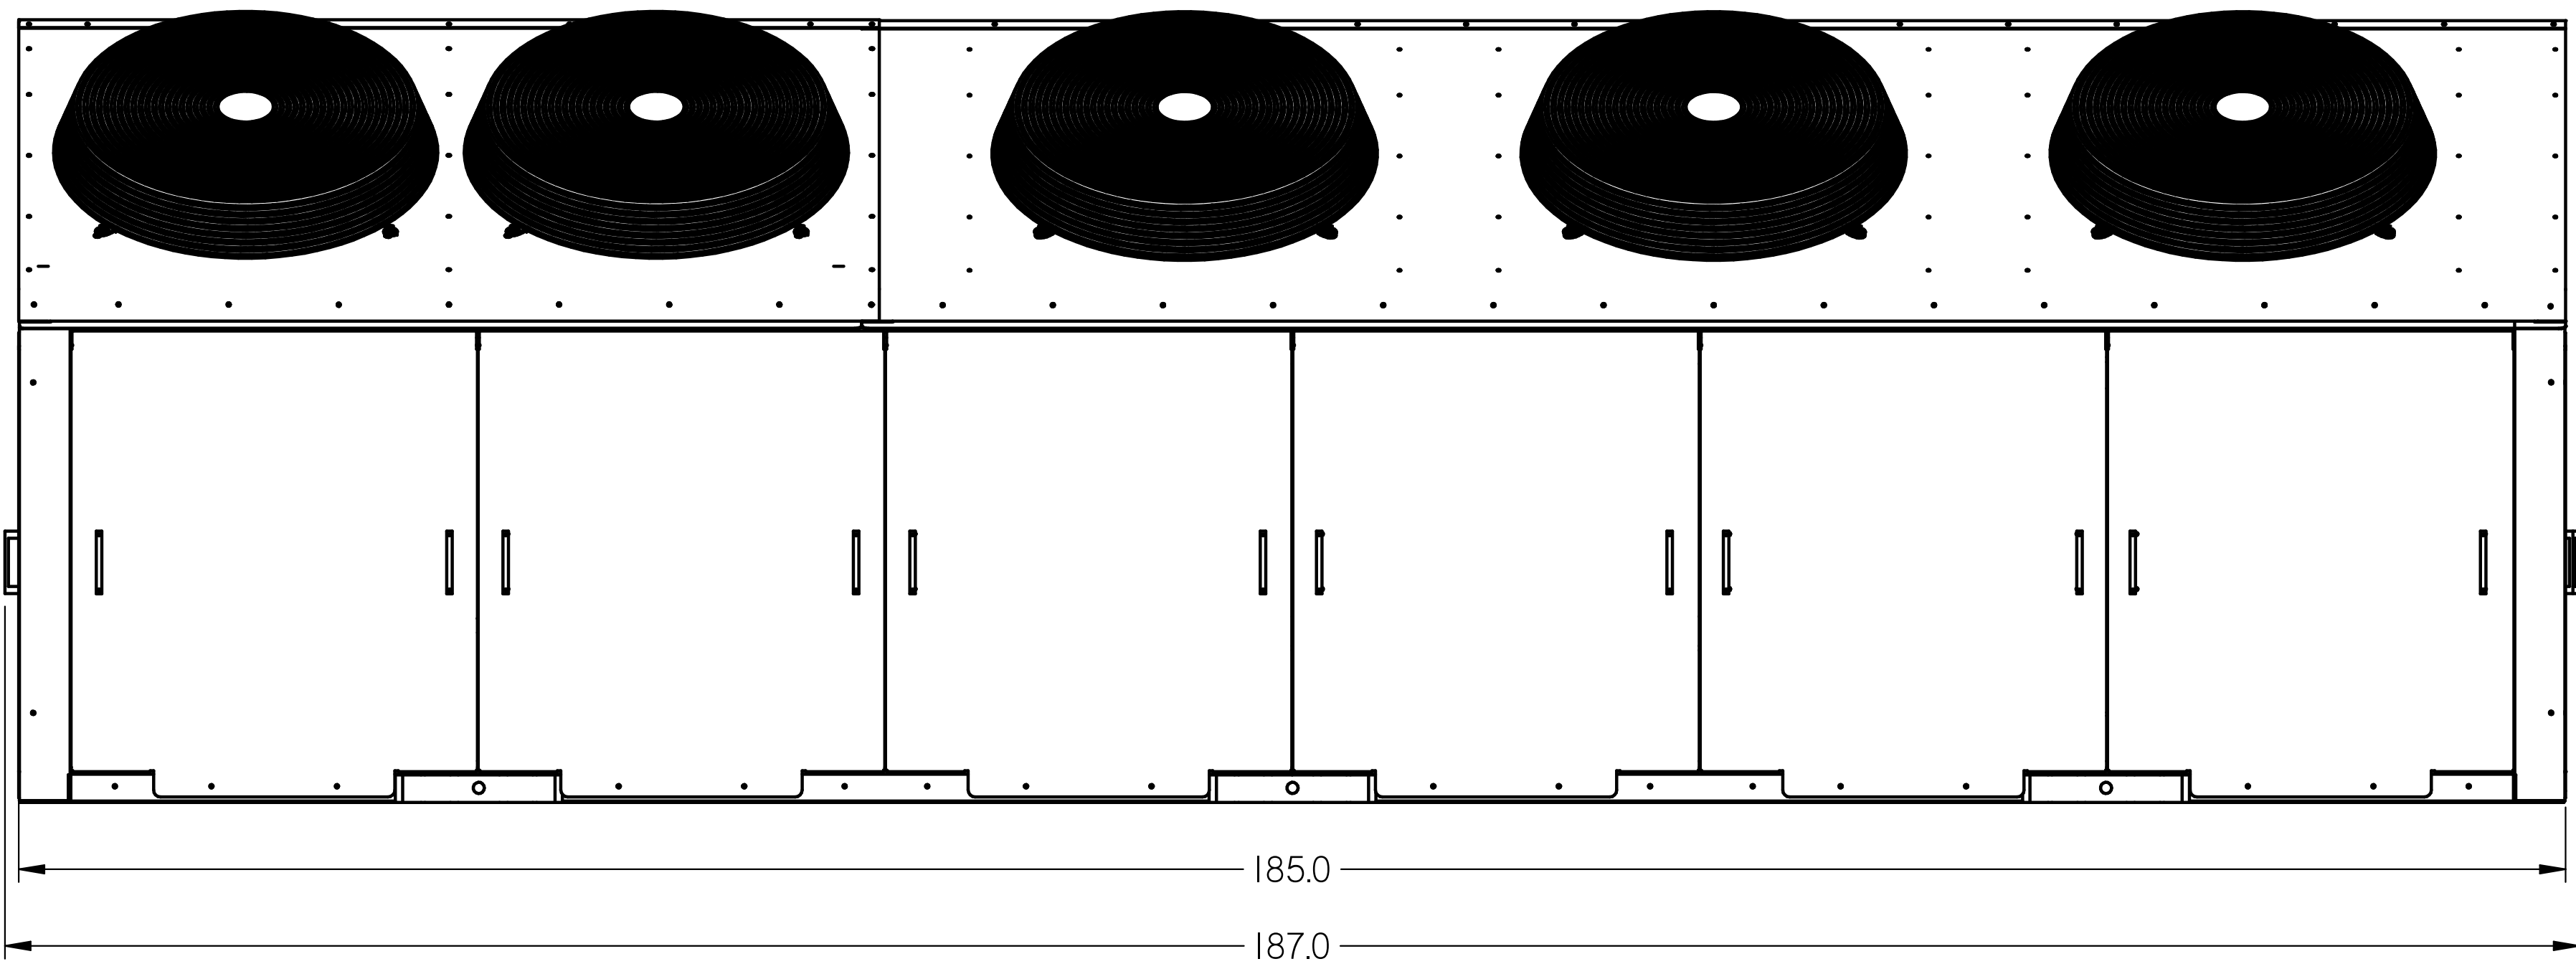
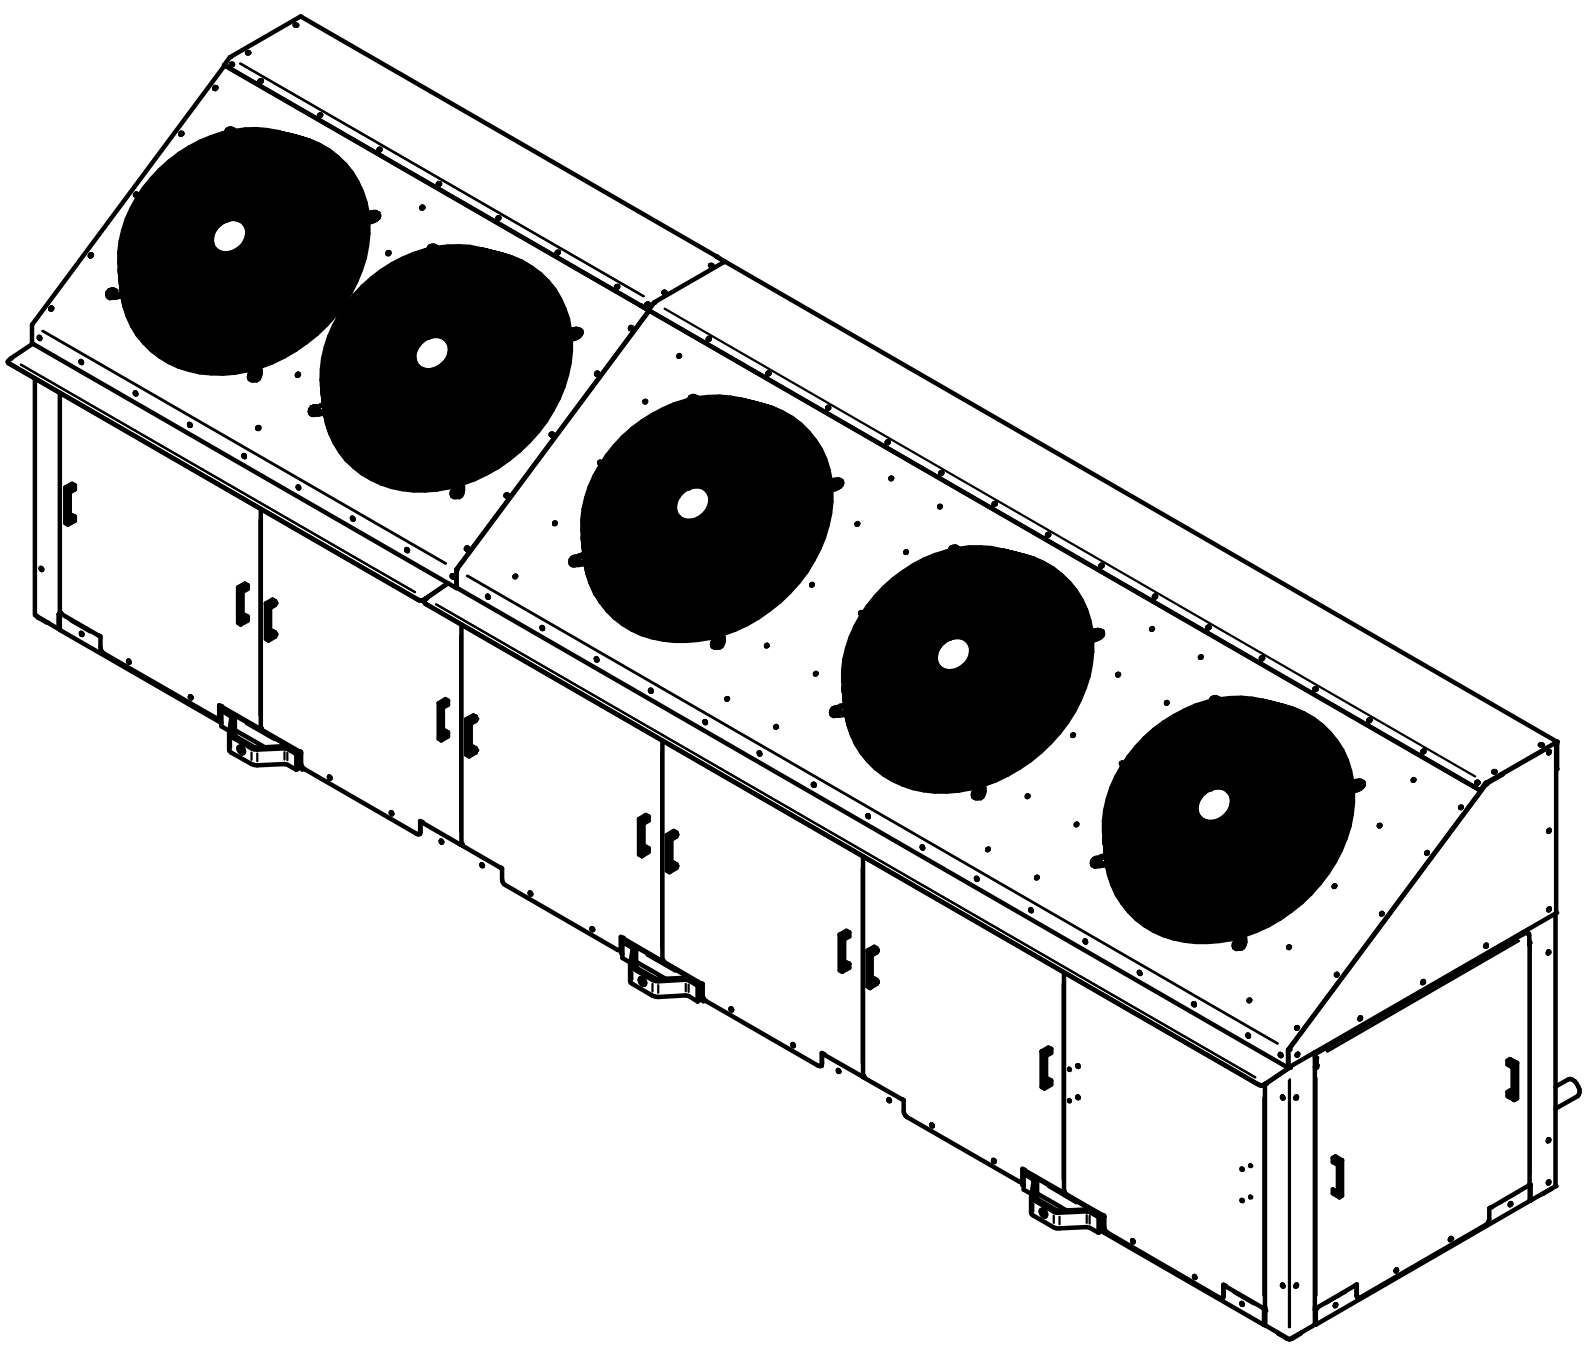


SEE SHEET 3 FOR MINIMUM CLEARANCE REQUIREMENTS

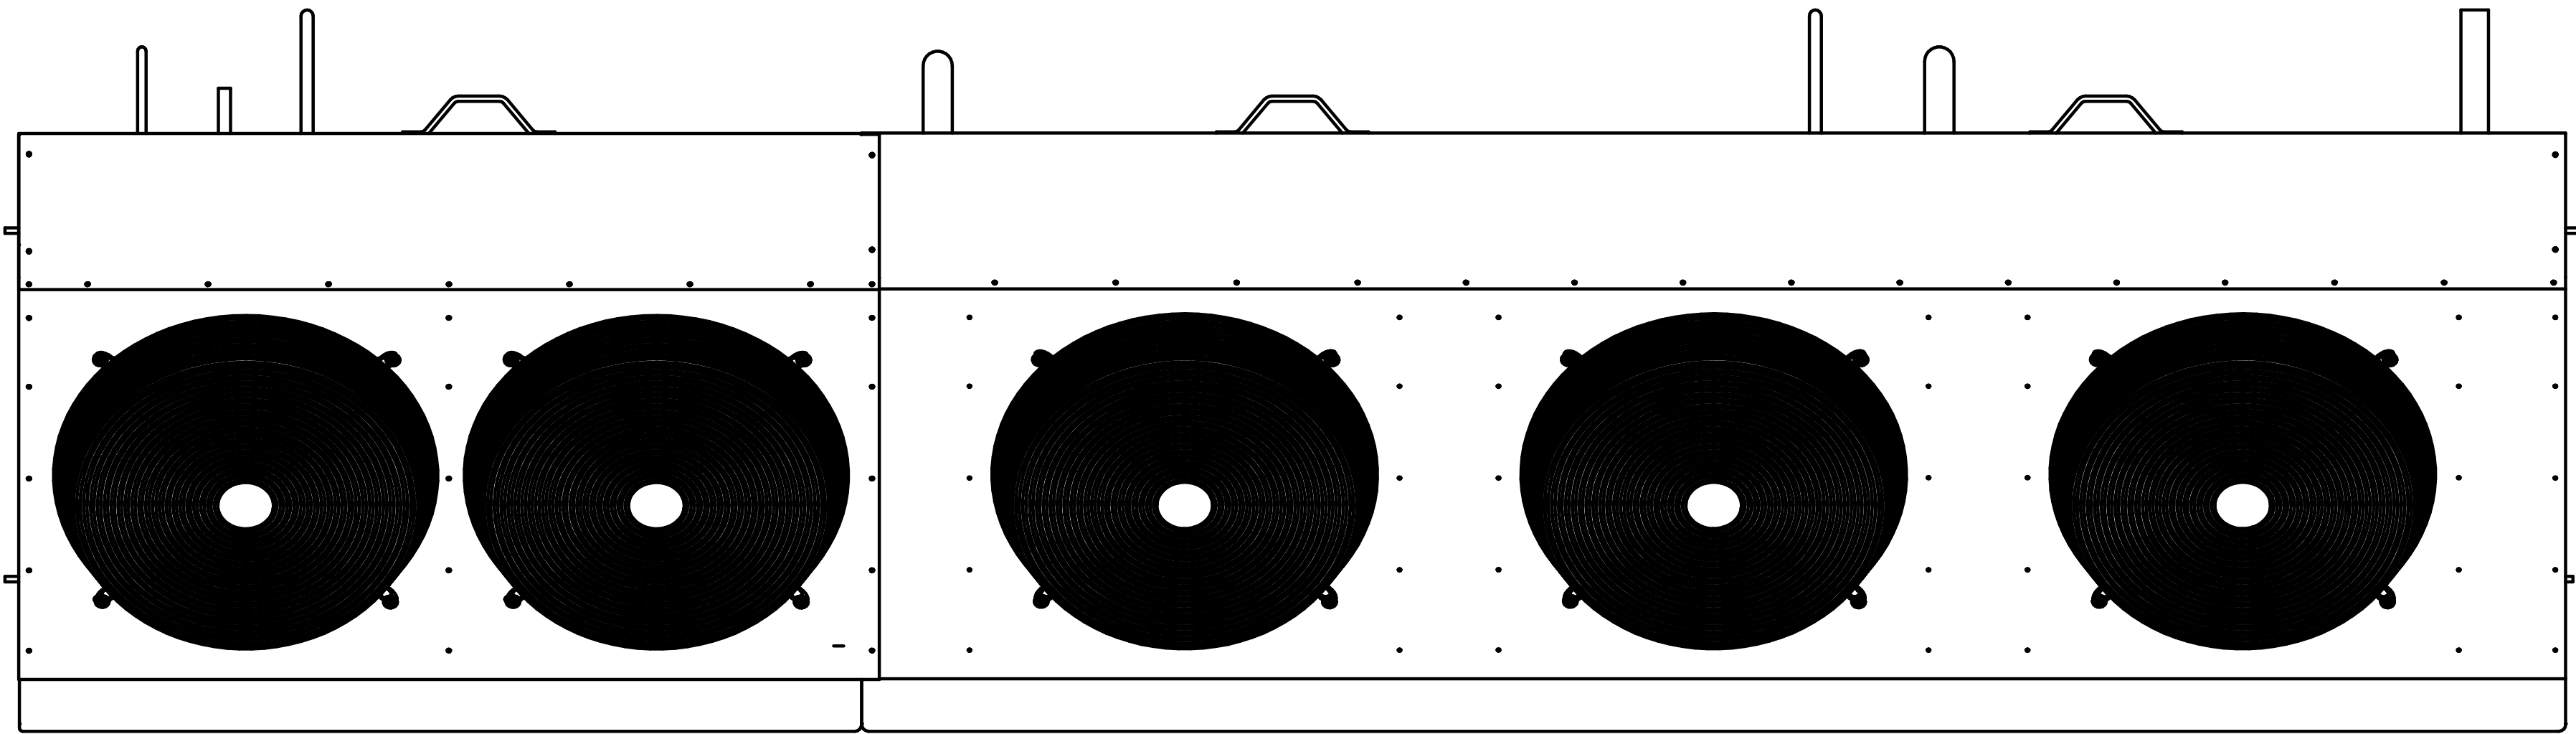

PULL-OFF ACCESS
PANELS (3 SIDES)
WEIGHT OF EACH ACCESS
PANEL IS APPROX. 20 lbs.

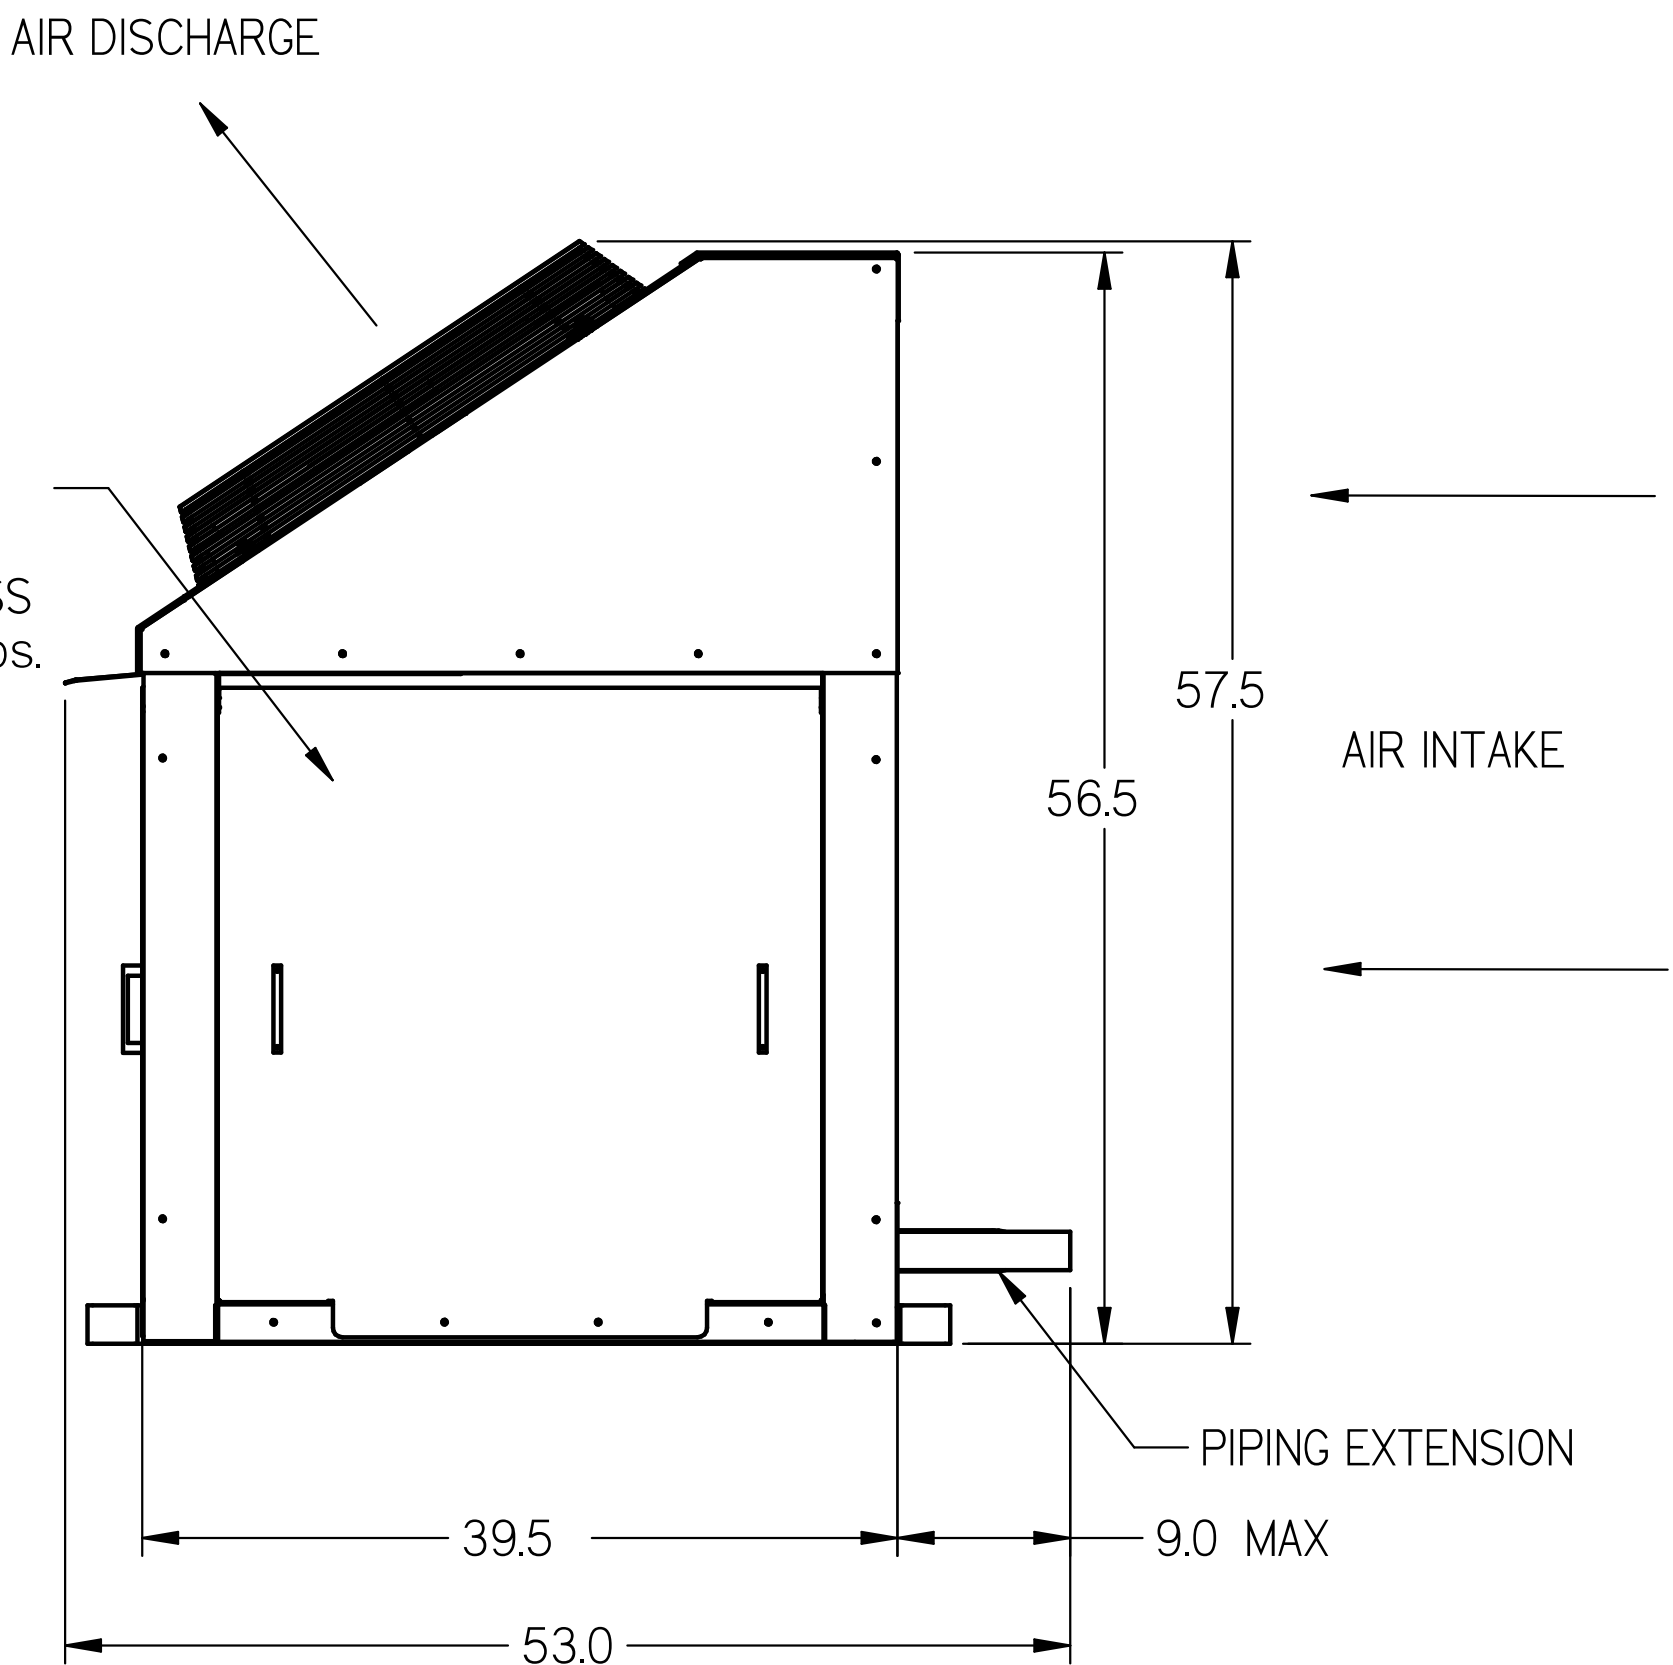

RECEIVER SIZES SHOWN ARE BASED UPON 80% CAPACITY



MAXIMUM TOTAL UNIT WEIGHT (POUNDS)	SHIPPING	OPERATING
145 POUND RECEIVER	3309	3534
OPTIONAL 200 POUND RECEIVER	3332	3577

- NOTES:
- IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
 - ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
 - OVERALL DIMENSIONS: 187.0 L X 53.0 W X 57.5 H

INFORMATION SUBJECT TO CHANGE

DIMENSIONS ARE IN INCHES. DATE DRAWN: 2017/09/14		HUSSmann [®] 5-FAN PROTOAIRE WITH PULL OFF PANELS
THIRD ANGLE PROJECTION		
SHEET 1 OF 3		DOC PD-000000084 REV B

SWN 1.0 SUBMITTAL SHEET SIZE D

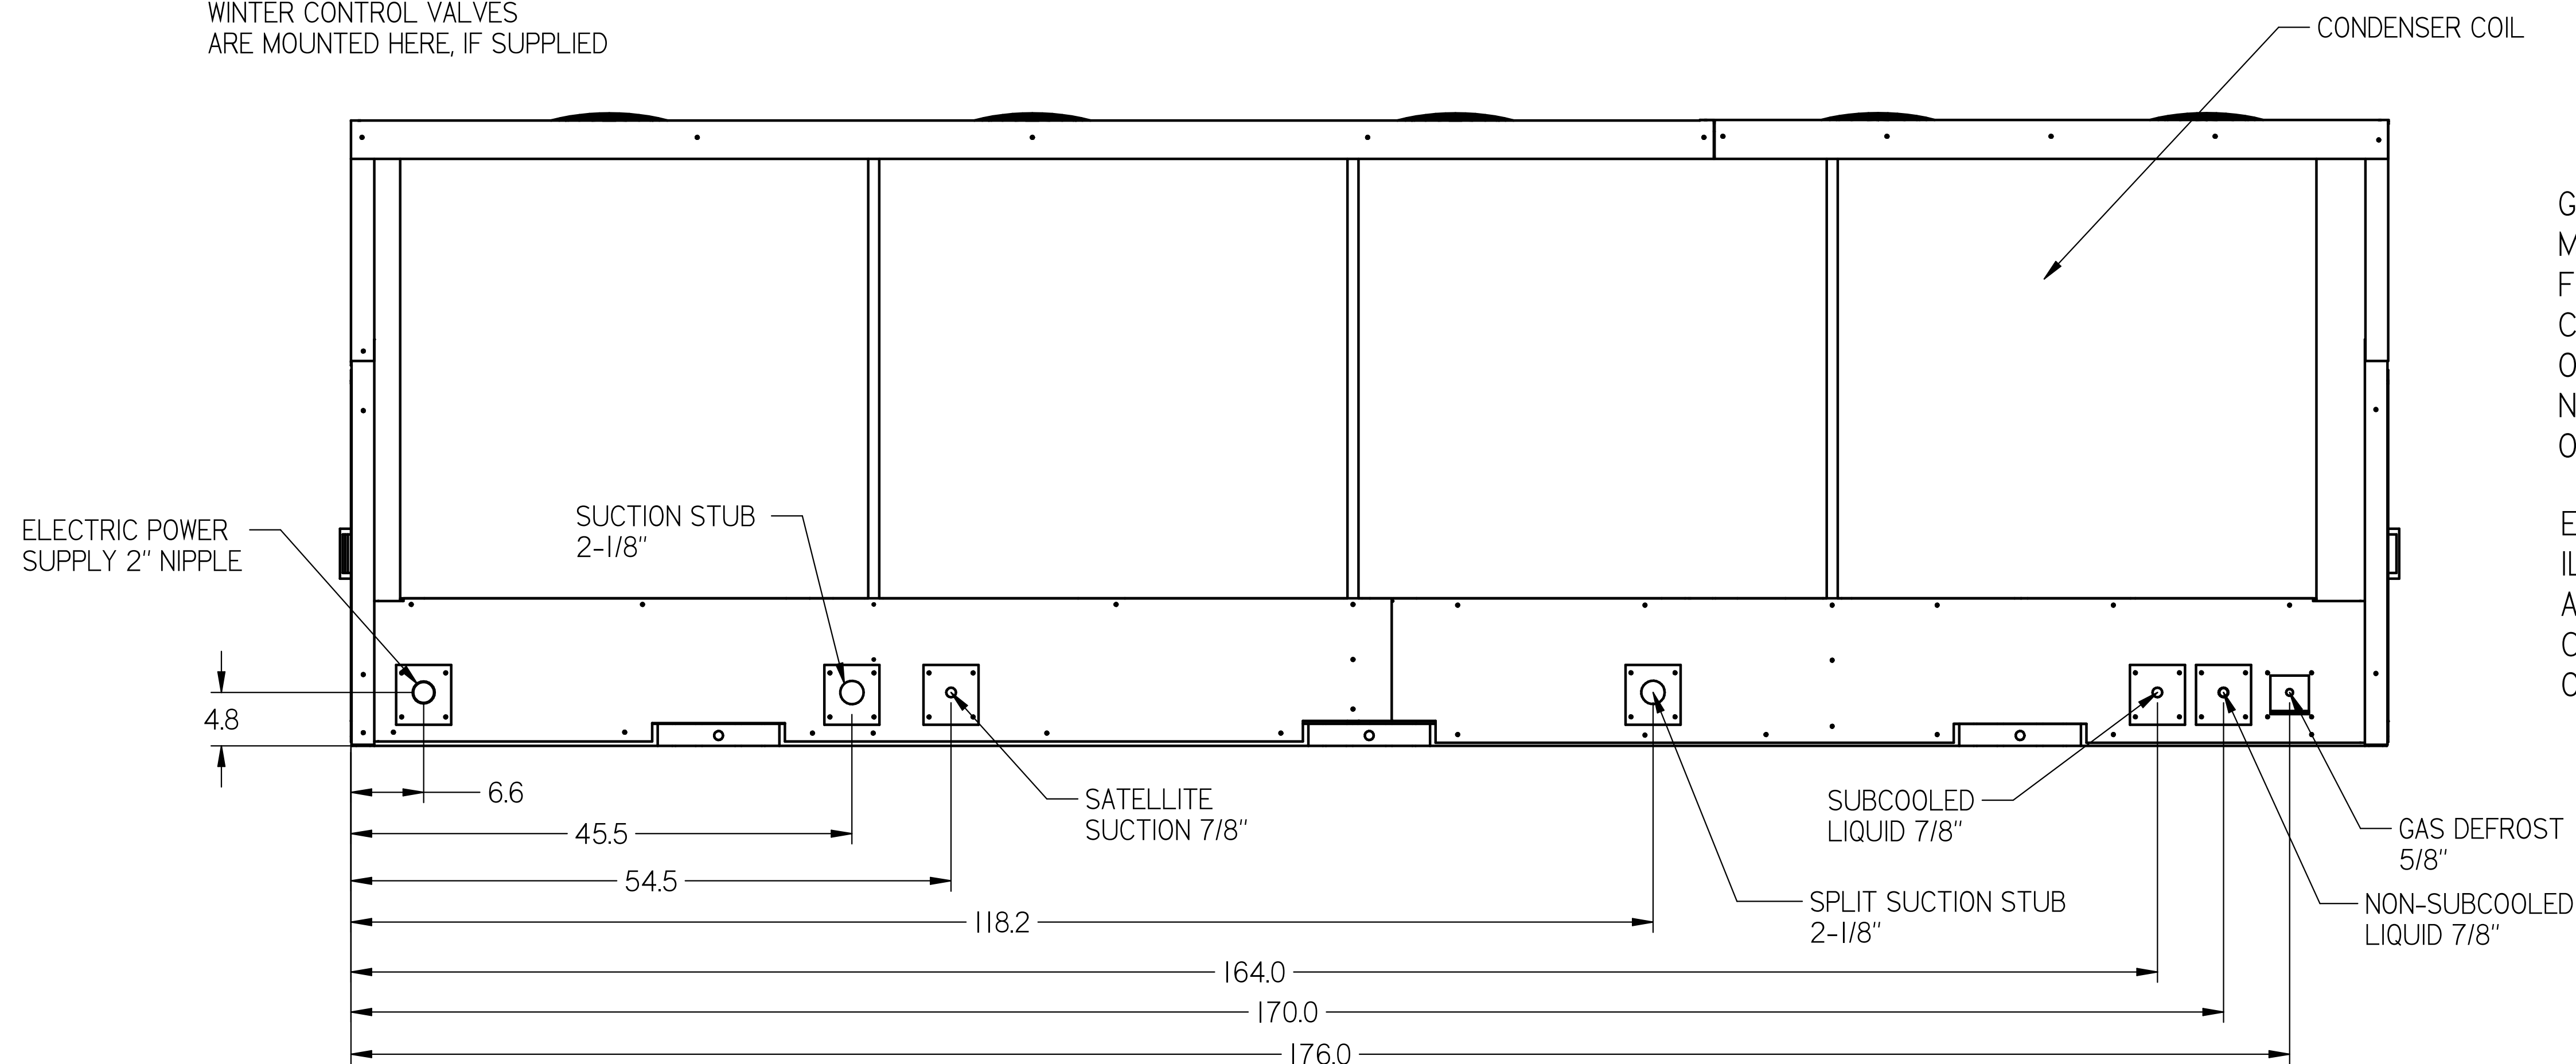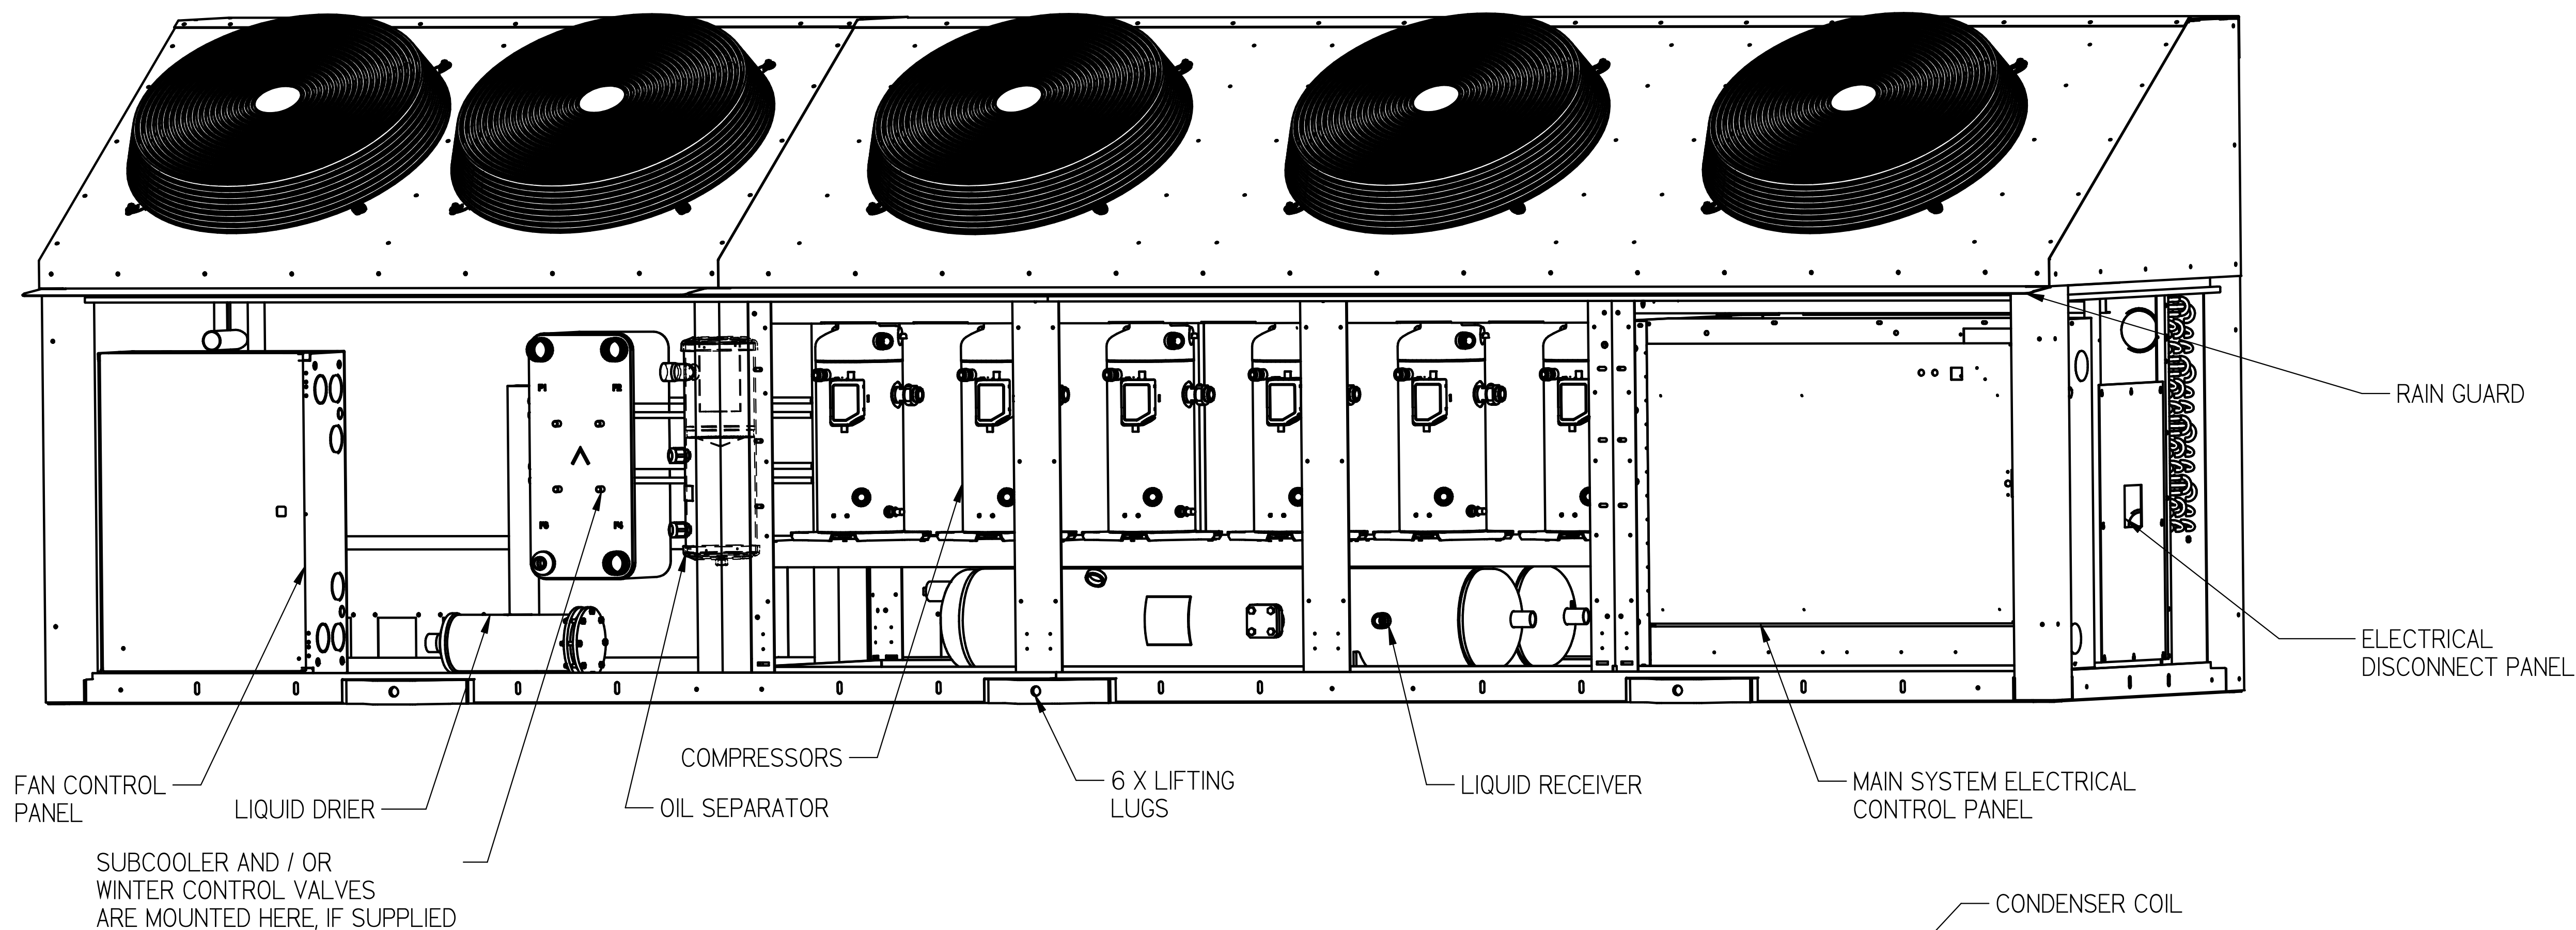

GENERAL UNIT SPECIFICATIONS :
 MATERIAL : GALVANIZED G90U STEEL
 FINISH : POWDER-COATED BEIGE
 CONDENSER COIL : COPPER TUBING, ALUMINUM FINS
 OPTIONAL COIL/FIN COATINGS : ELECTROFIN OR POLYFIN
 NOMINAL FAN SPEED : 1140 RPM
 OPTIONAL VFD AVAILABLE


EACH UNIT ACCOMODATES UPTO SIX COMPRESSORS,
 ILLUSTRATION SHOWN FOR REPRESENTATION ONLY.
 ACTUAL PRODUCT MAY VAY DEPENDING UPON UNIT
 CONFIGURATION.
 OPTIONAL DOOR HOLD-OPEN HARDWARE AVAILABLE

NOTES:

1. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
3. OVERALL DIMENSIONS: 187.0 L X 53.0 W X 57.5 H

INFORMATION SUBJECT TO CHANGE

DIMENSIONS ARE IN INCHES.
 DATE DRAWN: 2017/09/14

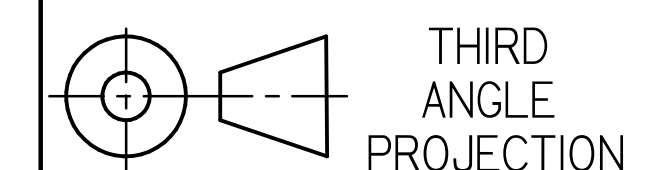

SHEET 2 OF 3

HUSSmann®

5-FAN PROTOAIRE
 WITH PULL OFF
 PANELS

DOC PD-000000084 REV B





SWN 1.0 SUBMITTAL SHEET SIZE D

MINIMUM CLEARANCE REQUIREMENTS:

ACTUAL CLEARANCE REQUIREMENTS ARE DEPENDENT UPON AUTHORITY HAVING JURISDICTION, AND MAY EXCEED DIMENSIONS SHOWN.


PROVIDE CLEARANCES AS SHOWN TO ENSURE ADEQUATE AIRFLOW, REDUCE THE POTENTIAL FOR AIR RECIRCULATION, FACILITATE SERVICE ACCESSIBILITY, AND TO MAINTAIN COMPLIANCE WITH ELECTRICAL CODE REQUIREMENTS

SUGGESTED RIGGING SETUP IS ILLUSTRATED.
BE SURE THAT LIFTING CABLES/STRAPS DO NOT DAMAGE PIPING STUBS, COIL SURFACE, OR RAIN GUARD.
FULL PERIMETER SUPPORT FOUNDATION REQUIRED

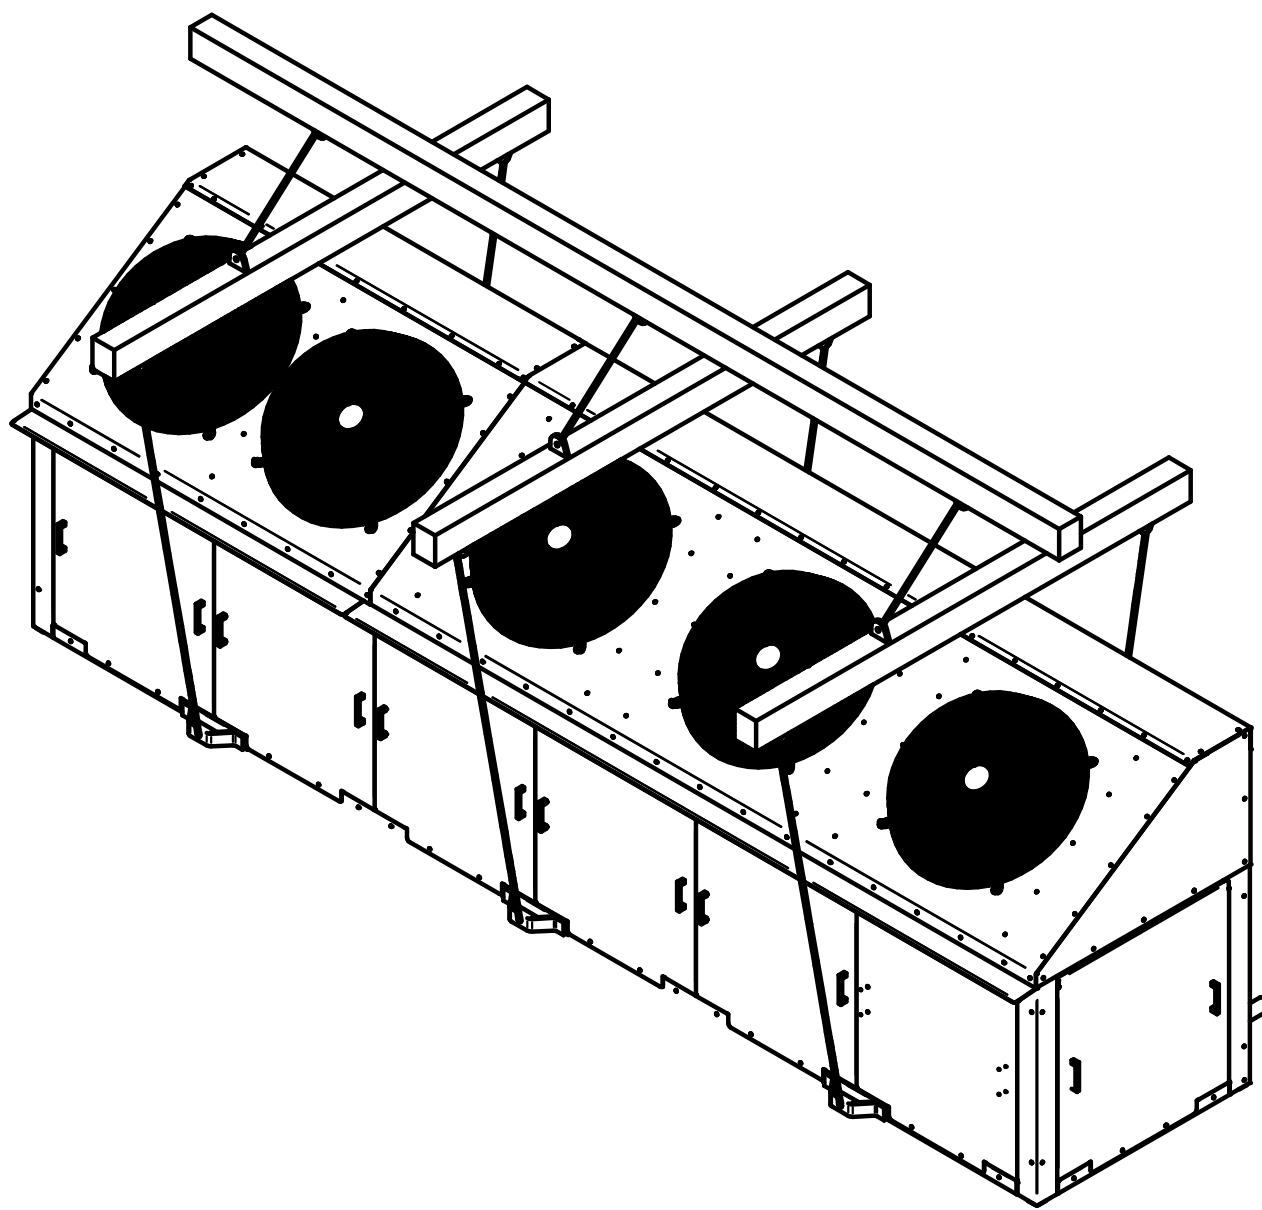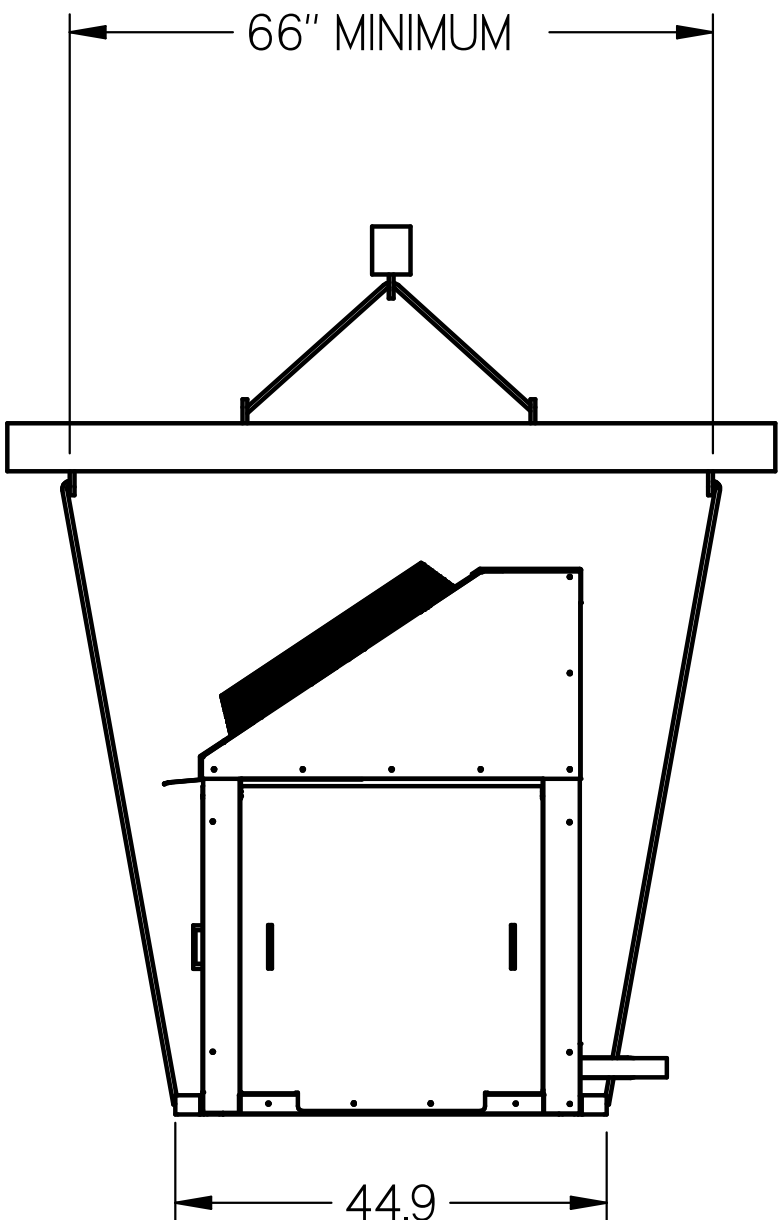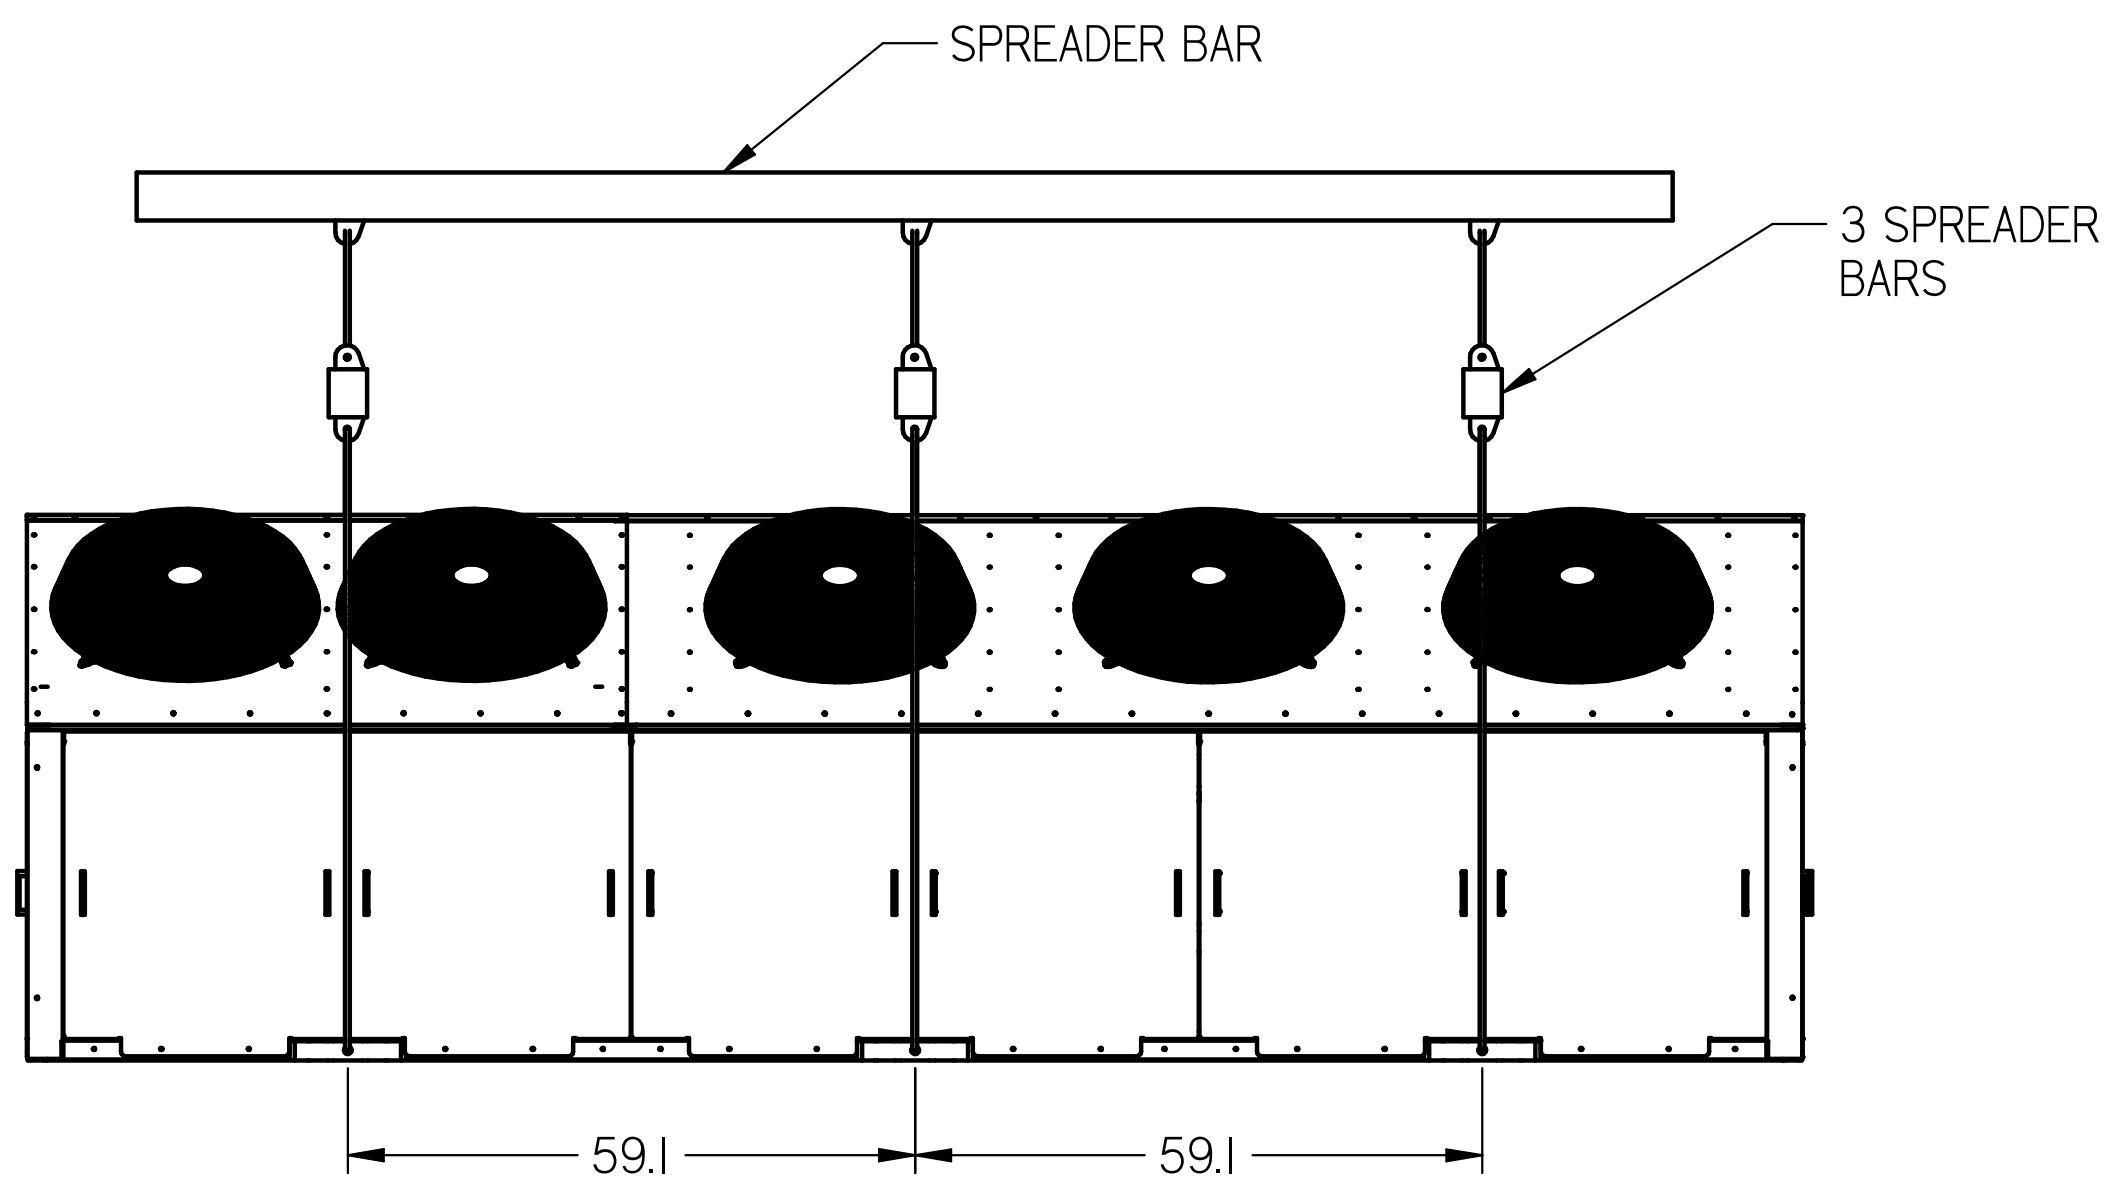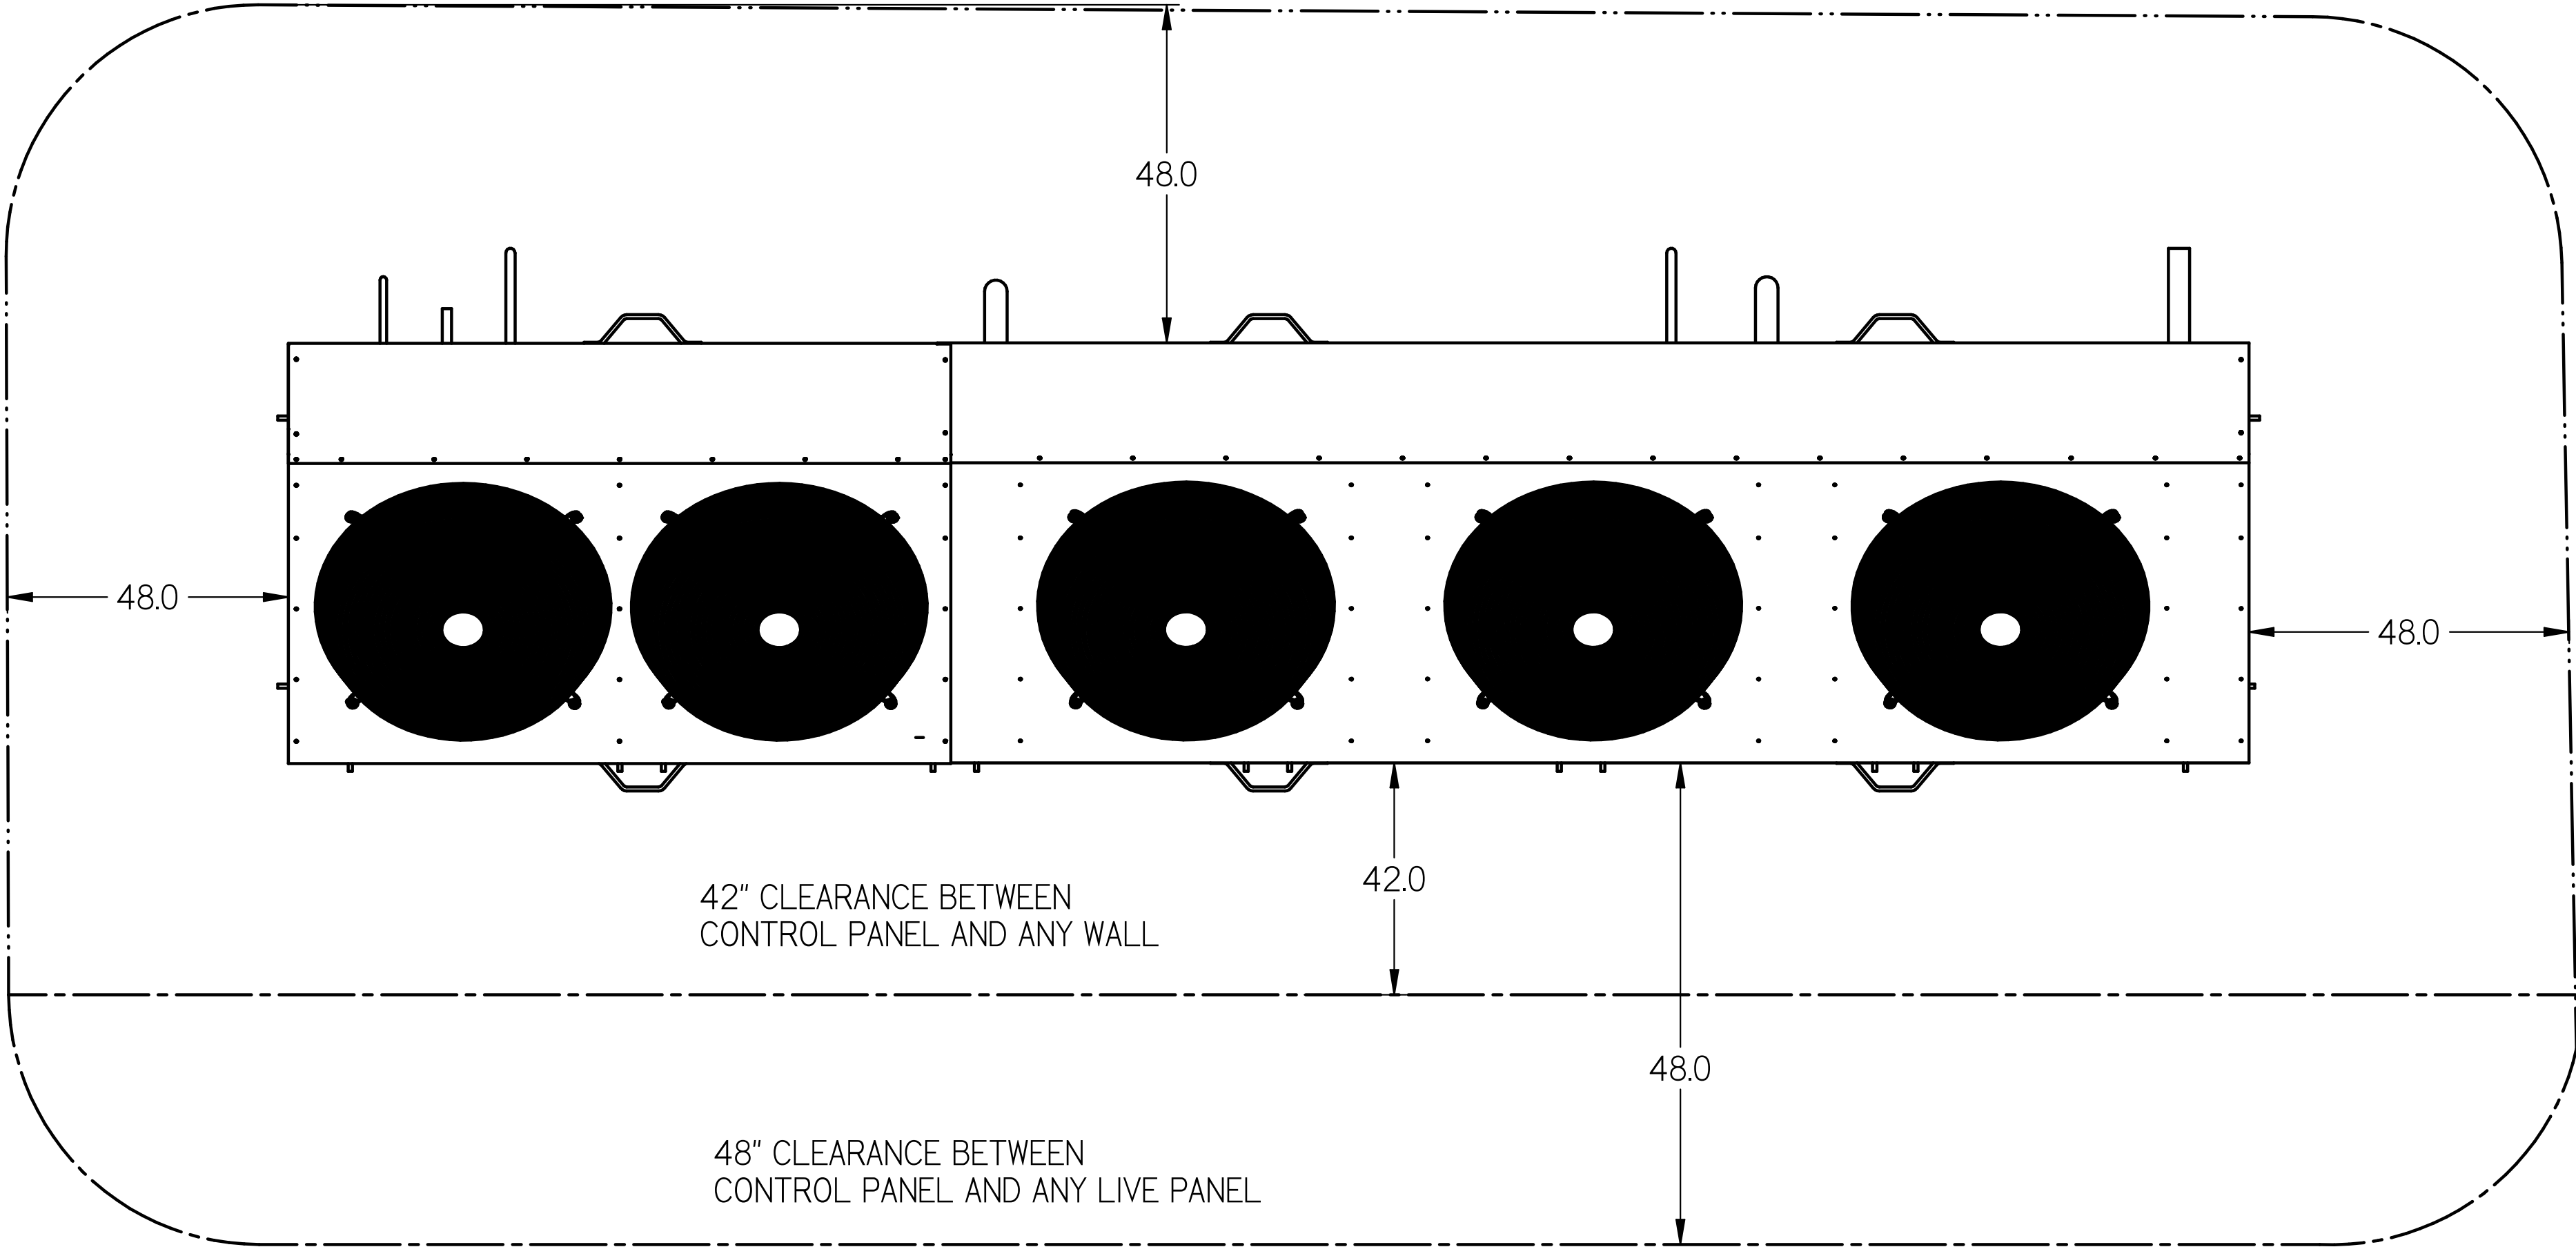

- NOTES:
1. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
 3. OVERALL DIMENSIONS: 187.0 L X 53.0 W X 57.5 H

INFORMATION SUBJECT TO CHANGE

DIMENSIONS ARE IN INCHES. DATE DRAWN: 2017/09/14		HUSSmann®	
 THIRD ANGLE PROJECTION		5-FAN PROTOAIRE WITH PULL OFF PANELS	
SHEET 3 OF 3		DOC PD-000000084	REV B

SWN 1.0 SUBMITTAL SHEET SIZE D