
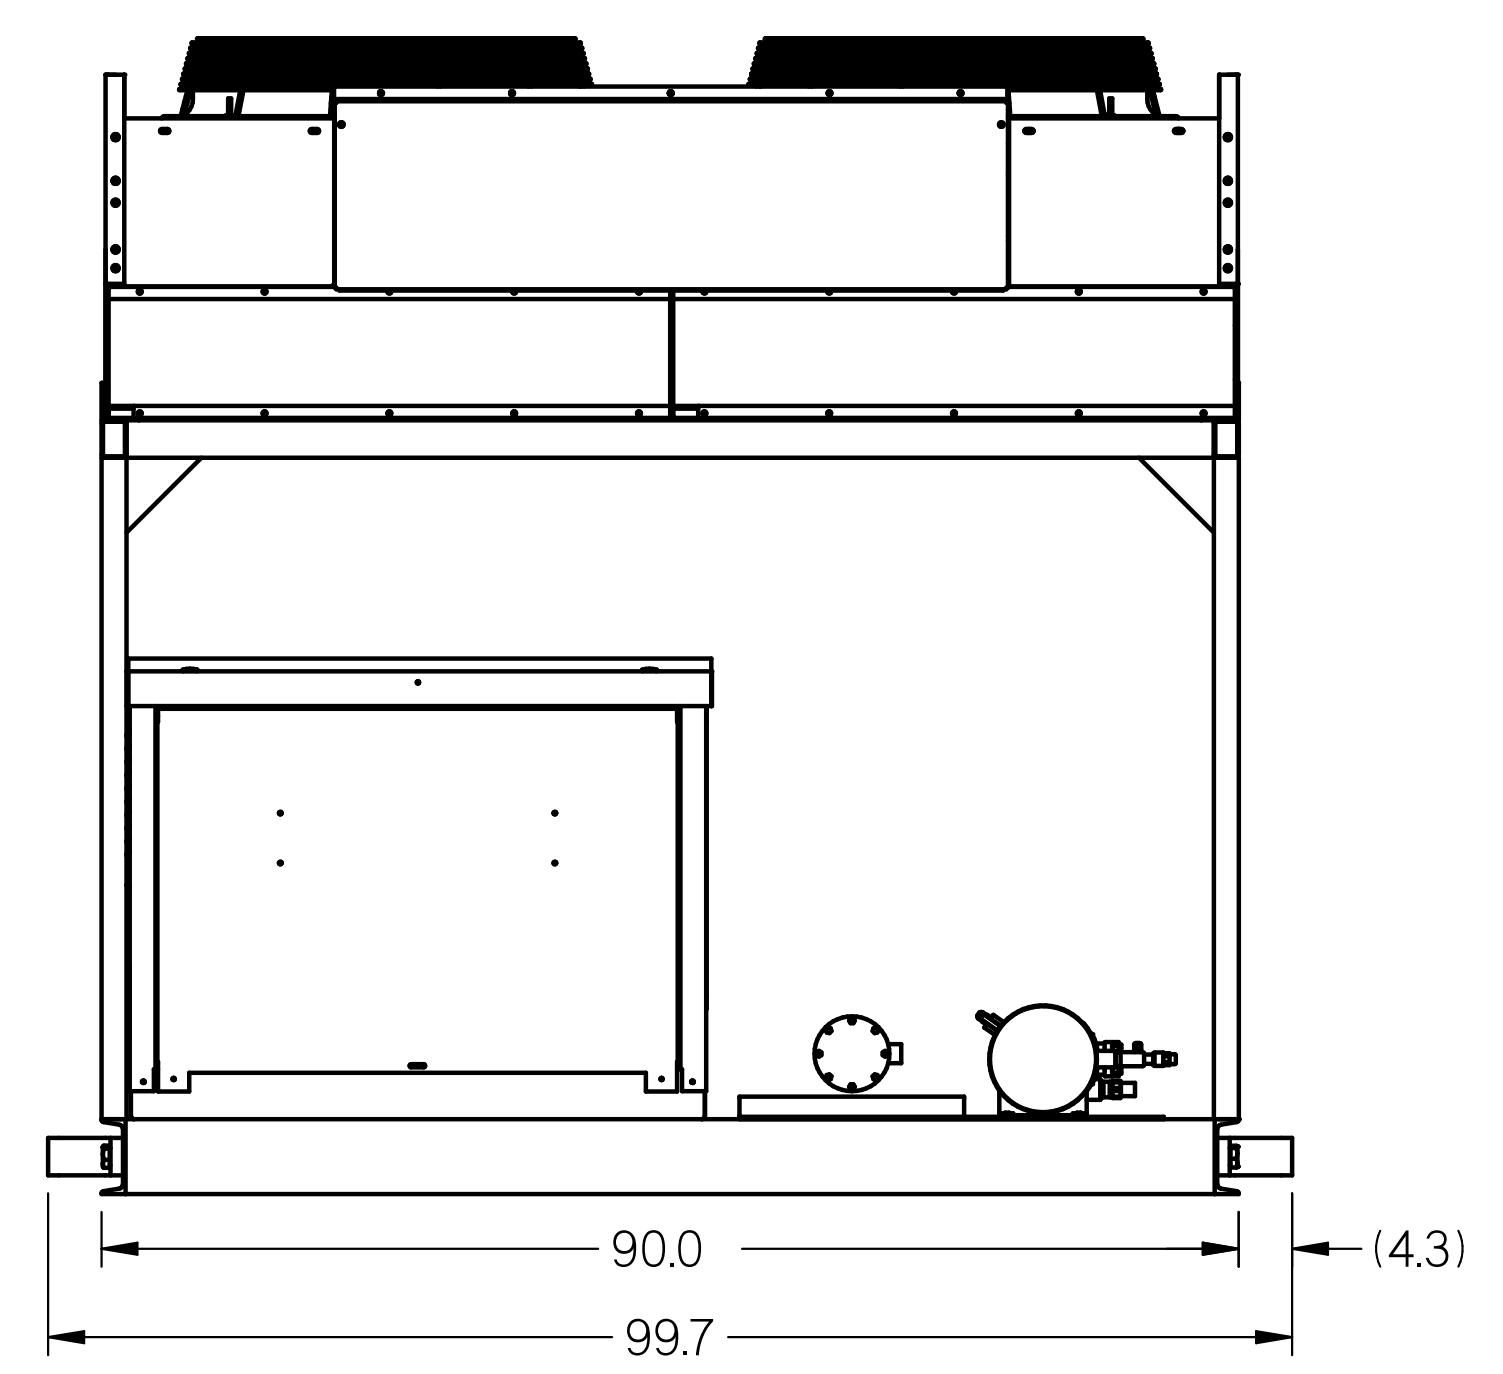
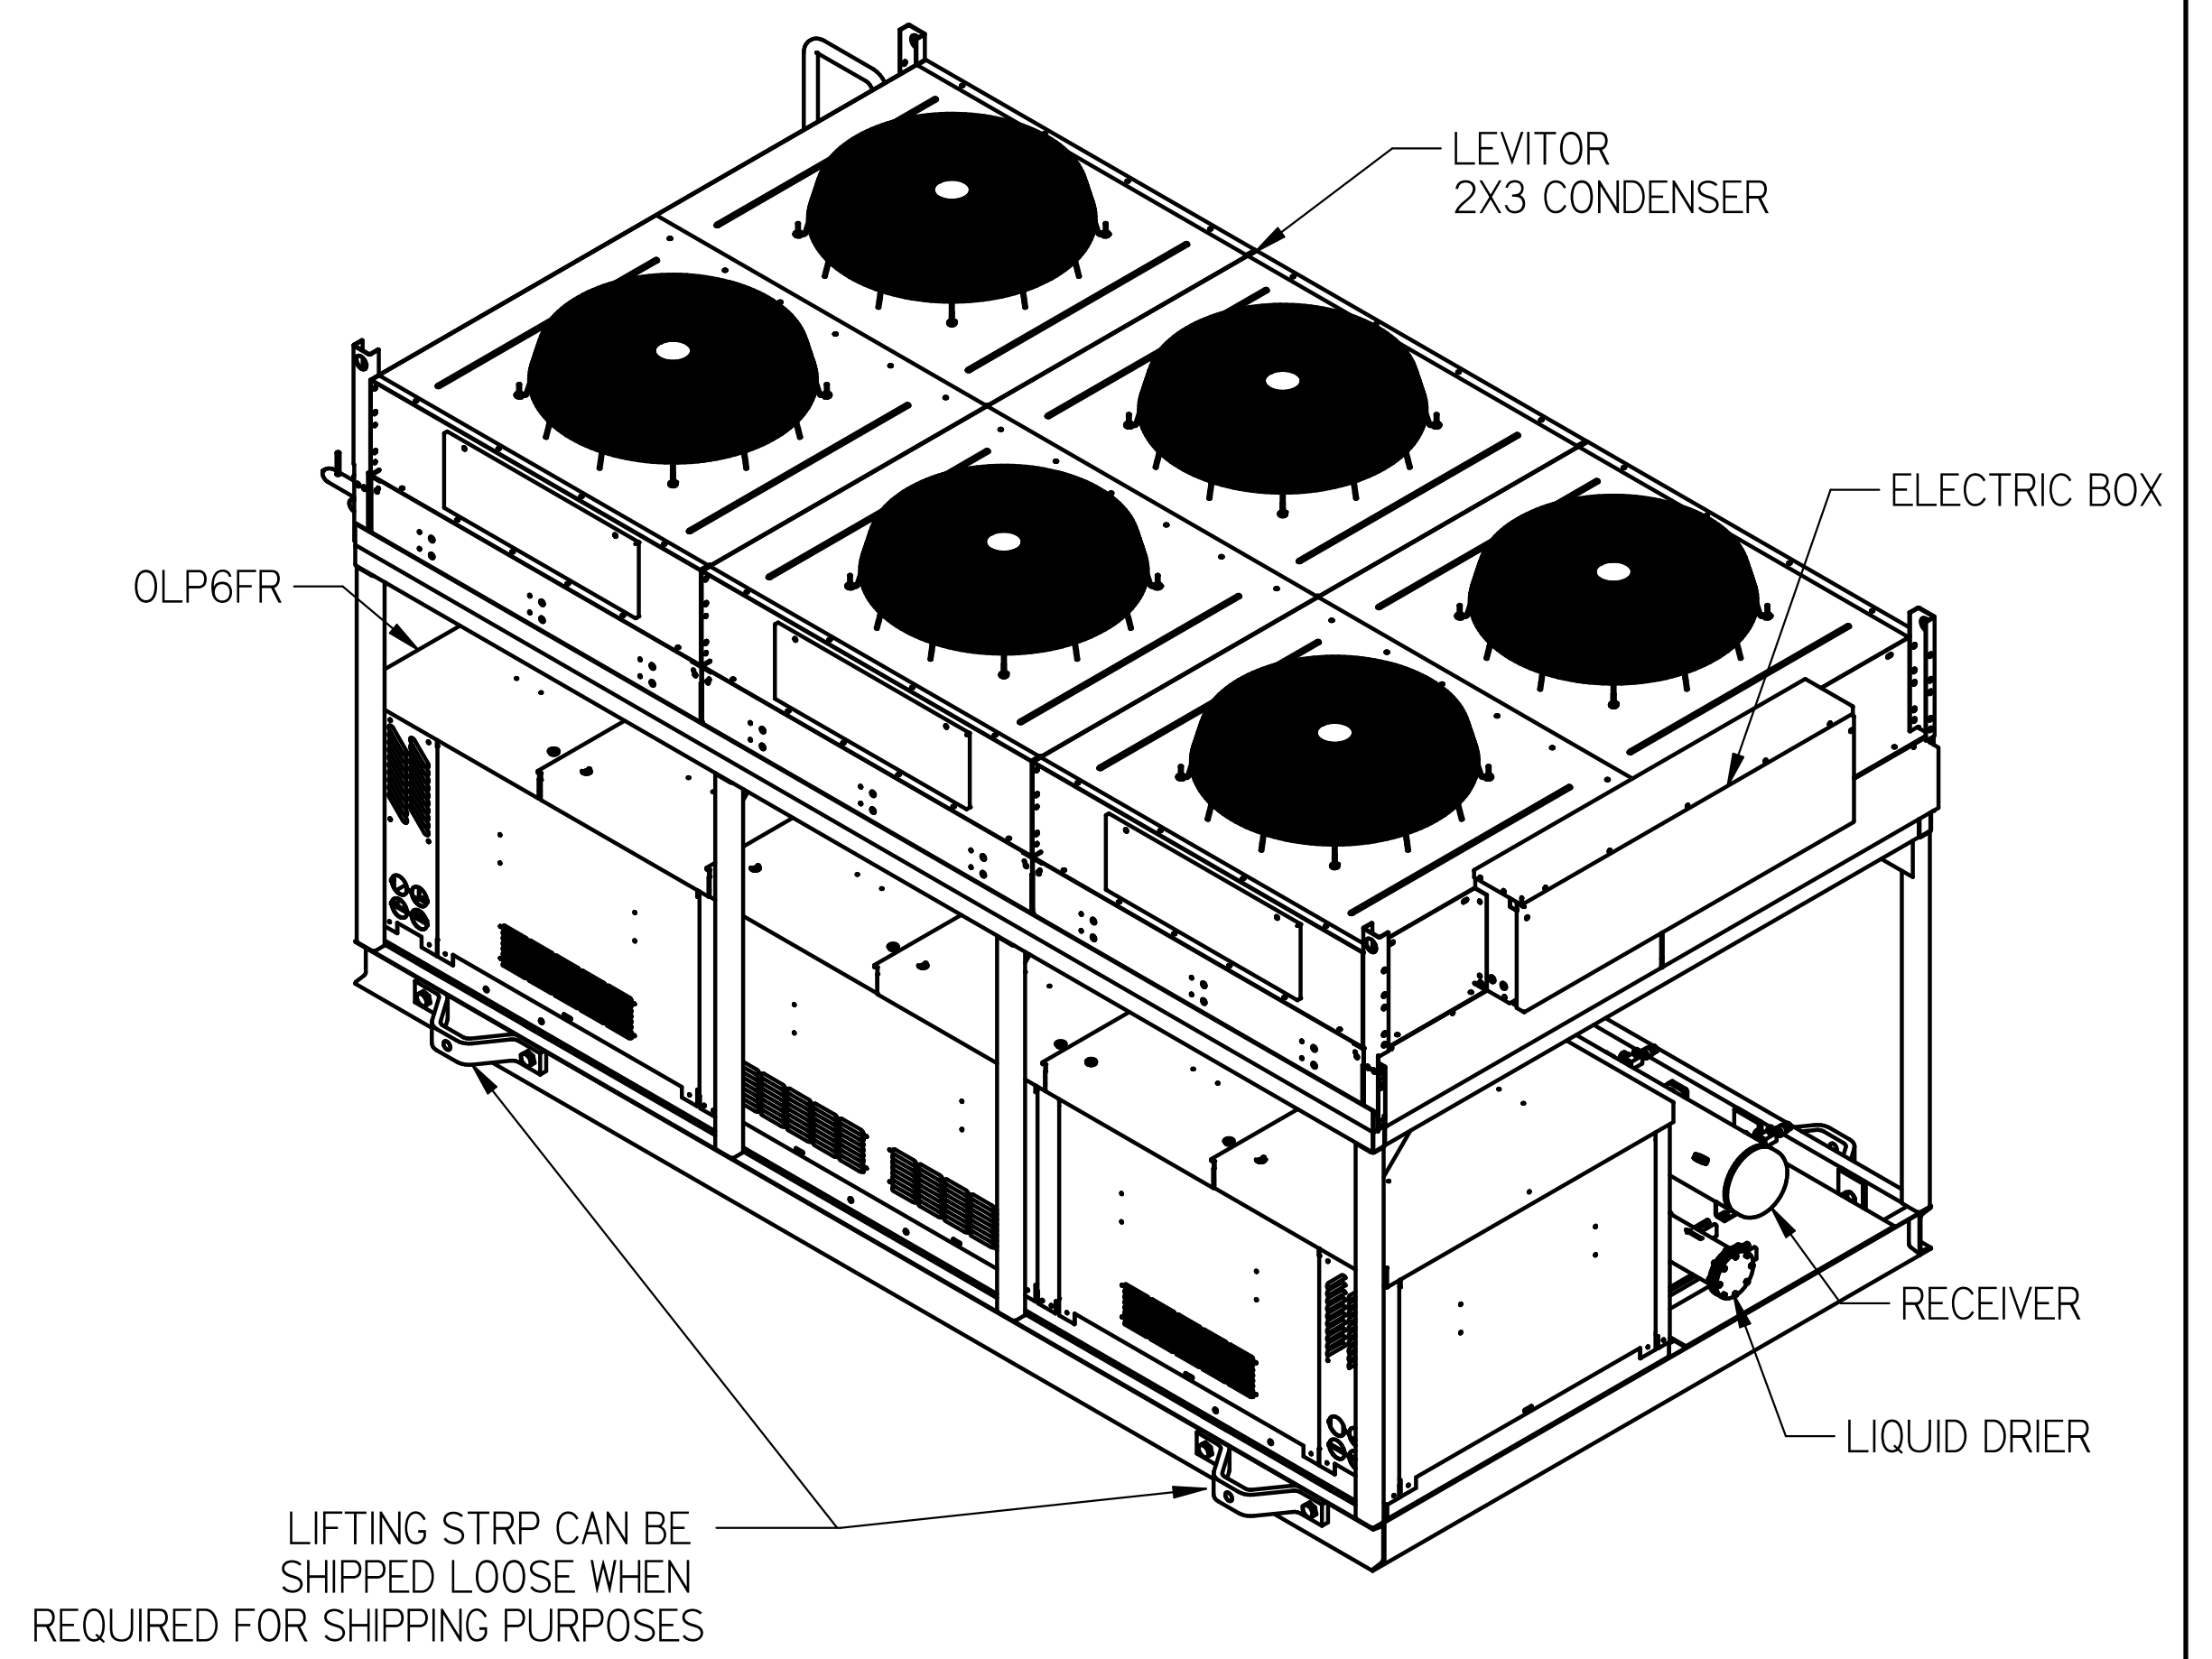
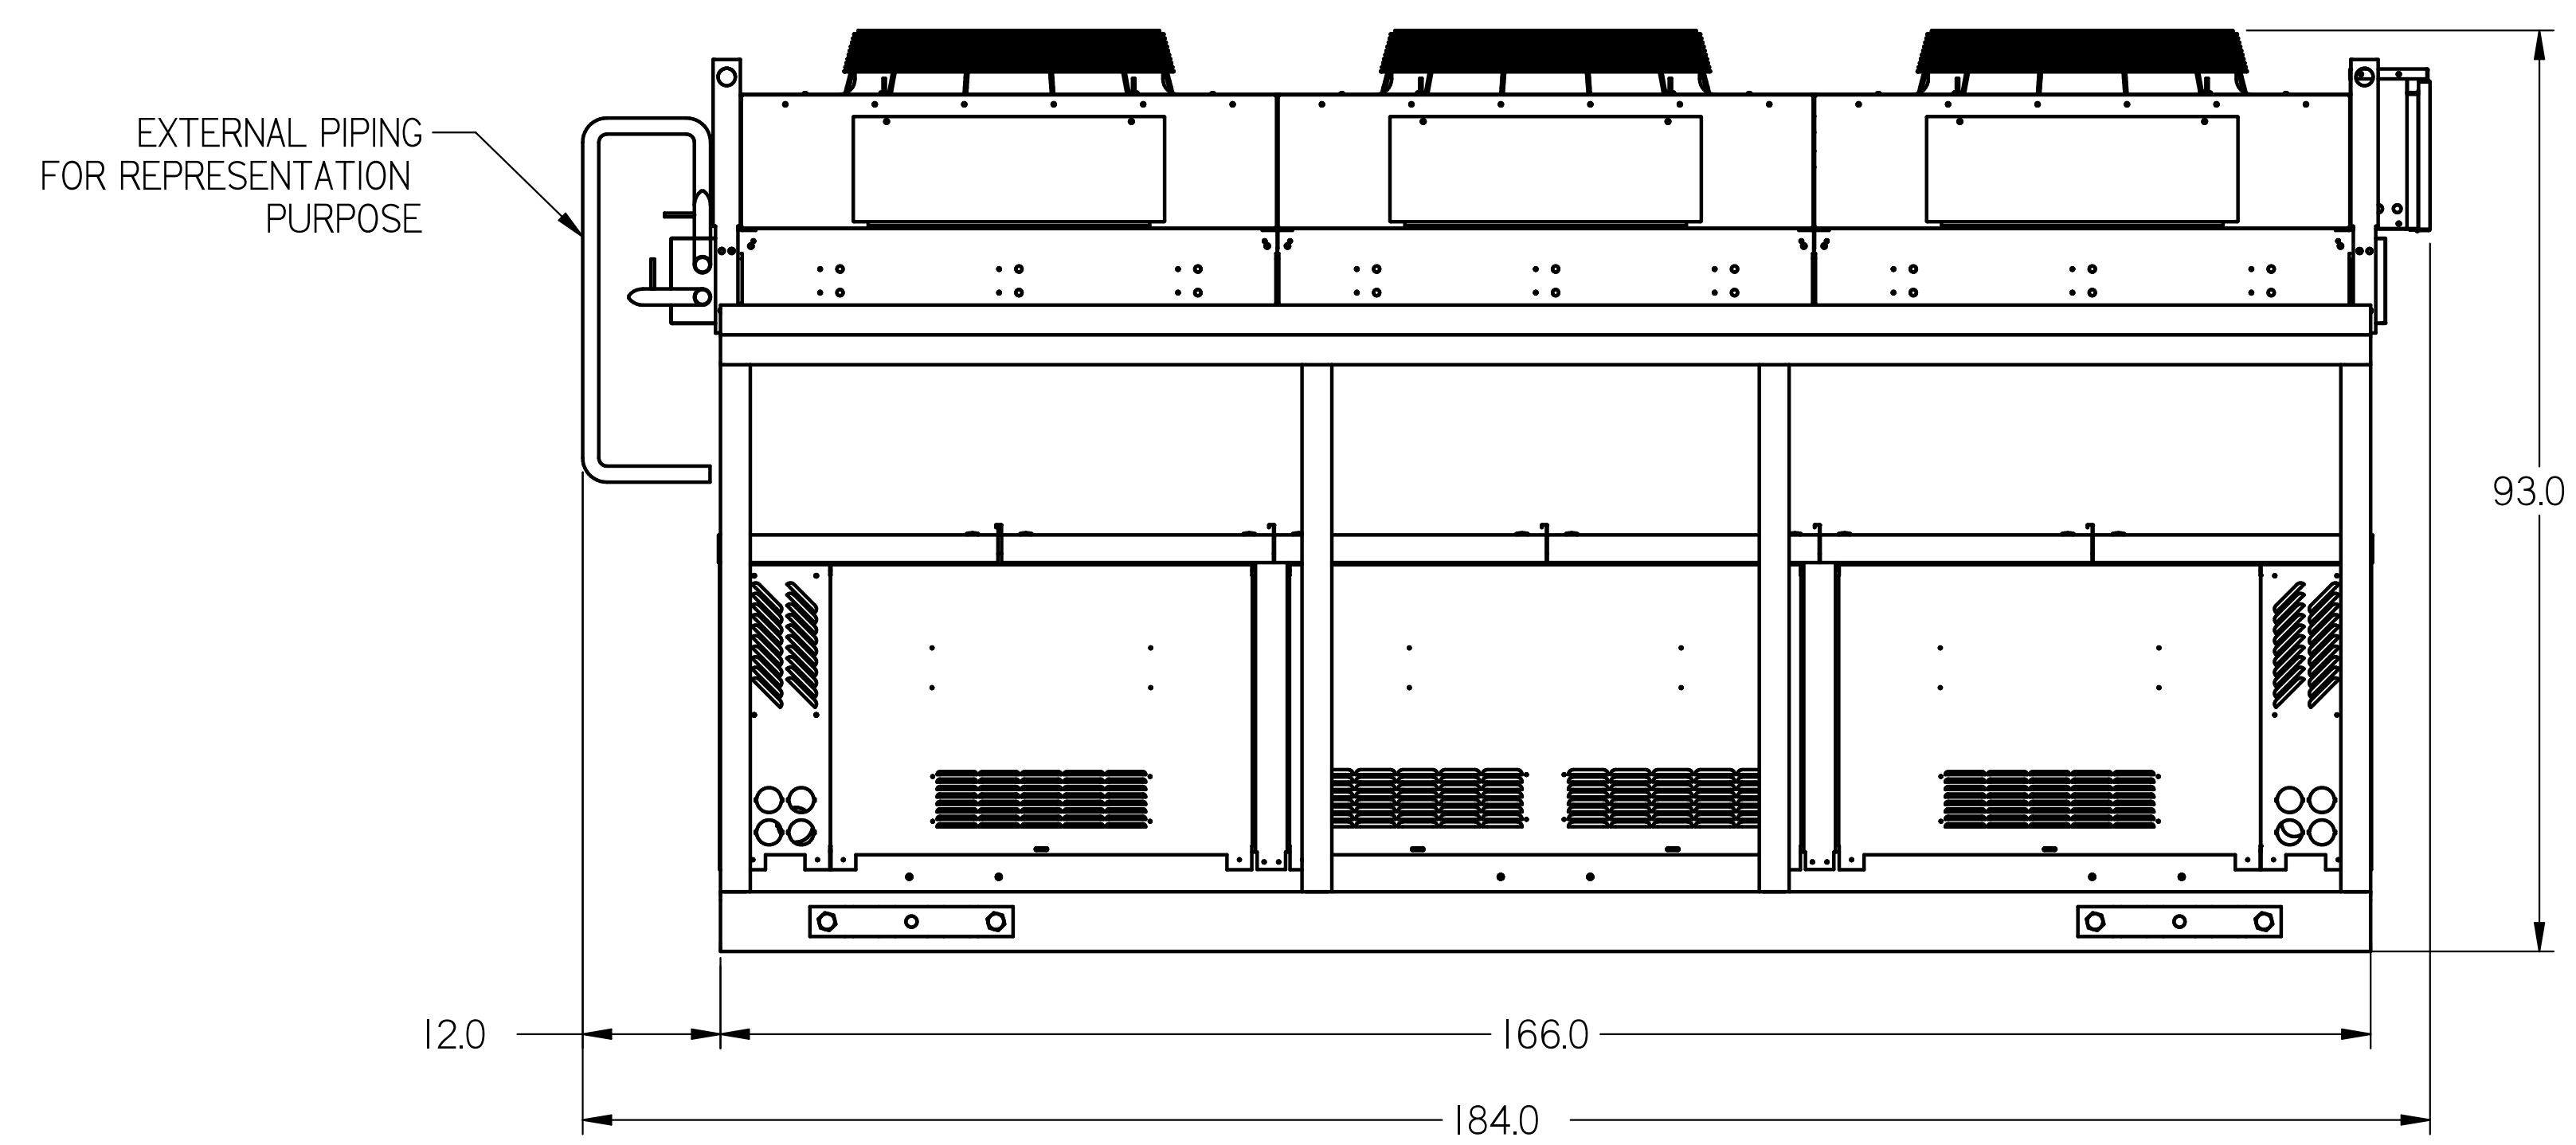
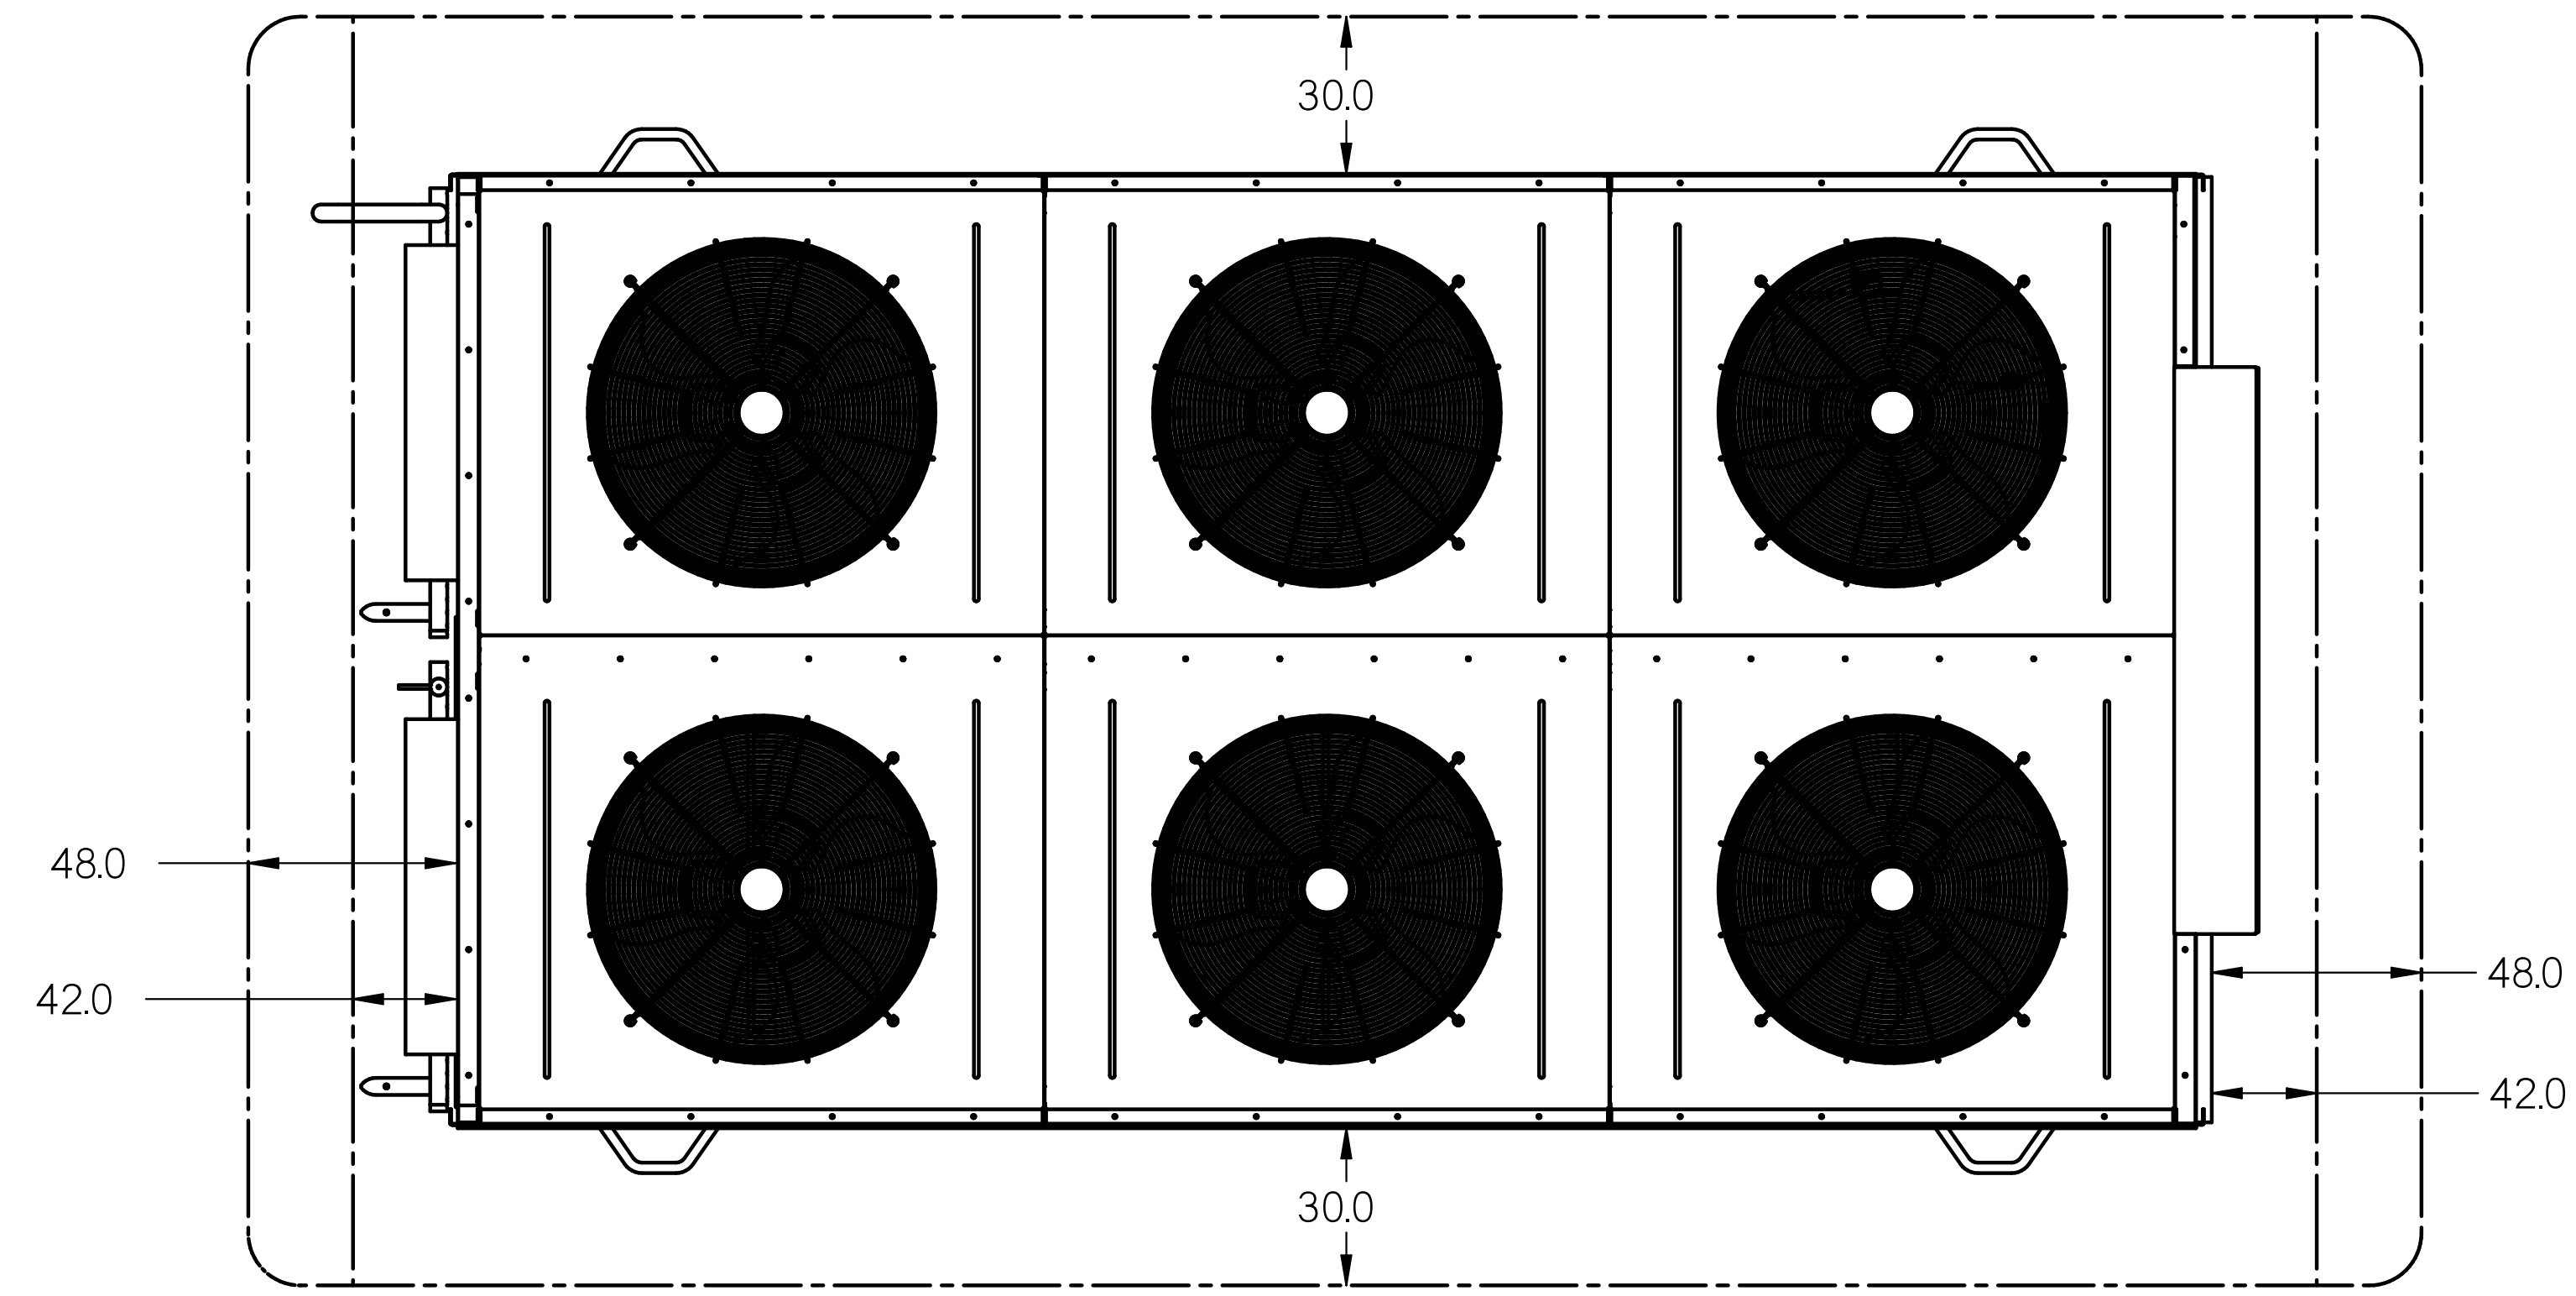


MINIMUM CLEARANCE REQUIREMENTS:
ACTUAL CLEARANCE REQUIREMENTS ARE DEPENDENT UPON AUTHORITY HAVING JURISDICTION AND MAY EXCEED DIMENSIONS SHOWN.
A) 42.0" CLEARANCE BETWEEN CONTROL PANEL AND ANY WALL
B) 48.0" CLEARANCE BETWEEN CONTROL PANEL AND ANY LIVE PANEL
C) 30.0" CLEARANCE FOR WORK SPACE, ADJUSTMENT AND REPLACEMENT OF PARTS

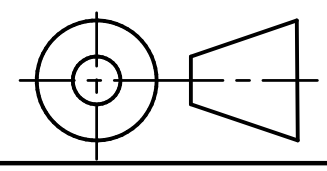

NOTES:
1. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
3. OVERALL DIMENSIONS: 184.0 L X 99.7 W X 93.0 T
4. APPROXIMATE WEIGHT OF THE UNIT = 5750 LBS
5. OLP: OUT DOOR LOW PROFILE, A PRODUCT OF HUSSMANN CORP.

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES.		HUSSmann®	
TOLERANCES ARE: DECIMALS .XX ±.03, .XXX ±.010 ANGLES ± 2°		ASSY 6 COMPR OLP 2X3 COND TOP	
		P/N	
THIRD ANGLE PROJECTION		PD-000000105	
SHEET 1 OF 1		REV A	

SWN 1.0 SHEET METAL SHEET SIZE D