


FROM HEAT RECLAIM

TO HEAT RECLAIM

TO CONDENSER

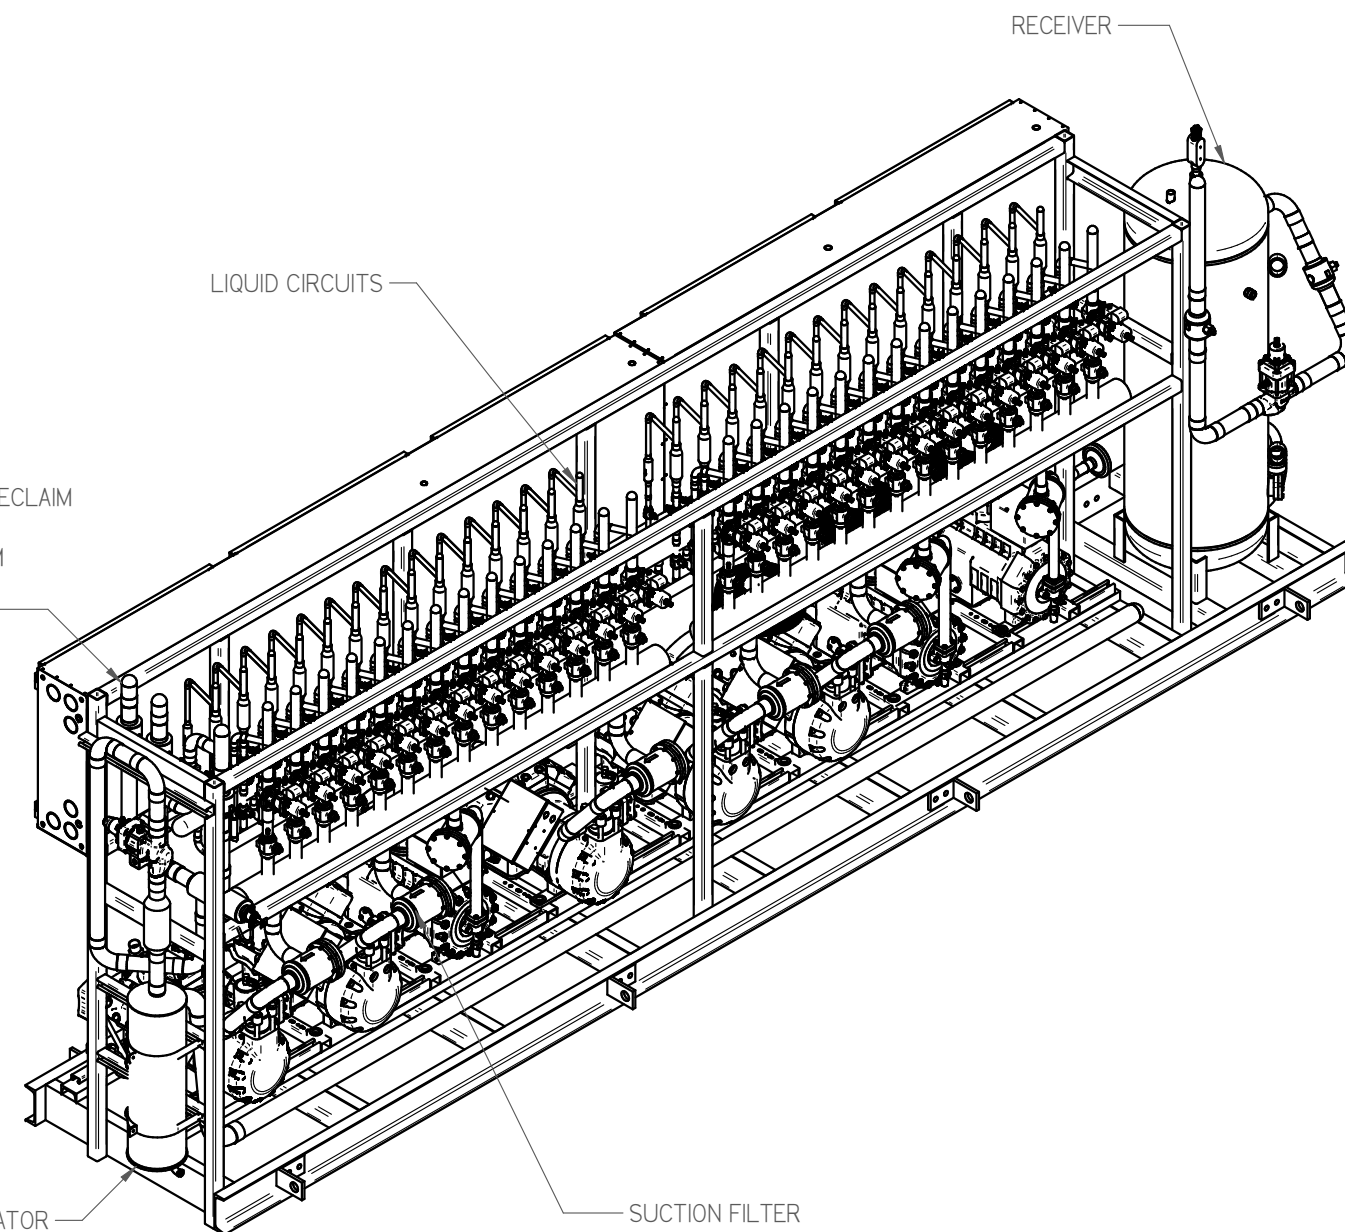

NOTES:

1. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
3. OVERALL DIMENSIONS: 235.1 L X 45.6 W X 84.5 H.
4. RECIEVER SIZES SHOWN ARE BASED UPON 80% CAPACITY

INFORMATION SUBJECT TO CHANGE

DIMENSIONS ARE IN INCHES.
DATE DRAWN: 2017/09/14



SHEET 2 OF 3





HUSSmann®

8CRV-PARALLEL
RACK INDOOR

DOC PD-000000049 REV B

SWN LO SUBMITTAL SHEET SIZE D


RIGGING DETAILS

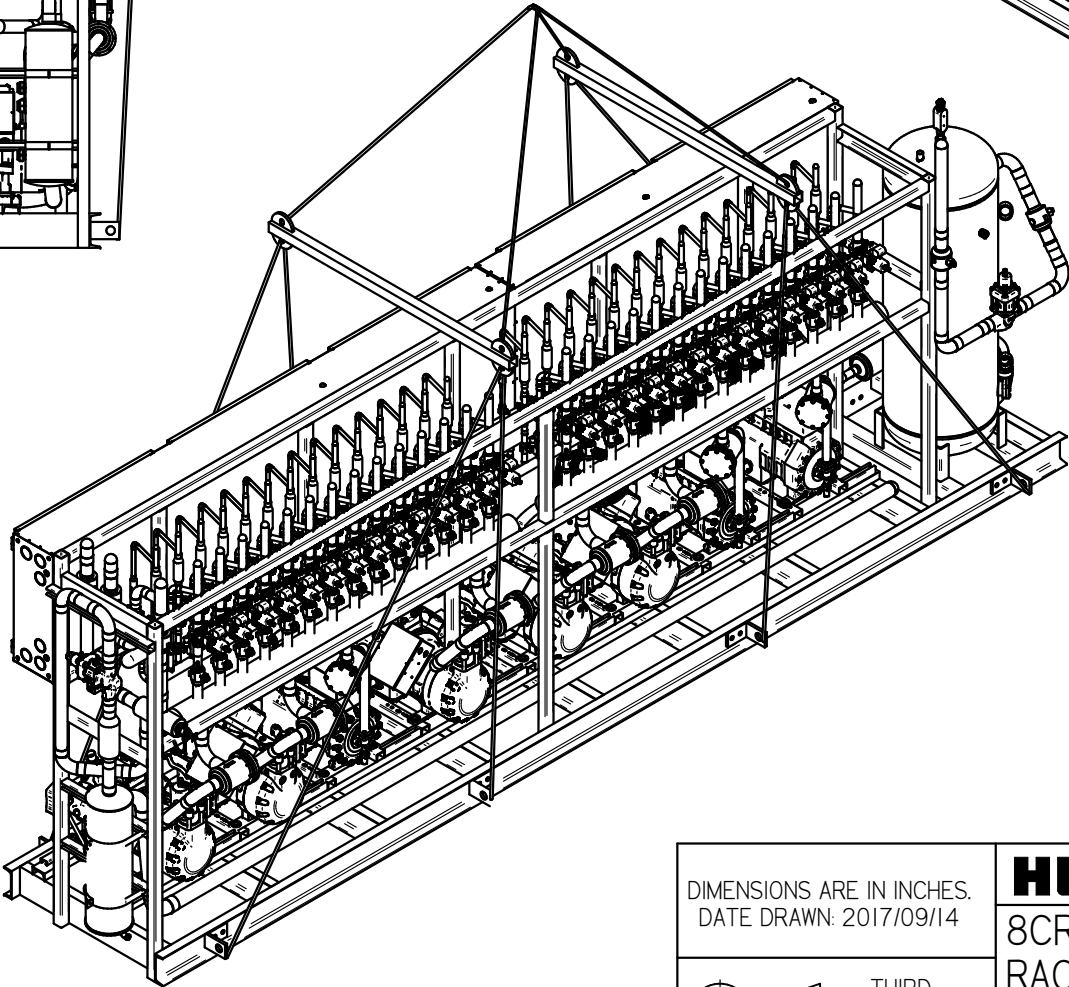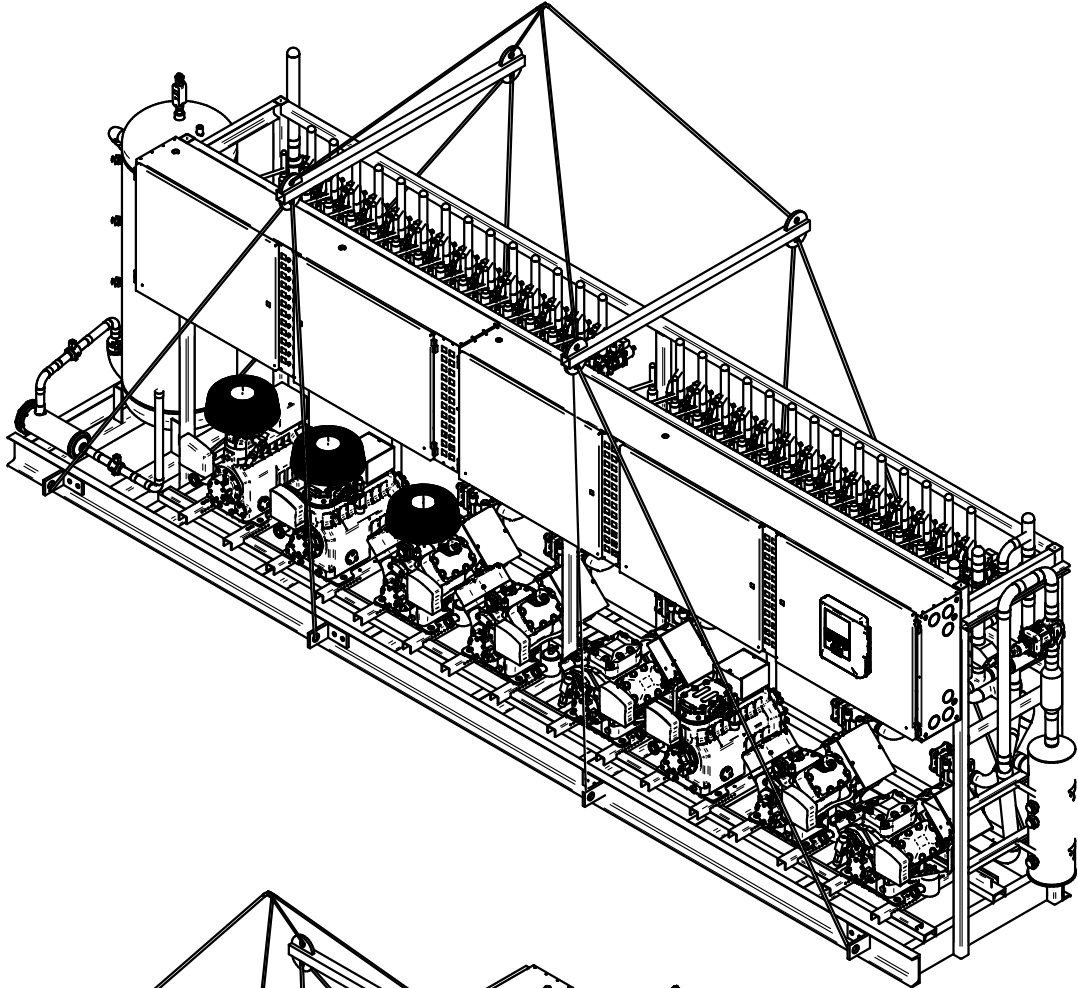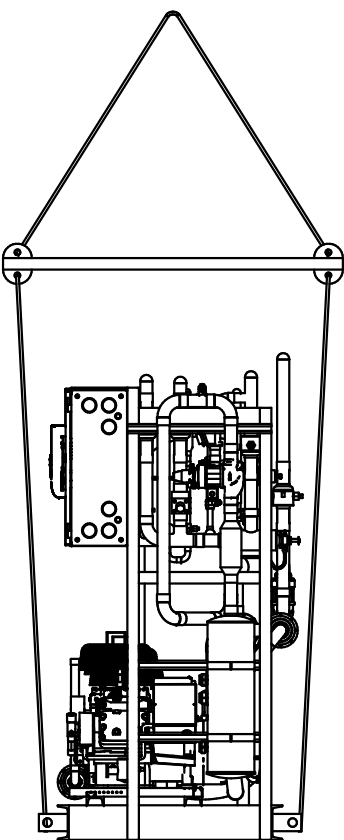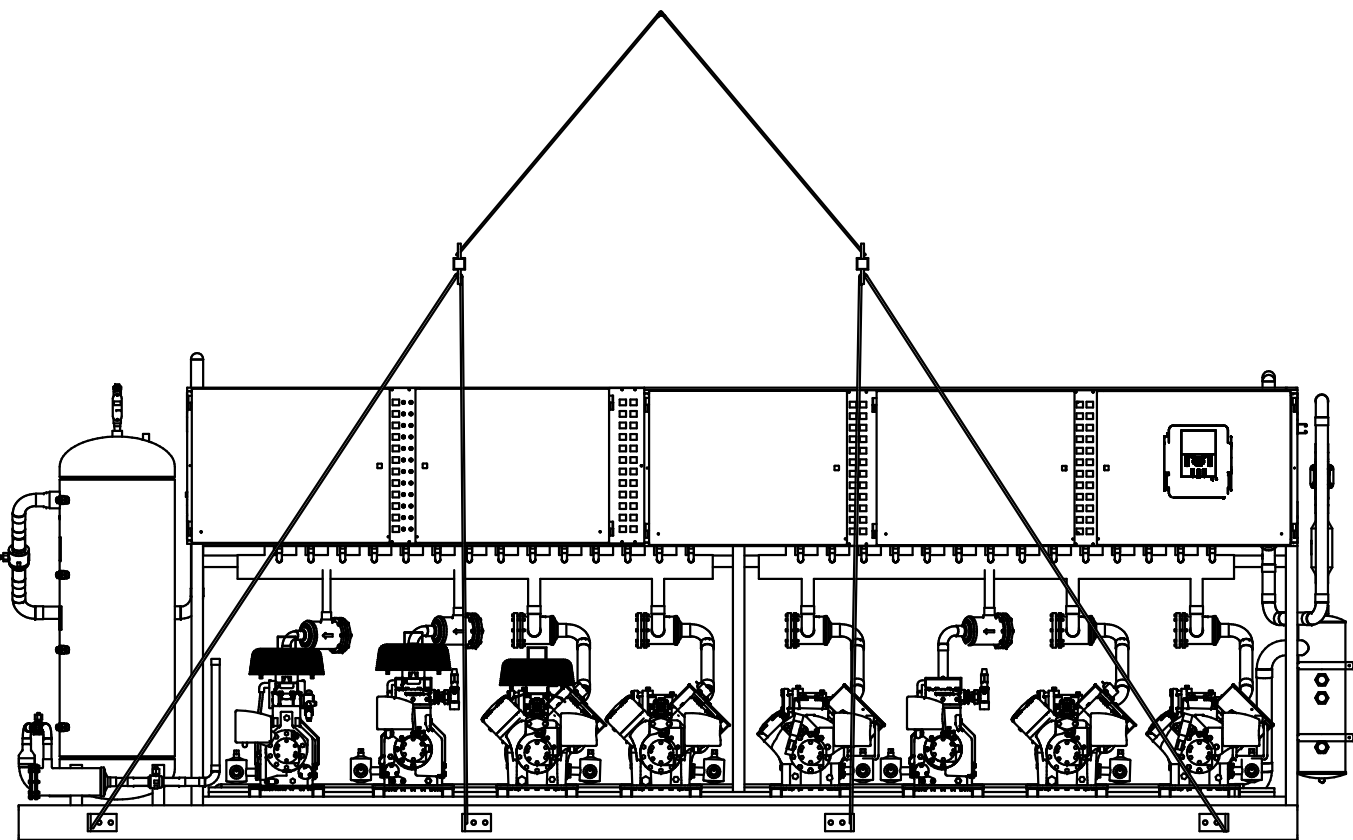

NOTES FOR RIGGING:
THE RIGGING ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY.
ACTUAL RIGGING MAY VARY PER APPLICATION.


- NOTES:
1. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
 3. OVERALL DIMENSIONS: 235.1 L X 45.6 W X 84.5 H.
 4. RECIEVER SIZES SHOWN ARE BASED UPON 80% CAPACITY

INFORMATION SUBJECT TO CHANGE

DIMENSIONS ARE IN INCHES. DATE DRAWN: 2017/09/14		HUSSmann®	
 THIRD ANGLE PROJECTION		8CRV-PARALLEL RACK INDOOR	
SHEET 3 OF 3		DOC PD-000000049	REV B

SWN LO SUBMITTAL SHEET SIZE D

MINIMUM CLEARANCE REQUIREMENTS:
ACTUAL CLEARANCE REQUIREMENTS ARE DEPENDENT UPON
AUTHORITY HAVING JURISDICTION, AND MAY EXCEED
DIMENSION SHOWN.

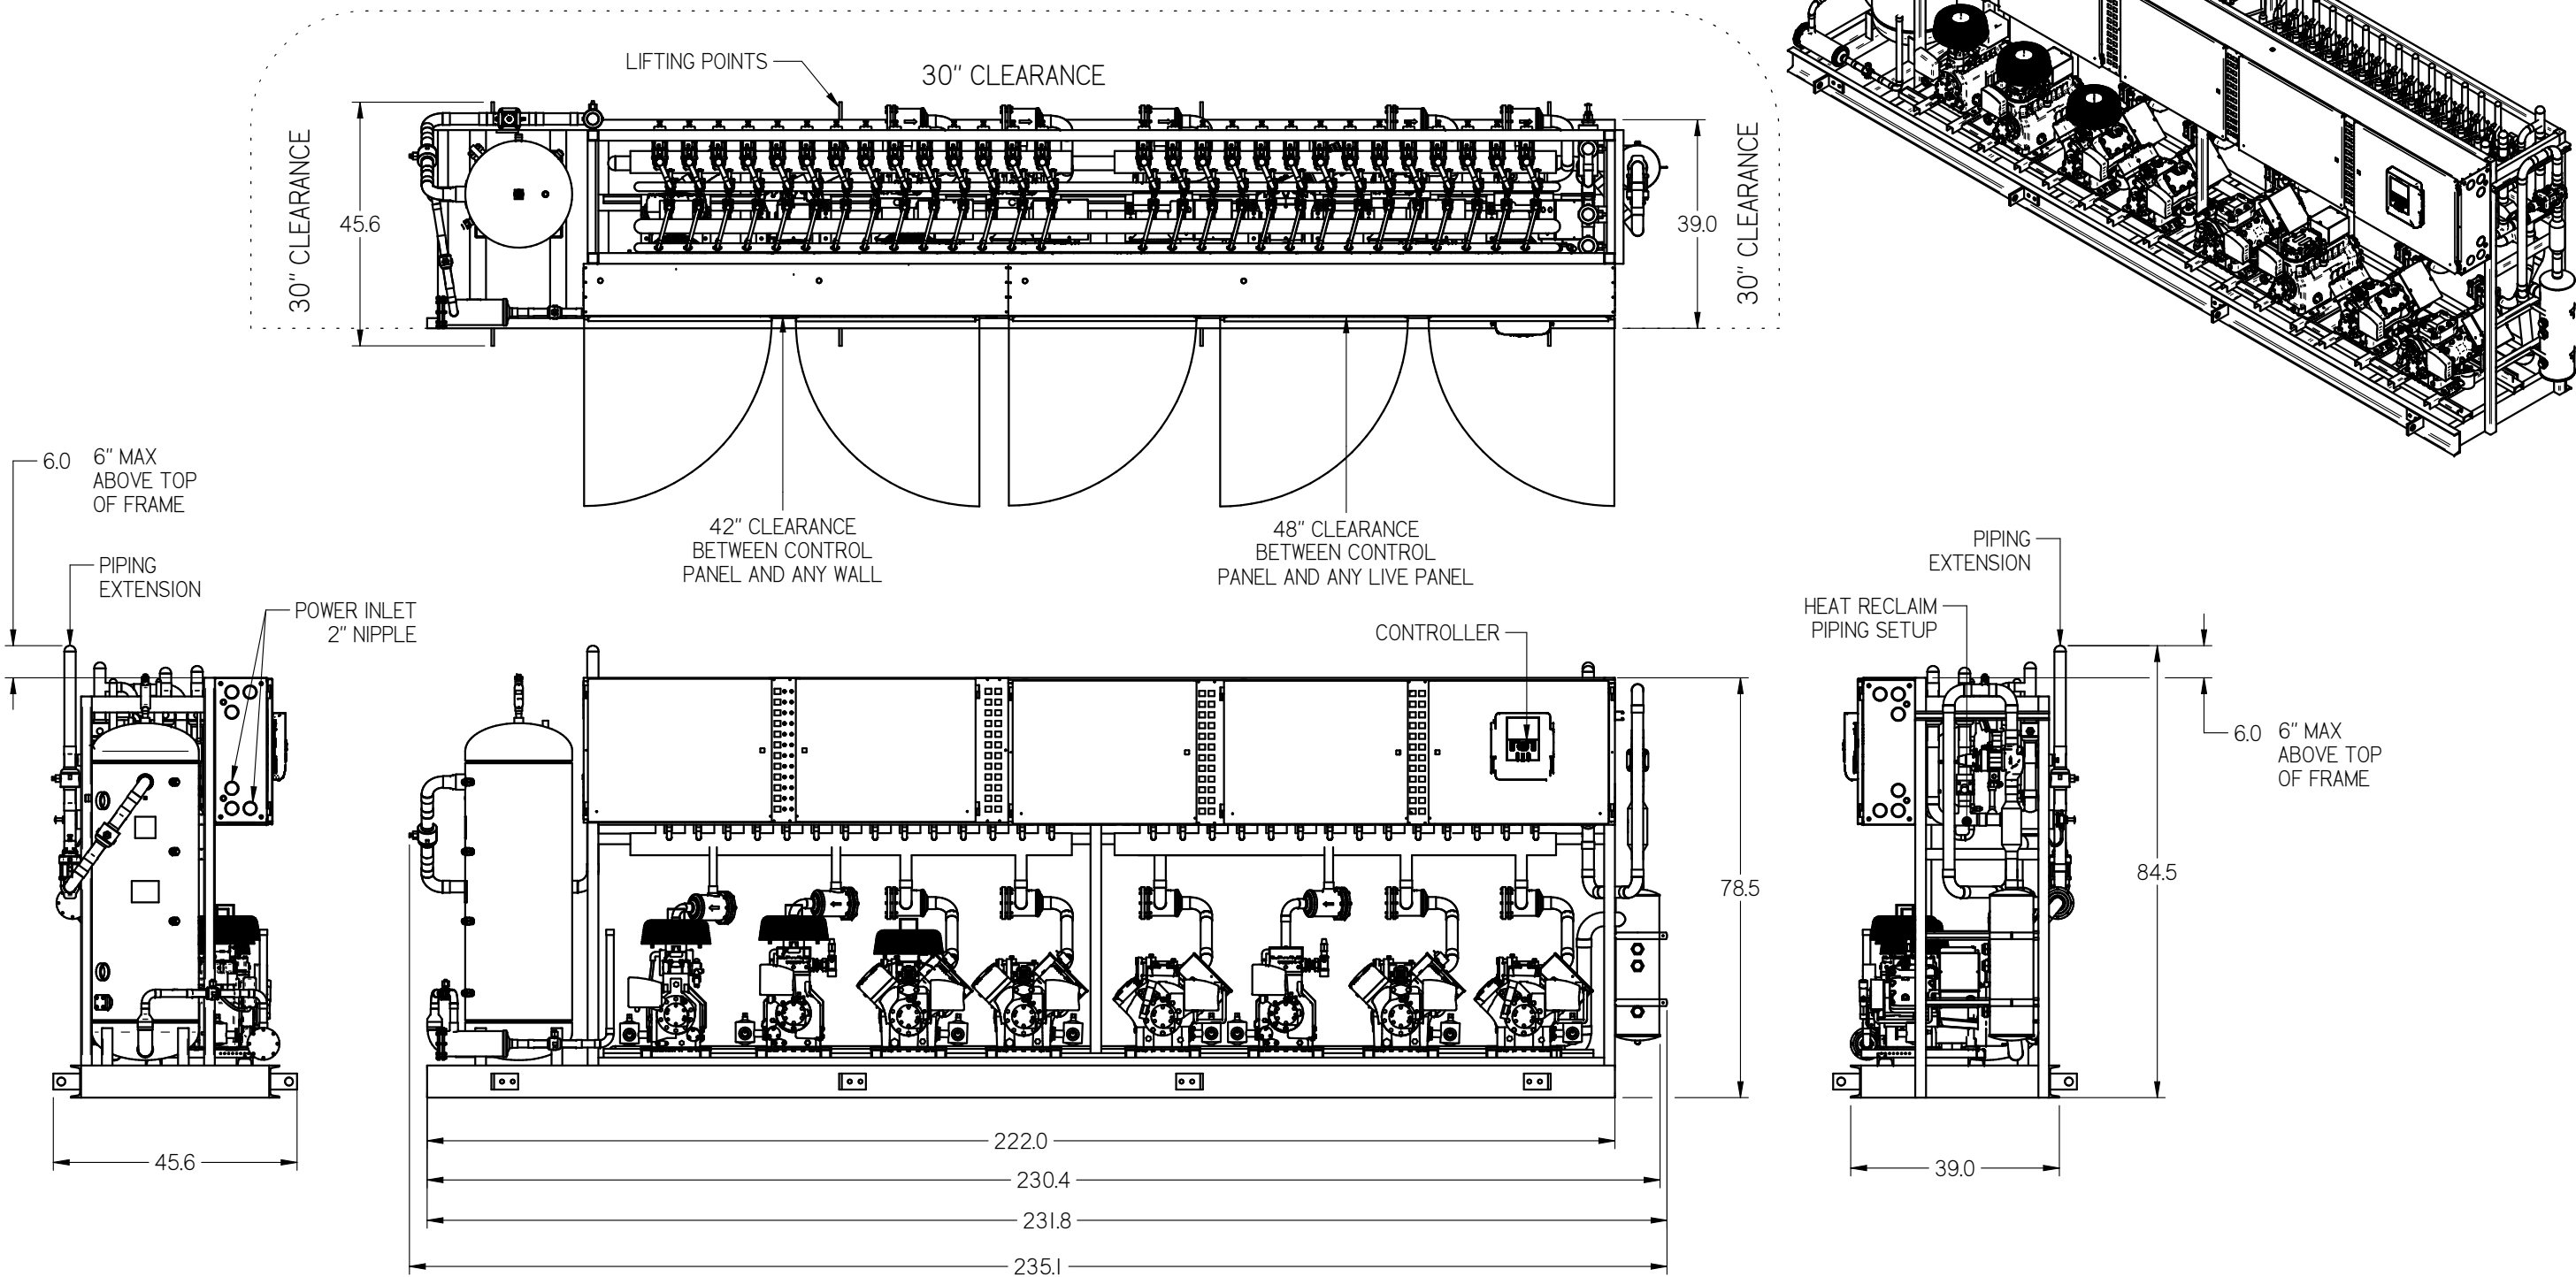

- NOTES:
1. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
 3. OVERALL DIMENSIONS: 235.1 L X 45.6 W X 84.5 H.
 4. RECIEVER SIZES SHOWN ARE BASED UPON 80% CAPACITY

RACK DIMENSIONS: 230"L X 39"W X 78.5"H

MAXIMUM TOTAL UNIT WEIGHT(LBS)	
SHIPPING	OPERATING
6319	6870

INFORMATION SUBJECT TO CHANGE

DIMENSIONS ARE IN INCHES.
DATE DRAWN: 2017/09/14

THIRD
ANGLE
PROJECTION


SHEET 1 OF 3

HUSSmann[®]

8CRV-PARALLEL
RACK INDOOR

DOC PD-000000049 REV B


SWN 1.0 SUBMITTAL SHEET SIZE D

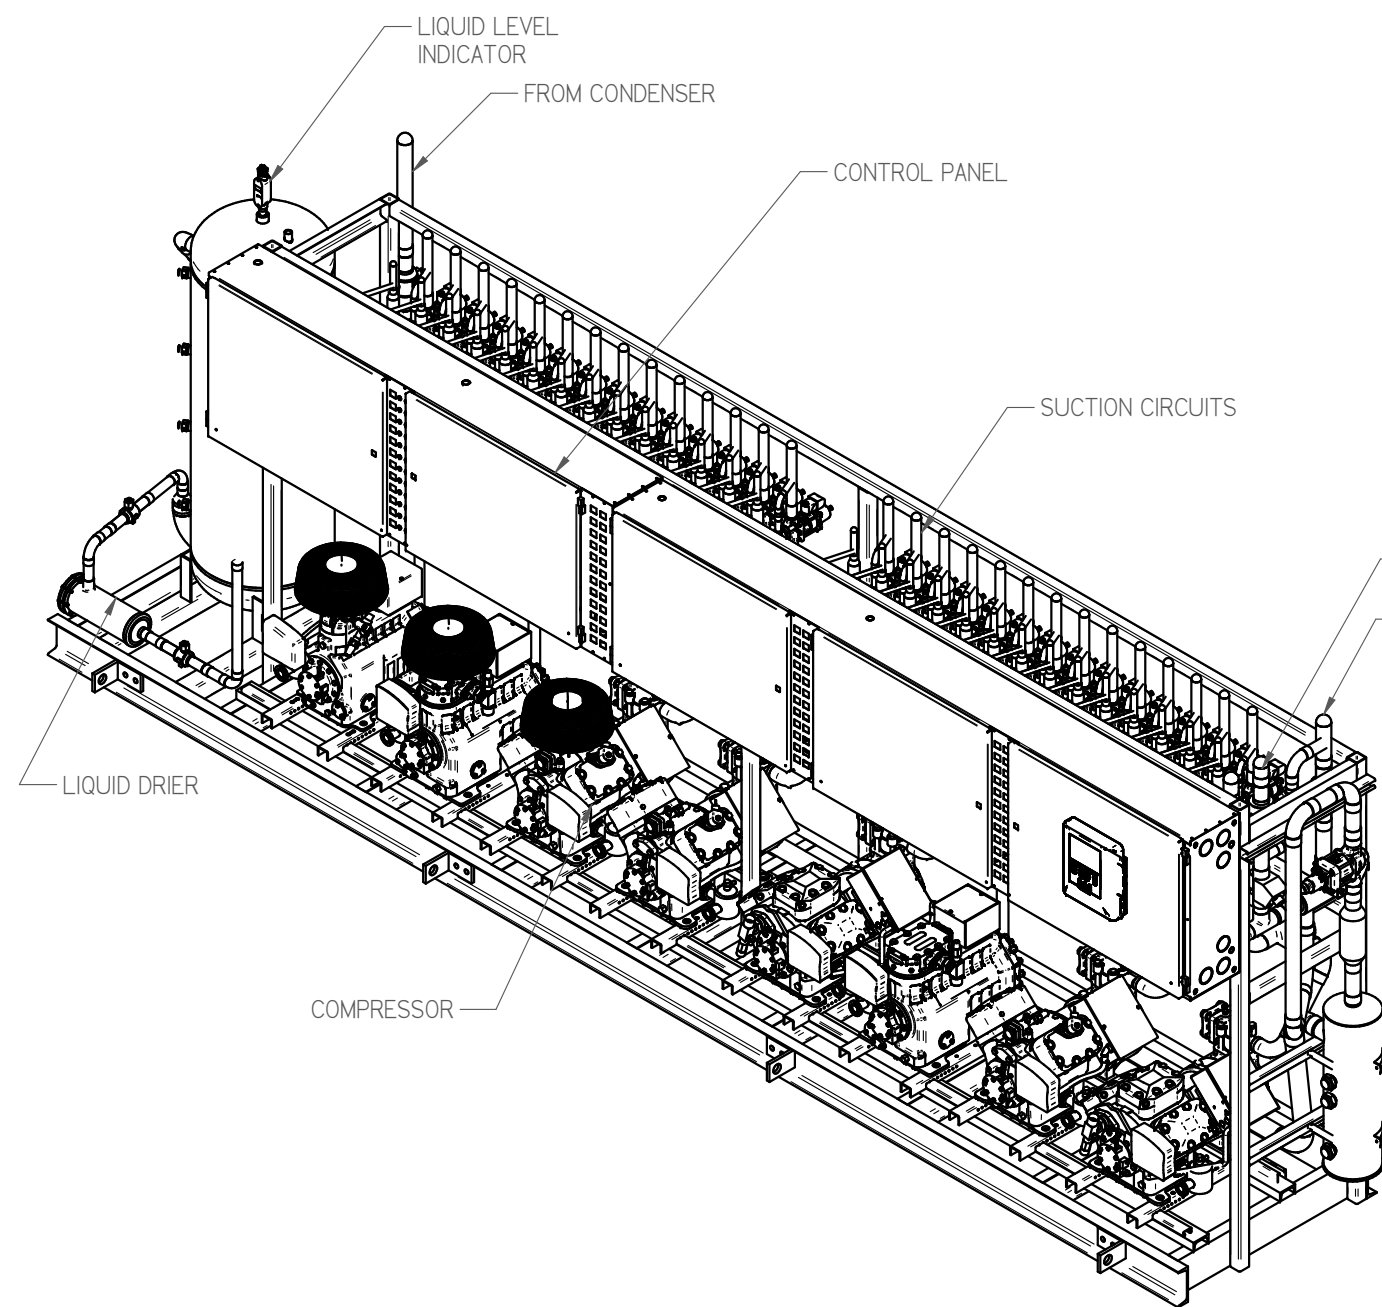

FROM HEAT RECLAIM

TO HEAT RECLAIM

TO CONDENSER

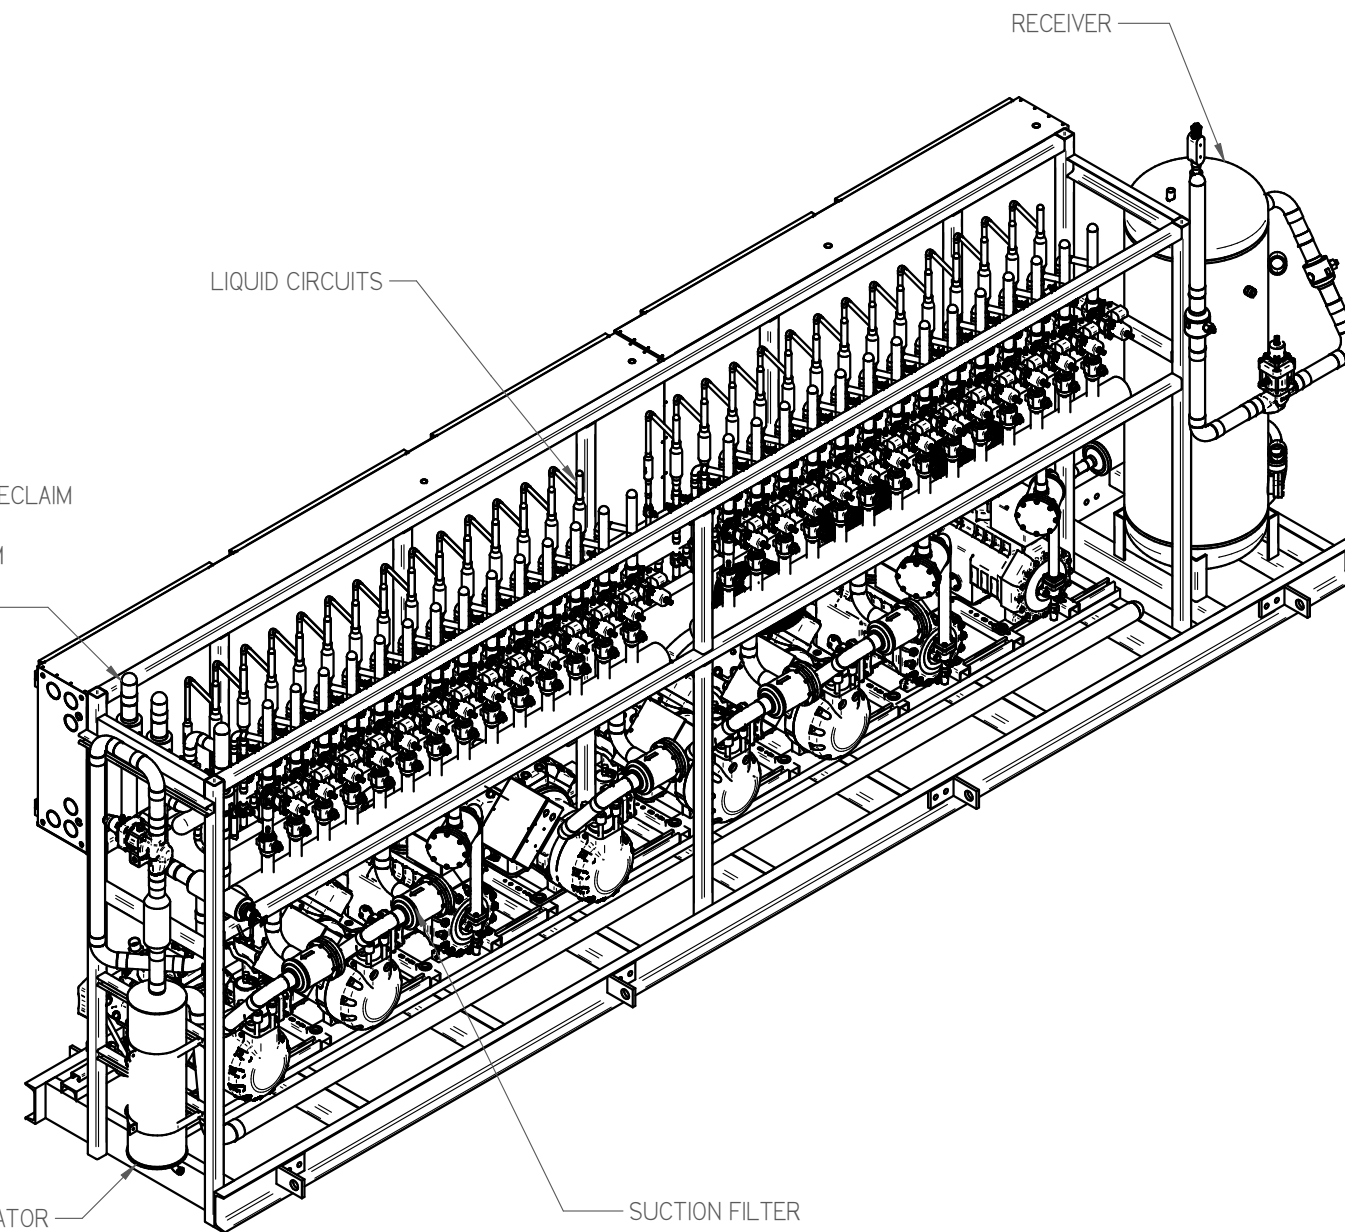

NOTES:

1. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
3. OVERALL DIMENSIONS: 235.1 L X 45.6 W X 84.5 H.
4. RECIEVER SIZES SHOWN ARE BASED UPON 80% CAPACITY

INFORMATION SUBJECT TO CHANGE

DIMENSIONS ARE IN INCHES.
DATE DRAWN: 2017/09/14



SHEET 2 OF 3





HUSSmann®

8CRV-PARALLEL
RACK INDOOR

DOC PD-000000049 REV B

SWN LO SUBMITTAL SHEET SIZE D


RIGGING DETAILS

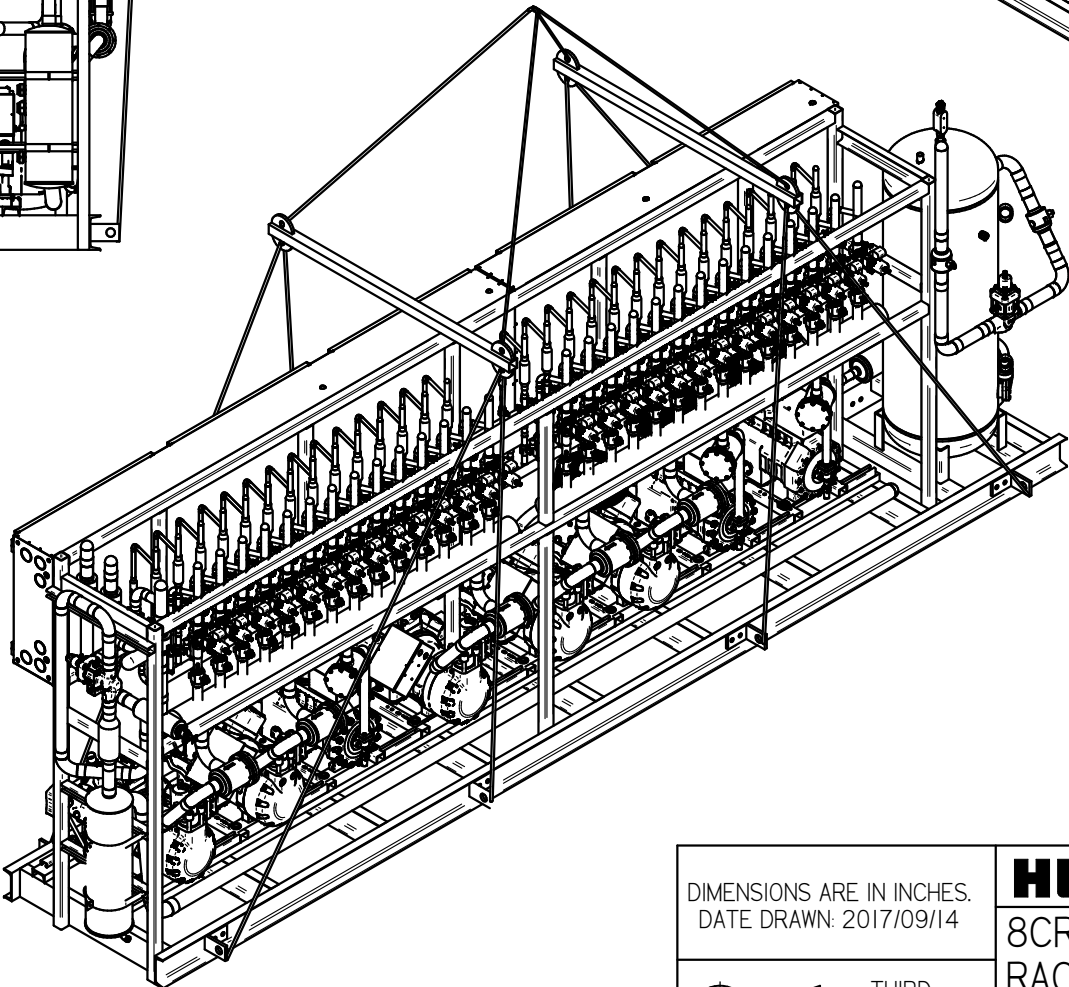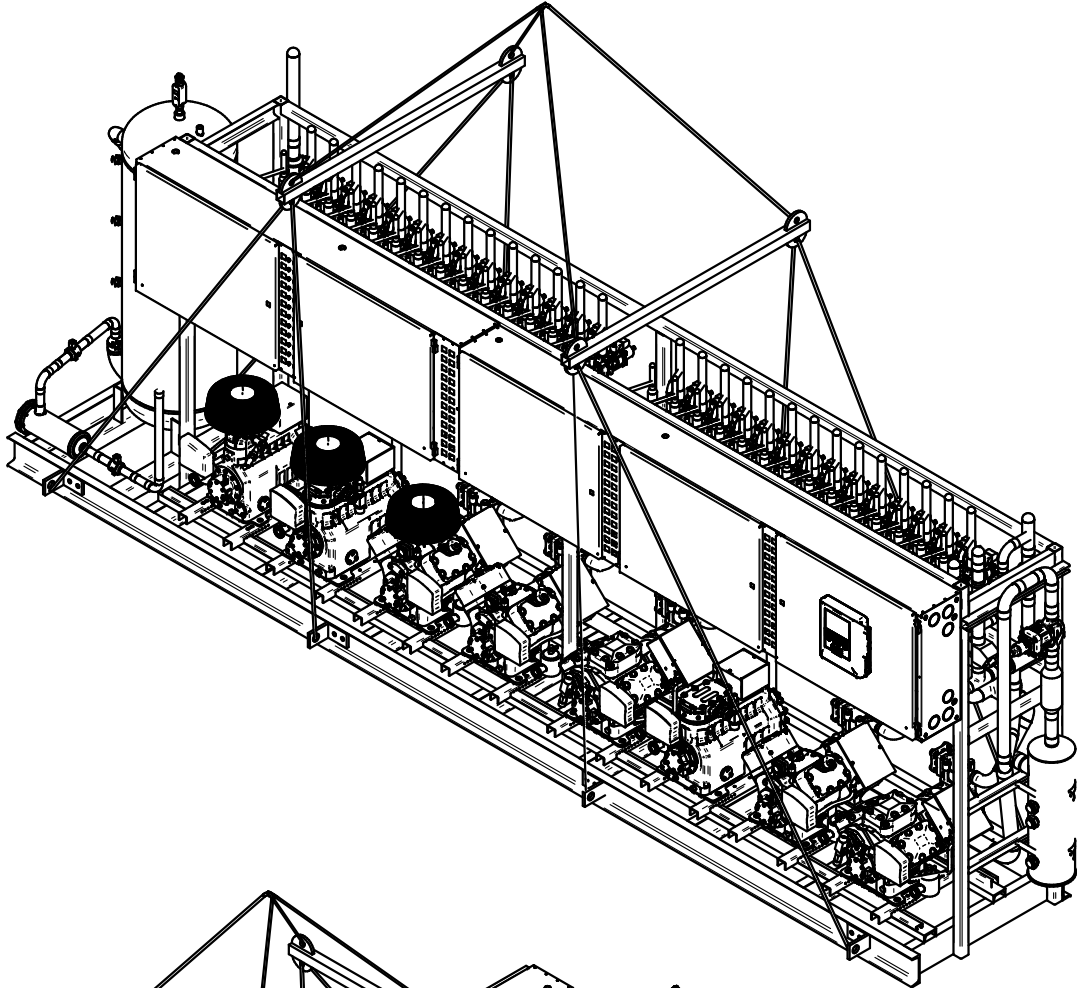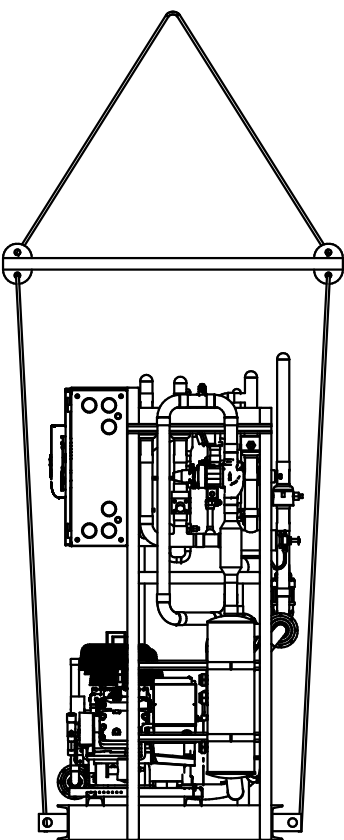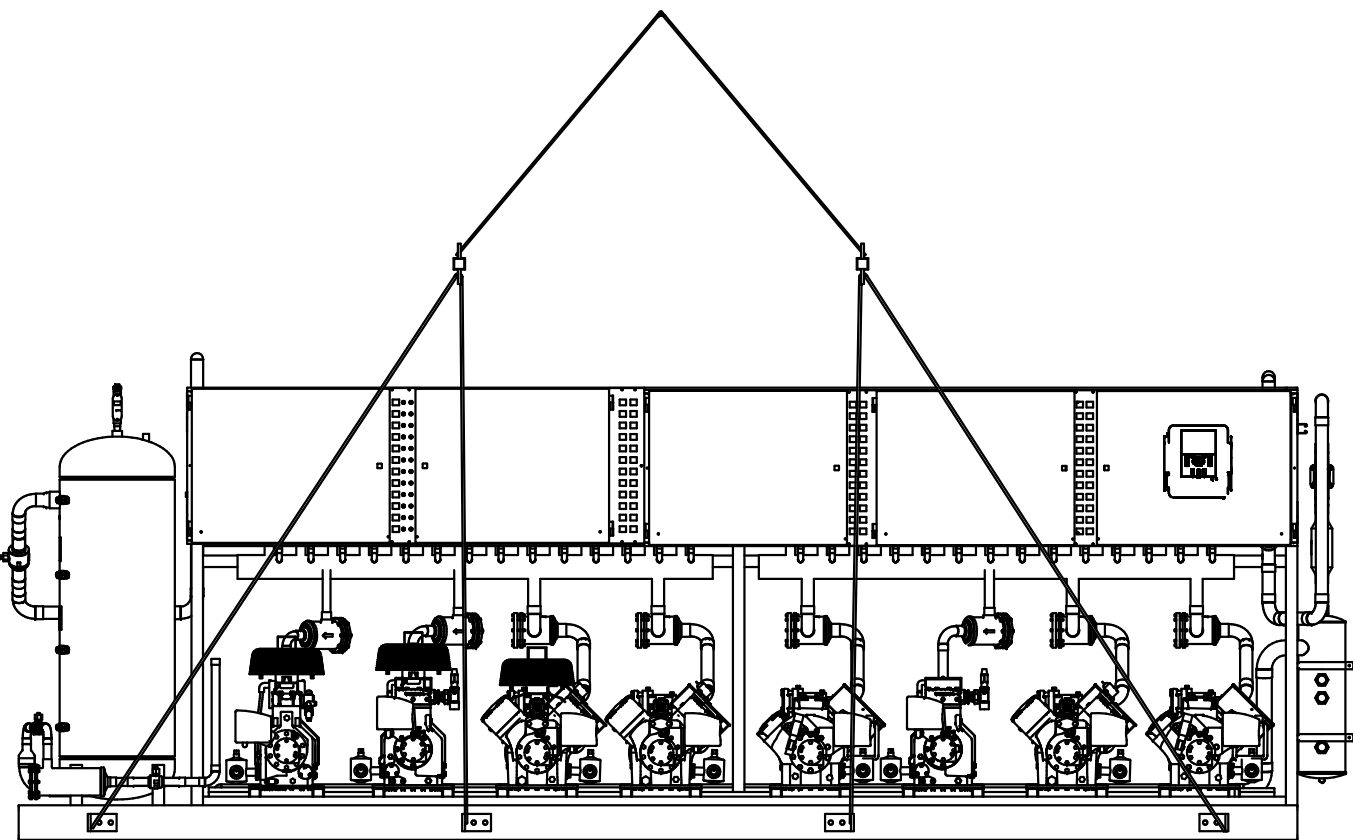

NOTES FOR RIGGING:
THE RIGGING ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY.
ACTUAL RIGGING MAY VARY PER APPLICATION.

- NOTES:
- 1. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
 - 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
 - 3. OVERALL DIMENSIONS: 235.1 L X 45.6 W X 84.5 H.
 - 4. RECIEVER SIZES SHOWN ARE BASED UPON 80% CAPACITY

INFORMATION SUBJECT TO CHANGE

DIMENSIONS ARE IN INCHES. DATE DRAWN: 2017/09/14		HUSSmann®	
 THIRD ANGLE PROJECTION		8CRV-PARALLEL RACK INDOOR	
		DOC PD-000000049	REV B
SHEET 3 OF 3			

SWN LO SUBMITTAL SHEET SIZE D