


NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
- 3. OVERALL DIMENSIONS: 50.1 L X 35.0 W X 49.7 H.



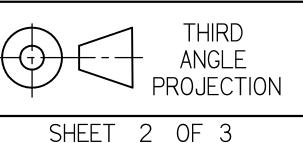

INFORMATION SUBJECT TO CHANGE

HIGH EFFICIENCY H SERIES MD OD HD BASE


DOC PD-00000018 REV F

MINIMUM CLEARANCE REQUIREMENTS: INTAKE ACTUAL CLEARANCE REQUIREMENTS ARE INTAKE DEPENDENT UPON AUTHORITY HAVING **EXHAUST EXHAUST EXHAUST EXHAUST** JURISDICTION, AND MAY EXCEED DIMENSIONS SHOWN. **EXHAUST EXHAUST** 60.0 CLEARANCE BETWEEN MULTIPLE UNIT SIDE EXHAUSTS 48.0 INTAKE 0.081 CLEARANCE BETWEEN REAR UNIT EXHAUST AND FRONT UNIT INTAKE 48.0 **EXHAUST** EXHAUST CLEARANCE ON MULTIPLE UNIT APPLICATION CONTROL PANEL PROVIDE CLEARANCES AS SHOWN TO ENSURE FACING LEFT **EXHAUST** ADEQUATE AIRFLOW, REDUCE THE POTENTIAL END OF UNIT FOR AIR RECIRCULATION AND FACILITATE SERVICE ACCESSIBILITY. INTAKE 48.0 **EXHAUST EXHAUST EXHAUST** CLEARANCE ON A SINGLE UNIT APPLICATION HUSSMANN DIMENSIONS ARE IN INCHES.

NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.

3. OVERALL DIMENSIONS: 50.1 L X 35.0 W X 49.7 H.

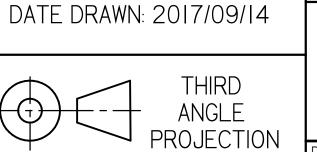

SHEET 3 OF 3

INFORMATION SUBJECT TO CHANGE

HIGH EFFICIENCY H SERIES MD OD HD BASE

PD-00000018 REV