


NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
- 3. OVERALL DIMENSIONS: 44.1 L X 32.4 W X 32.1 H.






HIGH EFFICIENCY H SERIES SM OD HD BASE

PD-00000017 REVE


INFORMATION SUBJECT TO CHANGE

O CHANGE SHEET 2 OF 3

MINIMUM CLEARANCE REQUIREMENTS: ACTUAL CLEARANCE REQUIREMENTS ARE DEPENDENT UPON AUTHORITY HAVING JURISDICTION, AND MAY EXCEED DIMENSIONS SHOWN.

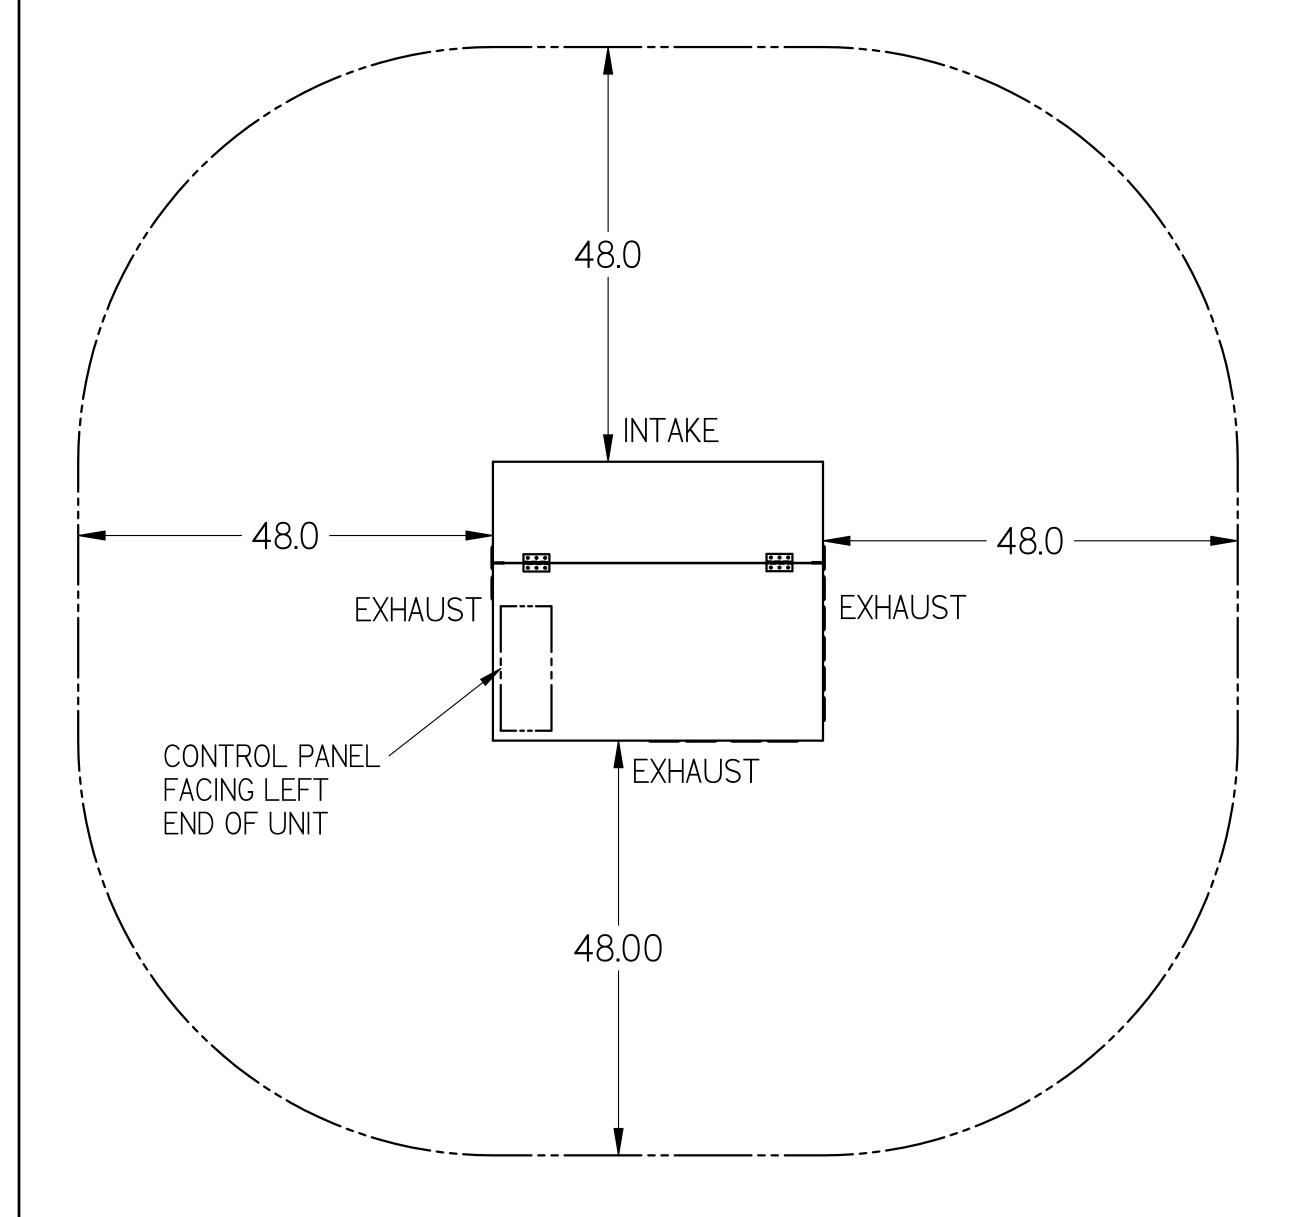


CLEARANCE ON A SINGLE UNIT APPLICATION

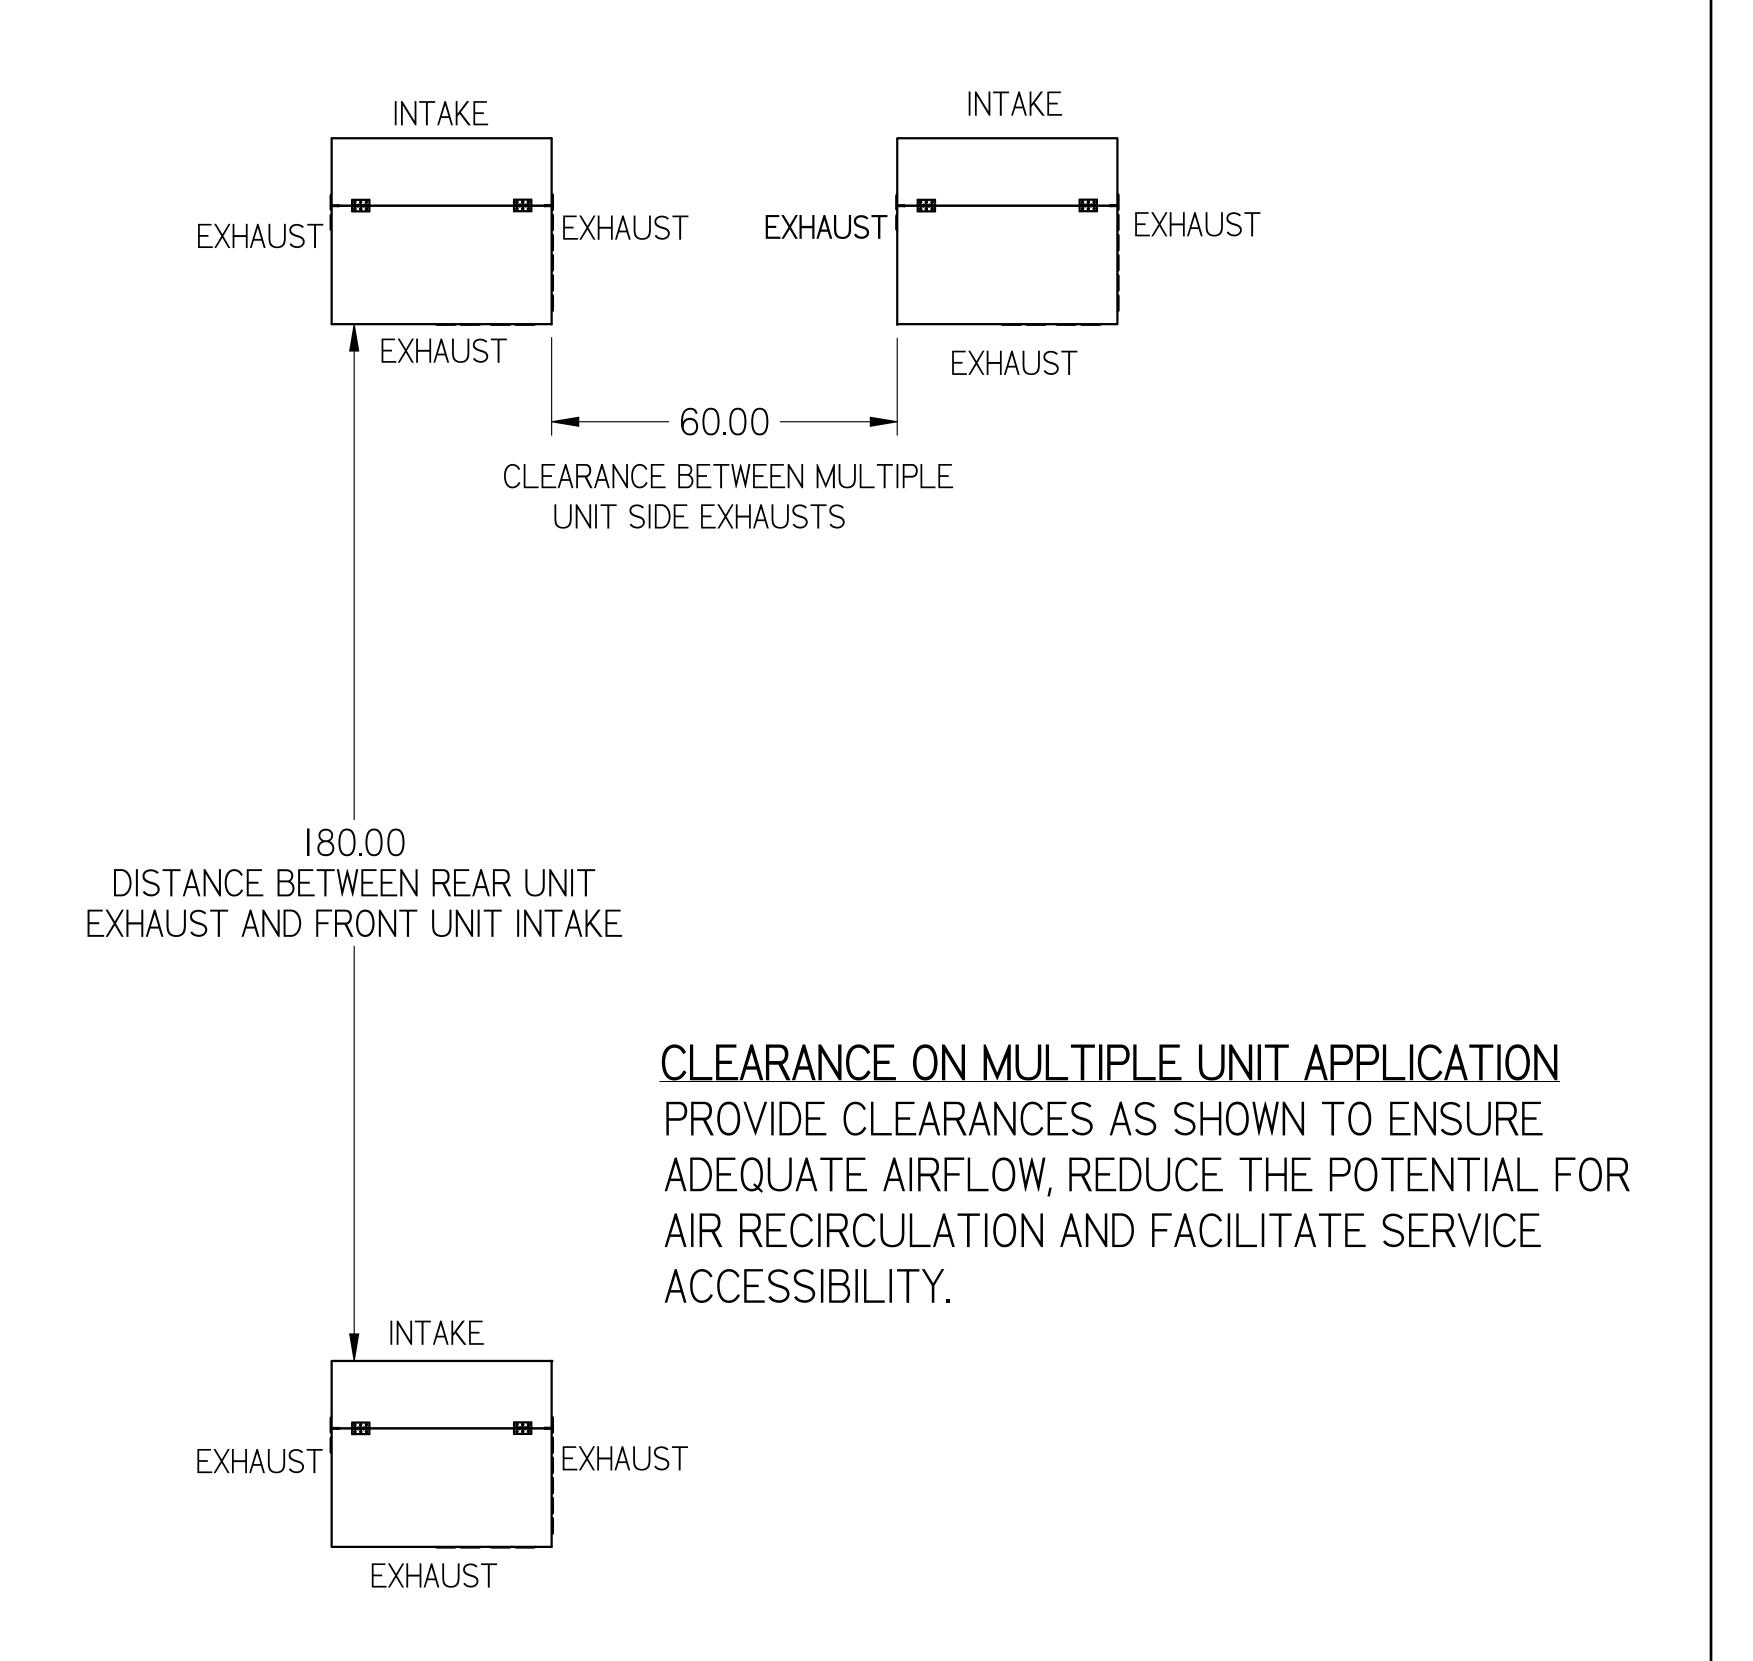

NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.

3. OVERALL DIMENSIONS: 44.1 L X 32.4 W X 32.1 H.

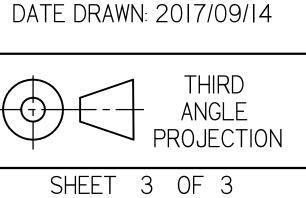

DIMENSIONS ARE IN INCHES.

HUSSMANN
HIGH EFFICIENCY H
SERIES SM OD HD

BASE PD-0000017 E

INFORMATION SUBJECT TO CHANGE